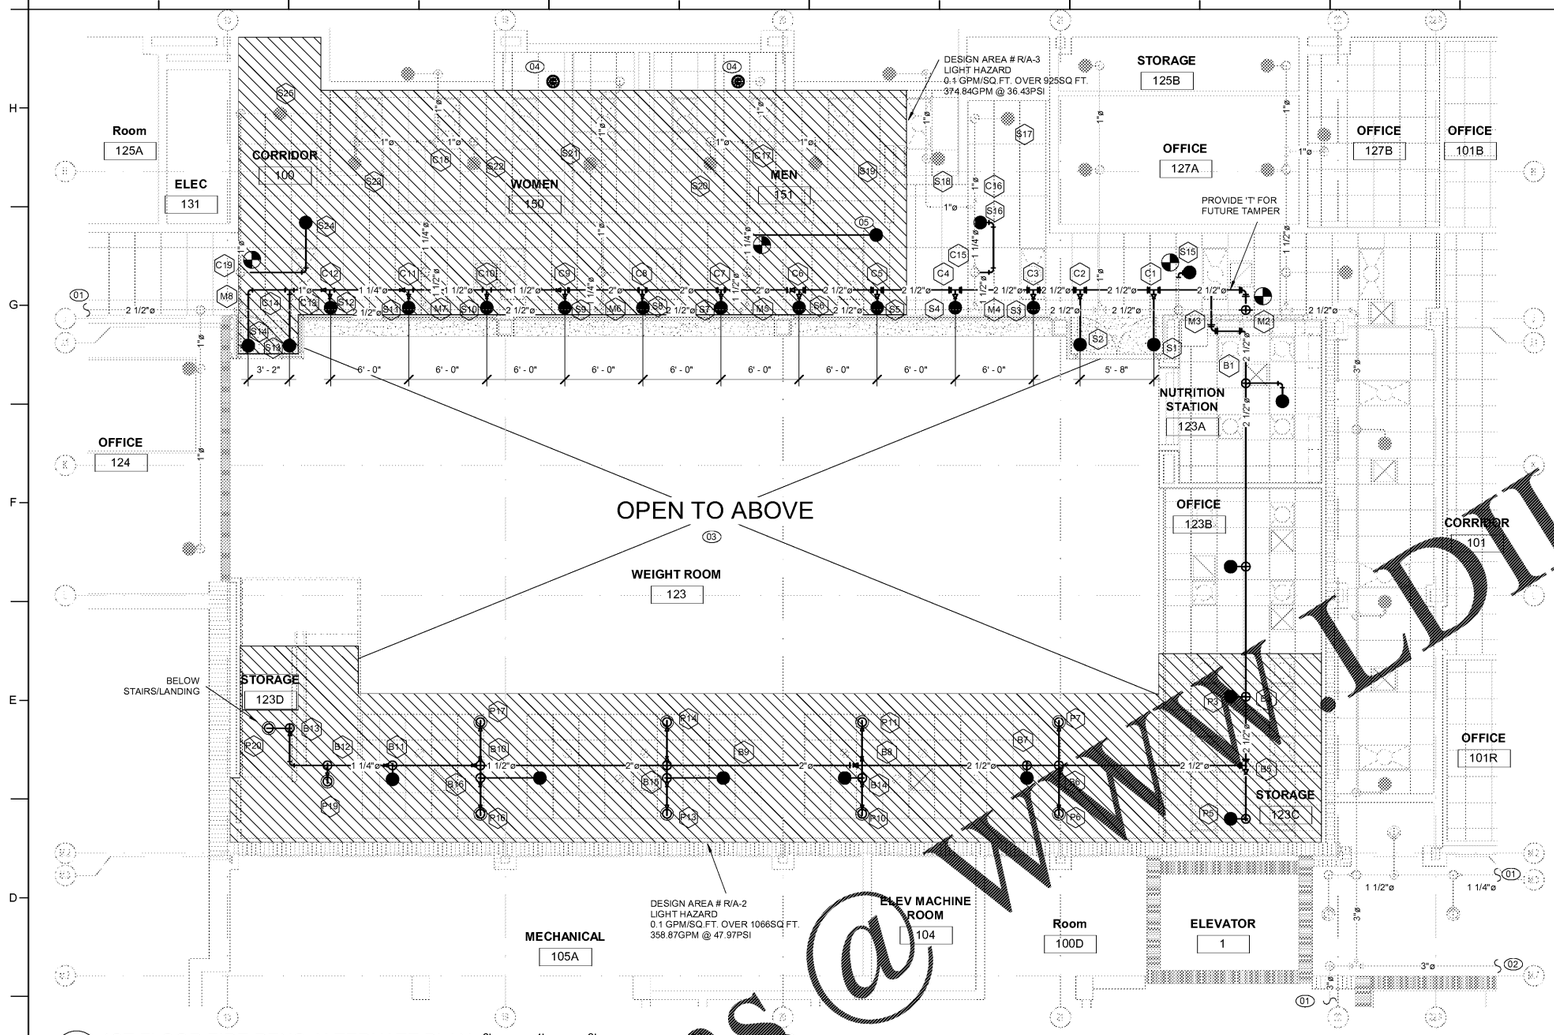

C1 1ST FLOOR FIRE RENO ALTERNATE PLAN
3/16" = 1'-0"

0' 4' 8'

FLOOR PLAN KEY NOTES:

NOTE: NOT ALL KEY NOTES BELOW ARE APPLICABLE TO THIS SHEET. KEY NOTES SUPPLEMENT INFORMATION FOUND ELSEWHERE IN THE DRAWINGS. SEE SHEET FP-0.1 FOR FIRE PROTECTION GENERAL NOTES, LEGENDS, AND ADDITIONAL REQUIREMENTS.

01 EXISTING SPRINKLER PIPE BRANCHLINE CONTINUES TO EXISTING SPRINKLERS. REFERENCE EXISTING AS-BUILT DOCUMENTS FOR CONTINUATION.

02 EXISTING SPRINKLER PIPE MAIN CONTINUES TO EXISTING FLOOR CONTROL ASSEMBLY. REFERENCE FP1.1 FOR CONTINUATION.

03 THIS AREA ON FP2.1 IS OPEN TO ABOVE AND SERVED BY EXISTING SPRINKLERS ON FP2.2.

04 RESTROOM FOOTPRINT IS CHANGING. SPRINKLER CONTRACTOR SHALL RE-ARRANGE AND RELOCATE HEADS TO COMPLY WITH SPRINKLER SPACING REQUIREMENTS FOR LIGHT HAZARD OUTLINED IN NFPA13 AS NECESSARY. THE TWO SPRINKLERS INDICATED OVER GYMNASIUM BLEACHERS SHALL BE LIT WITHIN REVISED RESTROOM FOOTPRINT TO COVER NEW RESTROOM FOOTPRINT.

05 PROVIDE NEW SPRINKLER HEAD FOR WATER COOLER NOOK.

FLOOR PLAN GENERAL NOTES:

1. REFER TO SHEET FP-0.1 FOR GENERAL NOTES.

RATED ASSEMBLIES LEGEND:

NOTES: RATINGS ARE NOT SHOWN THROUGH DOORS FOR CLARITY. SEE A-0.1 FOR PARTITION TYPES. SEE LIFE SAFETY PLANS ON T-2.1 AND T-2.2 FOR FULL EXTENT OF RATINGS, INCLUDING HORIZONTAL RATINGS. RATINGS ARE CONTINUOUS AROUND OPENINGS AND OPENINGS ARE TO BE PROTECTED IN ACCORDANCE WITH THE NC STATE BUILDING CODE. PROTECT ALL PENETRATIONS.

SEE T-SHEETS FOR UL RATINGS AND ADDITIONAL INFORMATION.

- 1-HR RATED FIRE BARRIER
- 2-HR RATED FIRE BARRIER
- SMOKE RESISTANT WALL
- NEW SMOKE RESISTANT WALL

KEY PLAN

FIRST FLOOR = NTS



Order Plans @ WWW.LDILine.com

Davis Kane
ARCHITECTS, P.A.
ARCHITECTURE . PLANNING . INTERIORS
503.300 OBERLIN ROAD, RALEIGH NC 27605
919.833.3737 WWW.DAVISKANE.COM

CONSULTANT
Sigma Engineered Solutions
Sigma Engineered Solutions, PC
2109 Gateway Centre Drive
Suite 100
Morrisville, NC 27560
PC: 919.240.0303
FX: 919.240.9909
www.sigmaes.com
North Carolina License # C-2460
Sigma Project # 19027

STRUCTURAL ENGINEERING

UNCG ATHLETICS
COLEMAN BUILDING
WEIGHT ROOM

SCO ID No. 19 - 20597 - 01A | Code: 41825 | Item: 304
1408 Walker Ave. Greensboro, NC 27402

SEALS

PAUL J. ROMITI
SEAL 032402
REGISTERED PROFESSIONAL ENGINEER
10/8/19

DKA JOB NUMBER
1915

REVISIONS

These drawings are the property of Davis Kane Architects, P.A. They may not be reused for any purpose without written permission.
Copyright © 2019 by Davis Kane Architects, P.A. All rights reserved.

PE: PAUL J. ROMITI
PM: PJR
Drawn By: JRE
Plot Date: 10/23/2019 3:31:12 PM

DATE ISSUED

BID DOCUMENTS
10/22/2019

SHEET TITLE

FIRST FLOOR FIRE PROTECTION RENO ALTERNATE PLAN

FP-8.3