


FLOOR PLAN GENERAL NOTES:

- REFER TO SHEET FP-0.1 FOR GENERAL NOTES.



1 2ND FLOOR FIRE RENO ALTERNATE BID PLAN
3/16" = 1'-0"

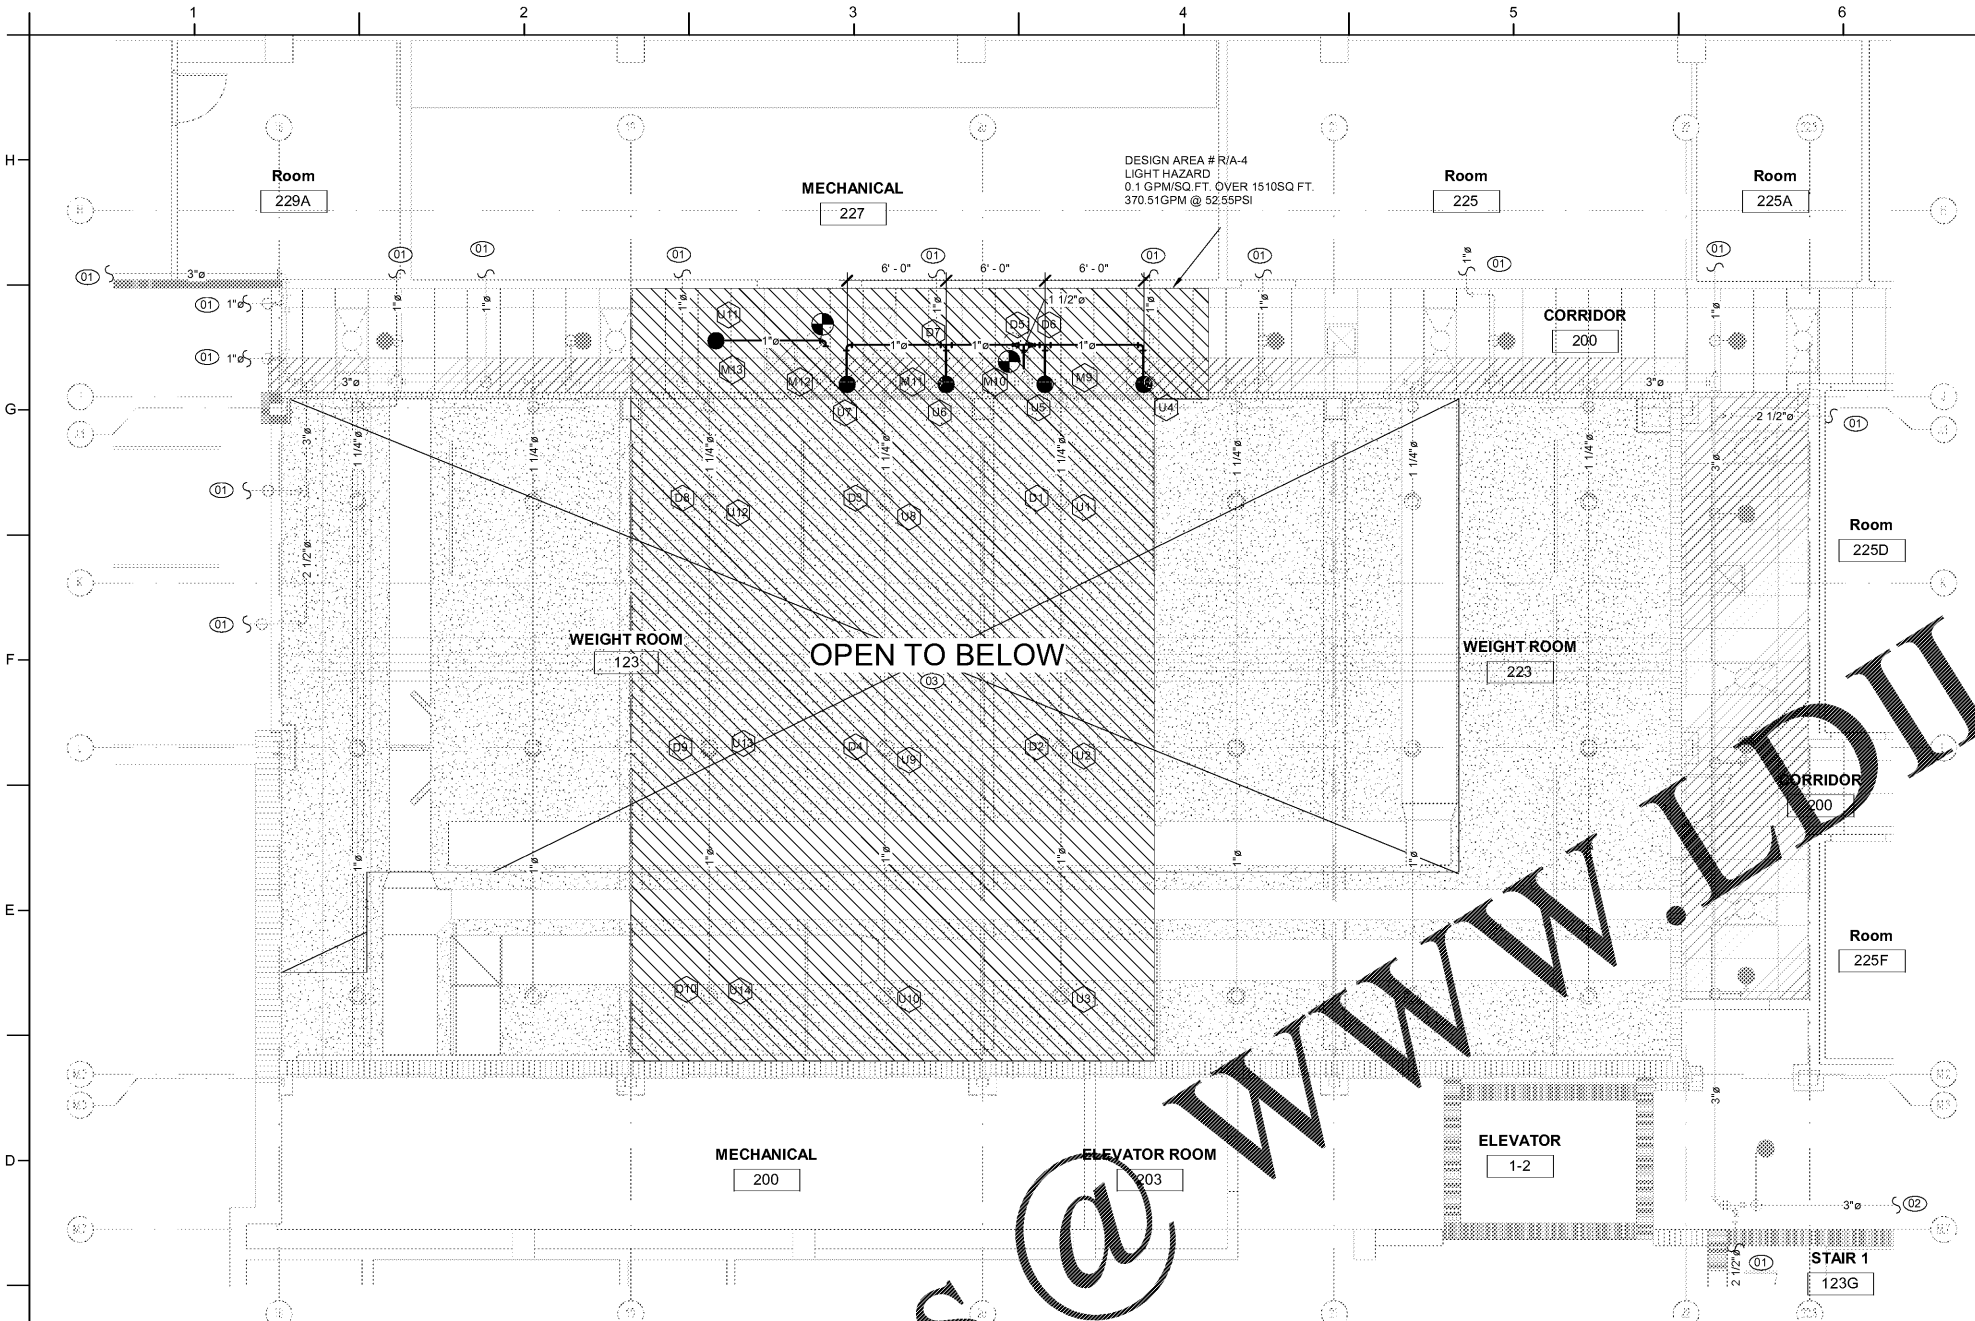

FLOOR PLAN KEY NOTES:

NOTE: NOT ALL KEY NOTES BELOW ARE APPLICABLE TO THIS SHEET. KEY NOTES SUPPLEMENT INFORMATION FOUND ELSEWHERE IN THE DRAWINGS. SEE SHEET FP-0.1 FOR FIRE PROTECTION GENERAL NOTES, LEGEND, AND ADDITIONAL REQUIREMENTS.

- 01 EXISTING SPRINKLER PIPE BRANCH/MAIN CONTINUES THROUGH EXISTING SPRINKLERS. REFERENCE EXISTING AS-BUILT DOCUMENTS FOR CONTINUATION.
- 02 EXISTING SPRINKLER PIPE MAIN CONTINUES TO EXISTING FLOOR CONTROL ASSEMBLY. REFERENCE FP-1 FOR CONTINUATION.
- 03 THIS AREA ON FP2.1 IS OPEN TO BELOW AND SEALED BY EXISTING SPRINKLERS ON FP2.2.

RATED ASSEMBLIES LEGEND:

NOTES: RATINGS ARE NOT SHOWN THROUGH DOORS FOR CLARITY. SEE A-0.1 FOR PARTITION TYPES. SEE LIFE SAFETY PLANS ON T-2.1 AND T-2.2 FOR FULL EXTENT OF RATINGS, INCLUDING HORIZONTAL RATINGS. RATINGS ARE CONTINUOUS AROUND OPENINGS AND OPENINGS ARE TO BE PROTECTED IN ACCORDANCE WITH THE NC STATE BUILDING CODE. PROTECT ALL PENETRATIONS.

- 1-HR RATED FIRE BARRIER
- 2-HR RATED FIRE BARRIER
- SMOKE RESISTANT WALL
- NEW SMOKE RESISTANT WALL

KEY PLAN

SECOND FLOOR = NTS

