


Order Plans @ www.dkaonline.com

SYSTEM NO. W-L-5001
MAY 19, 2005

F RATINGS—1, AND 2 HR (SEE ITEM 1)
T RATING—3/4, 1 AND 1-1/2 HR. (SEE ITEM 3)
L RATING AT AMBIENT — 2 CFM PER SQ. FT.
L RATING AT 400°F — LESS THAN 1 CFM PER SQ. FT.

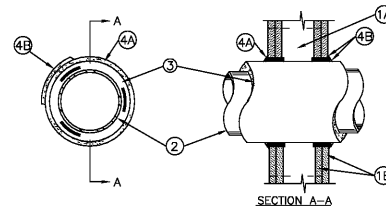

- WALL ASSEMBLY — THE 1 OR 2 HR FIRE-RATED GYPSUM BOARD/STUD WALL ASSEMBLY SHALL BE CONSTRUCTED OF THE MATERIALS AND IN THE MANNER DESCRIBED IN THE INDIVIDUAL U300, U400 OR V400 SERIES WALL OR PARTITION DESIGNS IN THE UL FIRE RESISTANCE DIRECTORY AND SHALL INCLUDE THE FOLLOWING CONSTRUCTION FEATURES:
 - STUDS — WALL FRAMING MAY CONSIST OF EITHER WOOD STUDS OR STEEL CHANNEL STUDS. WOOD STUDS SHALL CONSIST OF NOM 2 BY 4 IN. LUMBER SPACED 16 IN. OC WITH NOM 2 BY 4 IN. LUMBER END PLATES AND CROSS BRACES. STEEL STUDS TO BE MIN 3-5/8 IN. WIDE BY 1-3/8 IN. DEEP CHANNELS SPACED MAX 24 IN. OC.
 - GYPSUM BOARD* — NOM 5/8 IN. THICK, 4 FT WIDE WITH SQUARE OR TAPERED EDGES. THE GYPSUM BOARD TYPE, THICKNESS, NUMBER OF LAYERS, FASTENER TYPE AND SHEET ORIENTATION SHALL BE AS SPECIFIED IN THE INDIVIDUAL DESIGN IN THE UL FIRE RESISTANCE DIRECTORY. MAX DIAM OF OPENING IS 14-1/2 IN. FOR WOOD STUD WALLS AND 18 IN. FOR STEEL STUD WALLS.

THE HOURLY F RATING OF THE FIRE STOP SYSTEM IS 1 HR WHEN INSTALLED IN A 1 HR FIRE RATED WALL AND 2 HR WHEN INSTALLED IN A 2 HR FIRE RATED WALL.
- THROUGH PENETRANTS — ONE METALLIC PIPE OR TUBING TO BE CENTERED WITHIN THE FIRESTOP SYSTEM. PIPE OR TUBING TO BE RIGIDLY SUPPORTED ON BOTH SIDES OF WALL ASSEMBLY. THE FOLLOWING TYPES AND SIZES OF METALLIC PIPES OR TUBING MAY BE USED:
 - STEEL PIPE — NOM 12 IN. DIAM (OR SMALLER) SCHEDULE 10 (OR HEAVIER) STEEL PIPE.
 - COPPER TUBING — NOM 6 IN. DIAM (OR SMALLER) TYPE L (OR HEAVIER) COPPER TUBING.
 - COPPER PIPE — NOM 6 IN. DIAM (OR SMALLER) REGULAR (OR HEAVIER) COPPER PIPE.
- PIPE COVERING* — NOM 1 OR 2 IN. THICK HOLLOW CYLINDRICAL HEAVY DENSITY (MIN 3.5 PCF) GLASS FIBER UNITS JACKETED ON THE OUTSIDE WITH AN ALL SERVICE JACKET. LONGITUDINAL JOINTS SEALED WITH METAL FASTENERS OR SELF-SEALING LAP TAPE. TRANSVERSE JOINTS SEALED WITH METAL FASTENERS OR BUTT STRIP TAPE SUPPLIED WITH THE PRODUCT. WHEN NOM 1 IN. THICK PIPE COVERING IS USED, THE ANNULAR SPACE BETWEEN THE PIPE COVERING AND CIRCULAR CUTOUT IN THE GYPSUM WALLBOARD LAYERS ON EACH SIDE OF THE WALL SHALL BE MIN 1/4 IN. TO MAX 3/8 IN. WHEN NOM 2 IN. THICK PIPE COVERING IS USED, THE ANNULAR SPACE BETWEEN THE PIPE COVERING AND CIRCULAR CUTOUT IN THE GYPSUM BOARD LAYERS ON EACH SIDE OF THE WALL SHALL BE MIN 1/2 IN. TO MAX 3/4 IN.

SEE PIPE AND EQUIPMENT COVERING MATERIALS (BRGU) CATEGORY IN BUILDING MATERIALS DIRECTORY FOR NAMES OF MANUFACTURERS. ANY PIPE COVERING MATERIAL MEETING THE ABOVE SPECIFICATIONS AND BEARING THE UL CLASSIFICATION MARKING WITH A FLAME SPREAD INDEX OF 25 OR LESS AND A SMOKE DEVELOPED INDEX OF 50 OR LESS MAY BE USED.

THE HOURLY T RATING OF THE FIRESTOP SYSTEM IS 3/4 HR WHEN NOM 1 IN. THICK PIPE COVERING IS USED. THE HOURLY T RATING OF THE FIRESTOP SYSTEM IS 1 HR AND 1-1/2 HR WHEN NOM 2 IN. THICK PIPE COVERING IS USED WITH 1 HR AND 2 HR FIRE RATED WALL RESPECTIVELY.

FIRESTOP SYSTEM TO BE INSTALLED SYMMETRICALLY ON BOTH SIDES OF WALL ASSEMBLY. THE DETAILS OF THE FIRESTOP SYSTEM SHALL BE AS FOLLOWS:

FILL VOID OR CAVITY MATERIALS* — WRAP STRIP — NOM 1/4 IN. THICK ELASTOMERIC MATERIAL, FACED ON ONE SIDE WITH ALUMINUM FOIL, SUPPLIED IN 2 IN. WIDE STRIPS. NOM 2 IN. WIDE STRIP TIGHTLY WRAPPED AROUND PIPE COVERING (FOIL SIDE OUT) WITH SEAM BUTTED. WRAP STRIP LAYER SECURELY BOUND WITH STEEL WIRE OR ALUMINUM FOIL TAPE AND SLID INTO ANNULAR SPACE APPROX 1-1/4 IN. SUCH THAT APPROX 3/4 IN. OF THE WRAP STRIP WIDTH PROTRUDES FROM THE WALL SURFACE. ONE LAYER OF WRAP STRIP IS REQUIRED WHEN NOM 1 IN. THICK PIPE COVERING IS USED. TWO LAYERS OF WRAP STRIP ARE REQUIRED WHEN NOM 2 IN. THICK PIPE COVERING IS USED.


3M COMPANY — FS-195+
- FILL, VOID OR CAVITY MATERIALS* — CAULK OR SEALANT — MIN 1/4 IN DIAM CONTINUOUS BEAD APPLIED TO THE WRAP STRIP/WALL INTERFACE AND TO THE EXPOSED EDGE OF THE WRAP STRIP LAYER APPROX 3/4 IN FROM THE WALL SURFACE.

3M COMPANY — CP 25WB+, IC 15WB+, FIREDAM 150+ CAULK OR FB-3000 WT SEALANT.

* INDICATES SUCH PRODUCTS SHALL BEAR THE UL OR eUL CERTIFICATION MARK FOR JURISDICTIONS EMPLOYING THE UL OR eUL CERTIFICATION (SUCH AS CANADA), RESPECTIVELY.
COPYRIGHT © 2019 UNDERWRITERS LABORATORIES, INC. REPRODUCED FROM THE UL ONLINE CERTIFICATIONS DIRECTORY WITH PERMISSION FROM UNDERWRITERS LABORATORIES, INC.

SYSTEM NO. C-AJ-5001
MARCH 05, 2007

F RATINGS — 1-1/2, 2 AND 3 HR (SEE ITEM 4)
T RATINGS — 0, 1/2, 3/4 AND 1 HR (SEE ITEMS 1A AND 4)
L RATING AT AMBIENT — 2 CFM PER SQ FT
L RATING AT 400 F — LESS THAN 1 CFM PER SQ FT



- FLOOR OR WALL ASSEMBLY — MIN 2-1/2 IN. THICK REINFORCED LIGHTWEIGHT OR NORMAL WEIGHT (100-150 PCF) CONCRETE. WALL MAY ALSO BE CONSTRUCTED OF ANY UL CLASSIFIED CONCRETE BLOCKS*. MAX DIAM OF OPENING IS 18 IN.

SEE CONCRETE BLOCKS (CAZT) CATEGORY IN THE FIRE RESISTANCE DIRECTORY FOR NAMES OF MANUFACTURERS.
- STEEL SLEEVE — (OPTIONAL, NOT SHOWN) — NOM 10 IN. (OR SMALLER) SCHEDULE 10 (OR HEAVIER) STEEL SLEEVE CAST OR GROUDED INTO FLOOR OR WALL ASSEMBLY. SLEEVE MAY EXTEND A MAX OF 2 IN ABOVE TOP OF FLOOR OR BEYOND EITHER SURFACE OF WALL AS AN ALTERNATE NOM 10 IN. DIAM (OR SMALLER) SLEEVE FABRICATED FROM NOM 0.019 IN THICK GALV STEEL CAST AND GROUDED INTO OR WALL ASSEMBLY FLUSH WITH FLOOR OR WALL SURFACES. F RATING IS 0 HR WHEN SLEEVE IS USED.
- THROUGH PENETRANT — NOM 4 IN. (OR SMALLER) TYPE L (OR HEAVIER) COPPER PIPE, NOM 12 IN. DIAM (OR SMALLER) SERVICE WATER (OR HEAVIER) CAST IRON SOIL PIPE, NOM 12 IN. DIAM (OR SMALLER) CLASS 50 (OR HEAVIER) DUCTILE IRON PRESSURE PIPE OR NOM 12 IN. DIAM (OR SMALLER) SCHEDULE 10 (OR HEAVIER) STEEL PIPE CENTERED IN THE OPENING AND RIGIDLY SUPPORTED ON BOTH SIDES OF THE FLOOR OR WALL ASSEMBLY.
- PIPE COVERING* — NOM 1 1/2 TO 2 IN. THICK HOLLOW CYLINDRICAL HEAVY DENSITY (MIN 3.5 PCF) GLASS FIBER UNITS JACKETED ON THE OUTSIDE WITH AN ALL SERVICE JACKET. LONGITUDINAL JOINTS SEALED WITH METAL FASTENERS OR FACTORY-APPLIED SELF-SEALING LAP TAPE. TRANSVERSE JOINTS SECURED WITH METAL FASTENERS OR WITH BUTT STRIP TAPE SUPPLIED WITH THE PRODUCT.

SEE PIPE AND EQUIPMENT COVERING MATERIALS (BRGU) CATEGORY IN BUILDING MATERIALS DIRECTORY FOR NAMES OF MANUFACTURERS. ANY PIPE COVERING MATERIAL MEETING THE ABOVE SPECIFICATIONS AND BEARING THE UL CLASSIFICATION MARKING WITH A FLAME SPREAD INDEX OF 25 OR LESS AND A SMOKE DEVELOPED INDEX OF 50 OR LESS MAY BE USED.
- FIRESTOP SYSTEM — THE DETAILS OF THE FIRESTOP SYSTEM SHALL BE AS FOLLOWS:
 - PACKING MATERIAL — MIN 1 IN. THICKNESS OF FIRMLY PACKED MINERAL WOOL BATT INSULATION USED AS A PERMANENT FORM. PACKING MATERIAL TO BE RECESSED FROM TOP SURFACE OF FLOOR OR SLEEVE OR FROM BOTH SURFACES OF WALL AS REQUIRED TO ACCOMMODATE THE REQUIRED THICKNESS OF CAULK FILL MATERIAL (ITEM B).
 - FILL, VOID OR CAVITY MATERIAL* — CAULK OR SEALANT — APPLIED TO FILL THE ANNULAR SPACE FLUSH WITH THE TOP SURFACE OF THE FLOOR OR SLEEVE OR FLUSH WITH BOTH SURFACES OF WALL. WHEN NOM PIPE COVERING THICKNESS IS 2 IN., MIN THICKNESS OF CAULK FILL MATERIAL IS 2 IN. WHEN NOM PIPE COVERING THICKNESS IS 1-1/2 IN. OR LESS, MIN THICKNESS OF CAULK FILL MATERIAL IS 1 IN. THE HOURLY F AND T RATINGS OF THE FIRESTOP SYSTEM ARE DEPENDENT UPON THE THICKNESS OF THE FLOOR OR WALL, THE SIZE OF PIPE, THE THICKNESS OF PIPE COVERING MATERIAL AND THE SIZE OF THE ANNULAR SPACE (BETWEEN THE PIPE COVERING MATERIAL AND THE EDGE OF THE CIRCULAR THROUGH OPENING), AS SHOWN IN THE FOLLOWING TABLE:

MIN FLOOR OR WALL THICKNS IN.	MAX PIPE DIAM. IN.	NOM PIPE COVERING THICKNS. IN.	ANNULAR SPACE IN.	F RATING HR.	T RATING HR.
2-1/2	4	1 or 1-1/2	1/2 to 2-3/8	2	1
4-1/2	4	2	1/4 to 3-5/8	2	1-1/2
2-1/2	12	1	1/2 to 1-1/2	2	1/2
4-1/2	12	1	1/2 to 2-3/8	3	1
2-1/2	12	1/2	1/2 to 2-3/8	2	0

3M COMPANY — CP 25WB+ OR FB-3000 WT
*INDICATES SUCH PRODUCTS SHALL BEAR THE UL OR eUL CERTIFICATION MARK FOR JURISDICTIONS EMPLOYING THE UL OR eUL CERTIFICATION (SUCH AS CANADA), RESPECTIVELY.
COPYRIGHT © 2019 UNDERWRITERS LABORATORIES, INC. REPRODUCED FROM THE UL ONLINE CERTIFICATIONS DIRECTORY WITH PERMISSION FROM UNDERWRITERS LABORATORIES, INC.



REVISIONS
