


FLOOR PLAN GENERAL NOTES:

- REFER TO SHEET E-0.1 ELECTRICAL SYMBOLS, ABBREVIATIONS, AND ADDITIONAL PROJECT NOTES.
- ALL DEVICES MOUNTED ON EXISTING WALLS SHALL REMAIN IN PLACE AND CONNECTED TO EXISTING POWER SOURCE; UNLESS NOTED OTHERWISE ON PLANS.

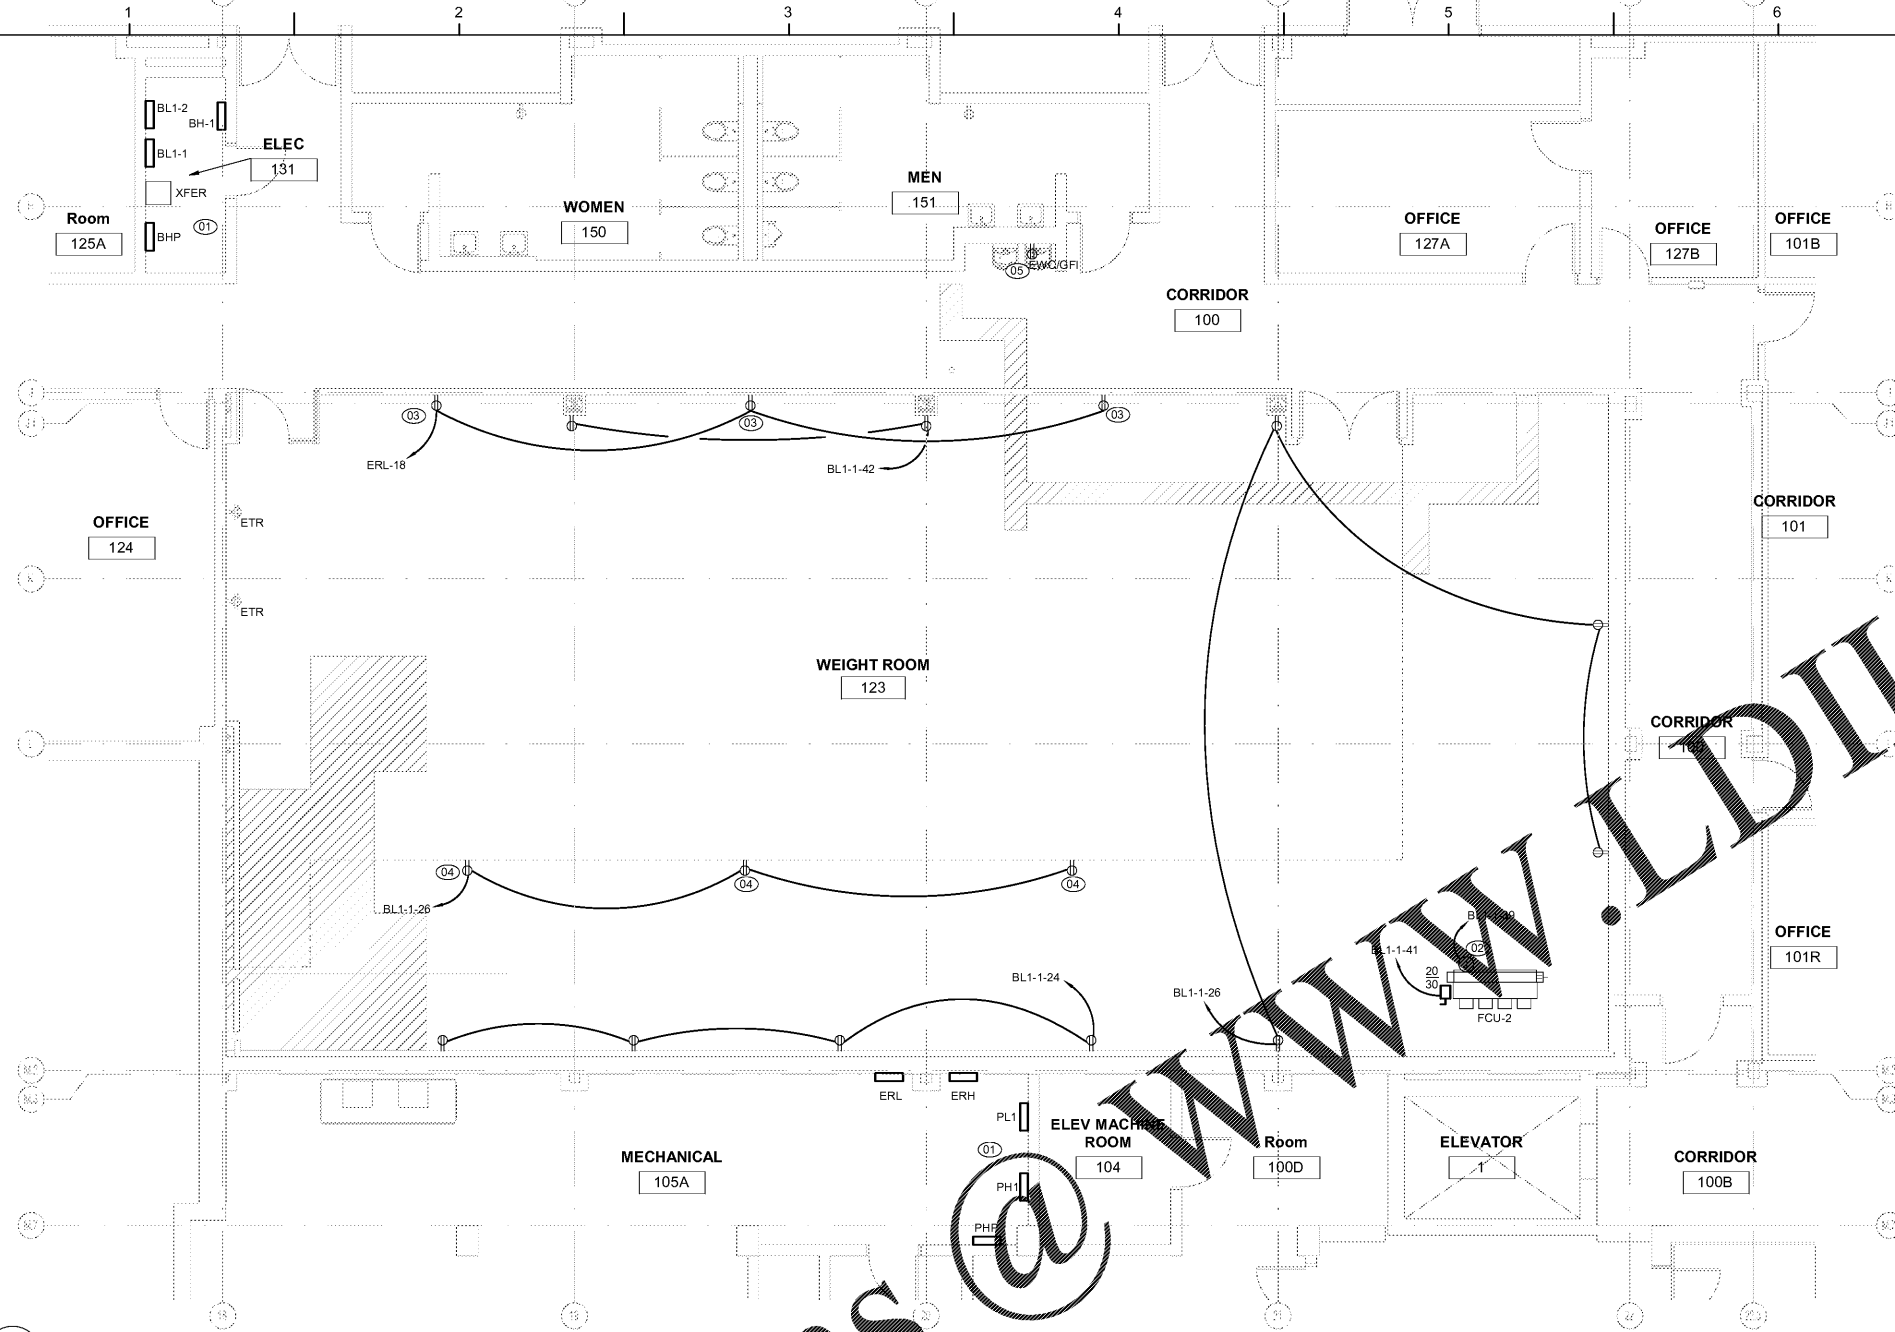

1 1ST FLOOR POWER RENO BASE BID PLAN
3/16" = 1'-0"

FLOOR PLAN KEY NOTES:

- (01)** ELECTRICAL EQUIPMENT ROOM AND EXISTING EQUIPMENT IS SHOWN FOR REFERENCE ONLY. EXISTING CIRCUITS IN THIS SPACE SHALL SEE RENOVATED AREAS.
- (02)** PROVIDE 120V/1P CIRCUIT FOR CONNECTION TO CONDENSER PUMP.
- (03)** PROVIDE DUPLEX RECEPTACLE FOR TVS ALONG WALLS. CONNECT TO CIRCUIT AS SHOWN. MOUNT DEVICES AT 48".
- (04)** PROVIDE DUPLEX RECEPTACLE MOUNTED TO BOTTOM OF CORRIDOR AND FLOOR LANDING FOR CONNECTION TO TELEVISION. CONNECT TO CIRCUIT AS SHOWN.
- (05)** PROVIDE DUPLEX RECEPTACLE FOR CONNECTION TO ELECTRIC WATER COOLER. CONNECT NEW DEVICE TO EXISTING WATER COOLER CIRCUIT. RETAINERS FROM DEMOLITION PHASE. COORDINATE PLACEMENT WITH WATER COOLER TO ENSURE THAT DEVICE IS READILY ACCESSIBLE.

RATED ASSEMBLIES LEGEND:

NOTES: RATINGS ARE NOT SHOWN THROUGH DOORS FOR CLARITY. SEE A-0.1 FOR PARTITION TYPES. SEE LIFE SAFETY PLANS ON T-2.1 AND T-2.2 FOR FULL EXTENT OF RATINGS. INCLUDING HORIZONTAL RATINGS. RATINGS ARE CONTINUOUS AROUND OPENINGS AND OPENINGS ARE TO BE PROTECTED IN ACCORDANCE WITH THE NC STATE BUILDING CODE. PROTECT ALL PENETRATIONS.

SEE T-SHEETS FOR UL RATINGS AND ADDITIONAL INFORMATION.

- [Symbol] 1-HR RATED FIRE BARRIER
- [Symbol] 2-HR RATED FIRE BARRIER
- [Symbol] SMOKE RESISTANT WALL
- [Symbol] NEW SMOKE RESISTANT WALL

KEY PLAN

FIRST FLOOR = NTS

