


**WASTE AND VENT PLAN**  
SCALE: 1/4"=1'-0"

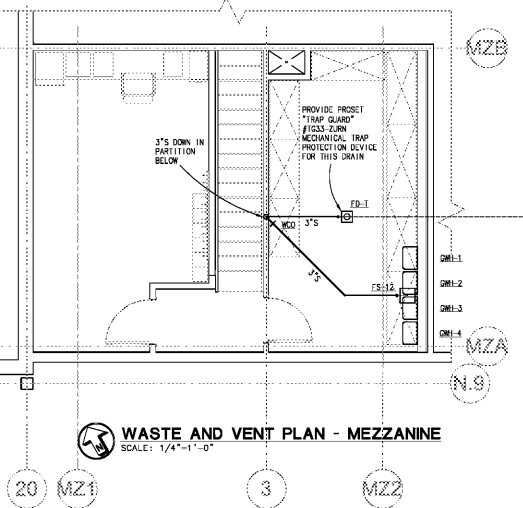

**WASTE AND VENT PLAN - MEZZANINE**  
SCALE: 1/4"=1'-0"

Order Plans @

- DRAWING NOTES**
- EXISTING WASTE AND VENT NOTES:**
    - ALL EXISTING SANITARY AND GREASE WASTE LINES TO BE RE-USED ARE TO BE CLEANED AND INSPECTED PRIOR TO START OF WORK AND CLEANING/REPAIRS OF THE EXISTING GREASE INTERCEPTORS.
    - EXISTING GREASE INTERCEPTORS (15000 GALLON) TO BE CLEANED AND SERVICED FOR INSPECTION BY THE LOCAL AUTHORITY.
    - ALL FIXTURES IN AREAS WHERE SLAB IS NOT REMOVED, IS TO HAVE THE SLAB CUT, THE FIXTURE REMOVED, AND PIPING CAPPED BELOW SLAB.
    - ALL WASTE AND VENT PIPING NOT SHOWN ON THESE DRAWINGS IS TO BE REMOVED AND SCRAPPED IF WITHIN AREAS THAT THE SLAB IS REMOVED.
    - ALL VENTS THROUGH SLAB NO LONGER IN SERVICE, ARE TO HAVE THE SLAB CUT, THE VENT REMOVED AND CAPPED BELOW SLAB.
    - ALL VENTS ABOVE SLAB NO LONGER IN USE SHALL BE REMOVED AND SCRAPPED, CAPPING PIPING AT POINT WHERE VENT REMAINS IN USE. NO ABANDONED PIPING IS TO BE LEFT IN PLACE ABOVE THE SLAB. (TYP)
    - ALL ABANDONED PIPING LEFT IN PLACE BELOW THE SLAB SHALL BE CAPPED WATER TIGHT.
  - EXISTING WELLS AND GAS PIPING:**
    - MAJORITY OF THE EXISTING GAS PIPING IS SHOWN AS BEING RE-USED. EXISTING PPE ROUTING AND SIZING WAS TAKEN FROM THE AS-BUILT DRAWINGS. IT IS THE PLUMBING CONTRACTOR'S RESPONSIBILITY TO VISIT THE JOBSITE AND CONFIRM ROUTING AND SIZING PRIOR TO BID.
    - ALL EXISTING GAS PIPING IS TO BE PREPARED AND PAINTED TO MATCH EXISTING COLOR SCHEMES. AFTER PAINTING, PLUMBING CONTRACTOR IS TO LABEL PIPING PER CODE.
    - CONTRACTOR IS TO LOCATE AND SET EXISTING DOMESTIC WATER PRESSURE REDUCING VALVE TO 80 PSI IF NO EXISTING PRESSURE REDUCING VALVE IS PRESENT IN THE SYSTEM, THEN CONTRACTOR IS TO PROVIDE ONE INSIDE ABOVE THE CEILING, AND SET AT 80 PSI.
  - GENERAL NOTES:**
    - ALL EXISTING PIPING HANGERS AND SUPPORTS NOT RE-USED, ARE TO BE REMOVED AND SCRAPPED. NO EXISTING PIPING OR ACCESSORIES SHALL BE ABANDONED IN PLACE, OTHER THAN AREAS WHERE FLOOR SLAB IS NOT CUT AND REMOVED.

- PLUMBING GENERAL NOTES**
- WORK SHALL COMPLY WITH APPLICABLE NATIONAL, STATE, AND LOCAL CODES INCLUDING:
    - 2012 GEORGIA STATE MINIMUM STANDARD BUILDING CODE (2012 IRC WITH AMENDMENTS)
    - 2012 GEORGIA STATE MINIMUM STANDARD PLUMBING CODE (2012 IPC WITH AMENDMENTS)
    - 2012 GEORGIA STATE MINIMUM STANDARD GAS CODE (2012 IFGC WITH AMENDMENTS)
    - STATE ENERGY CODE
  - DEFINITIONS: "TURNOUT" SHALL MEAN TO PURCHASE AND LOCATE AN ITEM ON THE JOBSITE. "INSTALL" SHALL MEAN TO PHYSICALLY INSTALL AN ITEM, AND TO CONNECT ALL REQUIRES SERVICES TO MAKE THE ITEM FULLY FUNCTIONAL. "PROVIDE" SHALL MEAN TO BOTH FURNISH AND INSTALL AN ITEM.
  - KNOW ALL POINTS OF CONNECTION WITH OTHER DISCIPLINES (LOCATION AND HEIGHT) PRIOR TO INSTALLATION. THIS SHALL INCLUDE EXISTING UTILITIES AS WELL AS NEW UTILITIES INSTALLED UNDER THE SCOPE OF WORK FOR THIS PROJECT.
  - COORDINATE WITH OTHER TRADES TO PREVENT INTERFERENCE WITH HVAC DUCTS, ELECTRICAL WIRING, AND STRUCTURE, IN THE CEILING PLUMBING. PRIORITY SHALL BE GIVEN TO HVAC DUCTWORK.
  - ALL WORK, BOTH MATERIAL AND INSTALLATION, SHALL BE GUARANTEED FOR A MINIMUM OF ONE YEAR FROM THE DATE OF OWNER ACCEPTANCE (CERTIFICATE OF OCCUPANCY).

- SANITARY, WASTE AND VENT PIPING**
- SANITARY, WASTE AND VENT PIPING SHALL BE SCHEDULE 40 PVC PER ASTM D2688 (NO SUBSTITUTIONS) WITH SOLVENT WELDED CEMENT IN ACCORDANCE WITH ASTM 2584, AND BE INSTALLED PER ASTM D2237.
  - COORDINATE SANITARY AND WASTE PIPING BELOW THE FLOOR WITH ALL EXISTING FOUNDATIONS AND ALL EXISTING SULLY/SLOW SANITARY DRAINS, PRIOR TO INSTALLATION.
  - SET FLOOR DRAINS BELOW FINISHED FLOOR LEVEL, TO ALLOW FULL DRAINAGE OF AREA.
  - EXPOSED DRAINAGE IN TALLETS SHALL BE CHROME-PLATED BRASS WITH ESCUTCHEONS.
  - PROVIDE CLEANOUTS AS SHOWN ON THE PLAN AND SHALL NOT BE ELEVATED. PROVIDE ADDITIONAL CLEANOUTS WHERE REQUIRED BY THE PLUMBING OFFICIAL, AT NO ADDITIONAL COST.
  - ALL INJECT PIPING SHALL TERMINATE AT THE RECEPTOR WITH A MINIMUM AIR GAP OF TWO PIPE DIAMETERS AND SHALL BE BEVELED AT 45 DEGREES.
  - ALL INJECT PIPING SERVING HAND SINKS, PREP SINKS, AND MISCELLANEOUS EQUIPMENT (I.E. ICE MACHINES, SODA STATIONS, ETC) MAY BE PVC, BUT SHALL BE PAINTED WITH SLURK PAINT.
  - ALL INJECT PIPING FROM PREP SINKS WITH MULTIPLE BASINS SHALL HAVE EACH BASIN DRAINED INDIVIDUALLY TO THE RECEPTOR.
  - TEST PIPING WITH A 1/2" WATER COLUMN FOR TWO HOURS.

**DISPOSITION NOTES**

(N) NEW  
(E) EXISTING  
(C) CONNECT TO EXISTING  
N/C NO-HUB CAST IRON

**PLUMBING LEGEND**

--- EXISTING DRAINAGE PIPING  
--- NEW DRAINAGE PIPING

--- VENT  
--- CONNECT NEW TO EXISTING  
--- INDIRECT WASTE (FULL SIZE)  
--- FOOD SERVICE PLUMBING TAG

PROJECT COORDINATOR  
**CIVITARESE MORGAN**  
821 N. RIVERFRONT BLVD. SUITE 700  
DALLAS, TEXAS 75207  
TEL: 214-613-0880 FAX: 469-730-3341

ARCHITECT  
**T.M. Morgan Architect**  
821 N. RIVERFRONT BLVD.  
SUITE 700  
DALLAS, TEXAS 75207

REGISTERED PROFESSIONAL  
**GREGOR GRAMLICH, PE**  
GEORGIA LICENSE #2008488  
13451 STANLEY ROAD, SUITE 17  
LARGO, FLORIDA 33773  
(727) 538-9464

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED  
AND SEALED BY GREGOR GRAMLICH, PE ON  
12-13-2019 USING A DIGITAL SIGNATURE.  
PRINTED COPIES OF THIS DOCUMENT ARE NOT  
CONSIDERED VALID UNLESS THEY ARE  
VERIFIED ON ANY ELECTRONIC COPIES.  
12-13-2019

ARCHITECTURAL PROJECT NO.: 208-19

**WHISKEY CAKE KITCHEN**

PERIMETER MALL  
4400 ASHFORD DUNWOODY RD  
ATLANTA, GA 30348

NO.	REVISIONS	DATE

LANDSCAPE REVIEW ISSUE DATE: 12-09-2019  
RD ISSUE DATE: 12-13-2019  
PRINTED ISSUE DATE: 12-13-2019  
CONSTRUCTION ISSUE DATE: XXX-XX-XXXX

DRAWING TITLE  
**WASTE AND VENT PLAN**

DRAWING NUMBER  
**P1.01**

ISSUED FOR PERMIT - 12-13-2019