


THIS SHEET PLOTS ON 22" x 34" ANSI D 0 1/2" = 1" M L K J I H G F E D C B A

C:\Users\Rodney\Documents\2019-106 Paulding Fire Station #12_mark@croftae.com.rvt
 6/12/2019 2:16:39 PM
 © Copyright 2019 by Croft & Associates, PC. All rights reserved. This document is property of Croft & Associates, PC. It is to be used only for the specific project referred to or identified herein and is not to be used on other projects, in whole or in part, except by the express written agreement of Croft & Associates, PC.

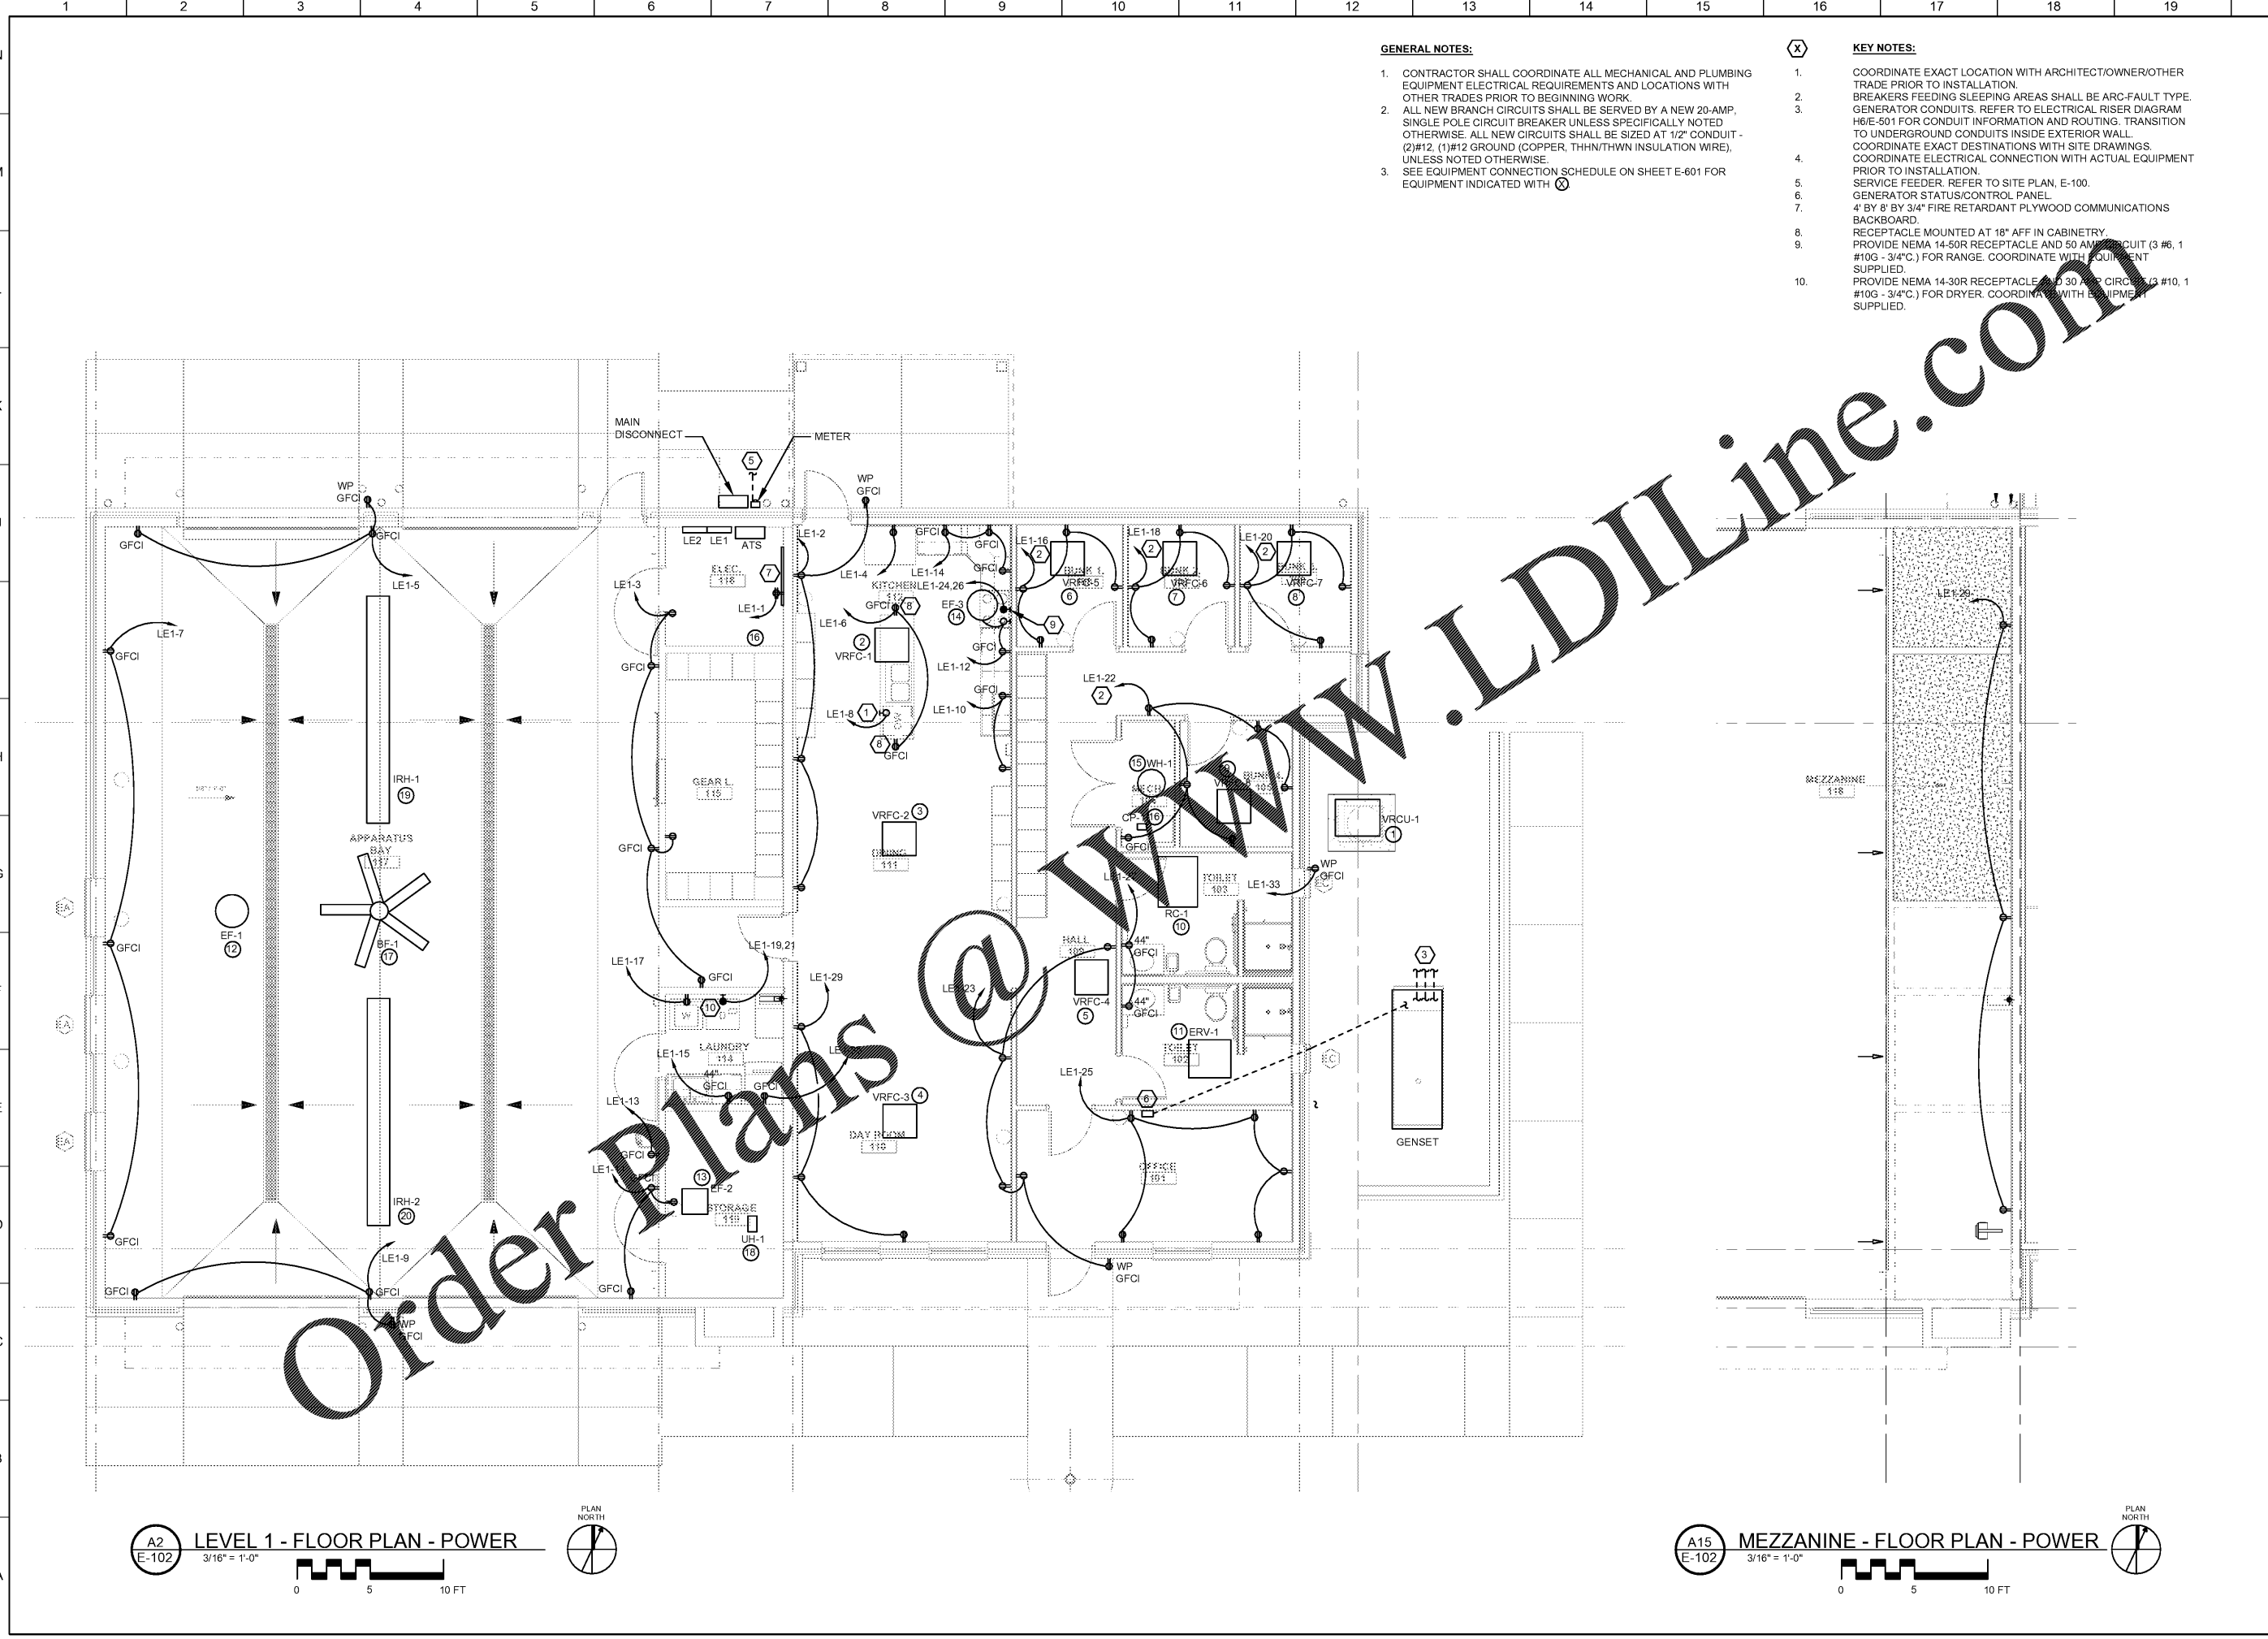

- GENERAL NOTES:**
1. CONTRACTOR SHALL COORDINATE ALL MECHANICAL AND PLUMBING EQUIPMENT ELECTRICAL REQUIREMENTS AND LOCATIONS WITH OTHER TRADES PRIOR TO BEGINNING WORK.
 2. ALL NEW BRANCH CIRCUITS SHALL BE SERVED BY A NEW 20-AMP, SINGLE POLE CIRCUIT BREAKER UNLESS SPECIFICALLY NOTED OTHERWISE. ALL NEW CIRCUITS SHALL BE SIZED AT 1/2" CONDUIT - (2)#12, (1)#12 GROUND (COPPER, THHN/THWN INSULATION WIRE), UNLESS NOTED OTHERWISE.
 3. SEE EQUIPMENT CONNECTION SCHEDULE ON SHEET E-601 FOR EQUIPMENT INDICATED WITH (X)

- KEY NOTES:**
1. COORDINATE EXACT LOCATION WITH ARCHITECT/OWNER/OTHER TRADE PRIOR TO INSTALLATION.
 2. BREAKERS FEEDING SLEEPING AREAS SHALL BE ARC-FAULT TYPE.
 3. GENERATOR CONDUITS. REFER TO ELECTRICAL RISER DIAGRAM HIE-501 FOR CONDUIT INFORMATION AND ROUTING. TRANSITION TO UNDERGROUND CONDUITS INSIDE EXTERIOR WALL.
 4. COORDINATE EXACT DESTINATIONS WITH SITE DRAWINGS.
 5. COORDINATE ELECTRICAL CONNECTION WITH ACTUAL EQUIPMENT PRIOR TO INSTALLATION.
 6. SERVICE FEEDER. REFER TO SITE PLAN, E-100.
 7. GENERATOR STATUS/CONTROL PANEL.
 8. 4' BY 8' BY 3/4" FIRE RETARDANT PLYWOOD COMMUNICATIONS BACKBOARD.
 9. RECEPTACLE MOUNTED AT 18" AFF IN CABINETS.
 10. PROVIDE NEMA 14-50R RECEPTACLE AND 50 AMP CIRCUIT (3 #6, 1 #10G - 3/4") FOR RANGE. COORDINATE WITH EQUIPMENT SUPPLIER.
 11. PROVIDE NEMA 14-30R RECEPTACLE AND 30 AMP CIRCUIT (3 #10, 1 #10G - 3/4") FOR DRYER. COORDINATE WITH EQUIPMENT SUPPLIER.

CROFT
 ARCHITECTS • ENGINEERS
 Croft & Associates
 3400 Blue Springs Road, Suite 200
 Kennesaw, Georgia 30144
 770.529.7714 (p) 770.529.7716 (f)
 www.croftae.com

REGISTERED PROFESSIONAL ENGINEER
 #033654
 JEFFREY MORRIS
 08/14/2019

OWNER
 PAULDING COUNTY
 BOARD OF COMMISSIONERS

Project Name
 FIRE STATION #12
 1303 SPRING ROAD
 DALLAS,
 GA. 30132

0	2019-08-13	PERMIT ISSUE
B	2019-07-10	95% REVIEW SET
A	2019-05-23	SCHEMATIC DESIGN REVIEW
No.	Date	Description
ISSUANCE		

PROJECT NUMBER
2019-106
 DRAWN: LRJ/RGL CHECKED: JKM
 SHEET TITLE
FLOOR PLANS - POWER
 SHEET NO.
E-102

A2 LEVEL 1 - FLOOR PLAN - POWER
 E-102 3/16" = 1'-0"

A15 MEZZANINE - FLOOR PLAN - POWER
 E-102 3/16" = 1'-0"