

LEGEND TO EXISTING WALLS:


- 1. REFER ALSO TO FLOOR PLANS, BUILDING SECTIONS, WALL SECTIONS AND DETAILS FOR ADDITIONAL INFORMATION ON WALLS...
EXISTING NON-RATED WALL
NON RATED CONCRETE BLOCK WALL UP TO FIRST COURSE (MIN. 4") ABOVE HIGHEST ADJACENT CEILING TYPE 2 UNLESS NOTED OTHERWISE ON FLOOR PLAN.
EXISTING 1 HOUR RATED BLOCK WALL TO ROOF DECK
1 HOUR FIRE RATED CONCRETE BLOCK WALL UP TO ROOF DECK. U.L. DESIGN NO. U906. PATCH ALL PENETRATIONS EXISTING AND NEW.
1 HOUR RATED BLOCK & GYPSUM WALL TO ROOF DECK.
1 HOUR FIRE RATED CONCRETE BLOCK WALL UP TO FIRST COURSE (MIN. 4") ABOVE CEILING TYPE 2 OR AND TOP OF FIRE RATED CEILING (SHAFTWALL). EXTEND WALL TO ROOF DECK WITH 1 HOUR FIRE RATED DRYWALL PARTITION (ONE LAYER OF FIRE RATED 5/8" GYPSUM BOARD ON EACH SIDE OF STEEL STUDS @ 16" O.C. REFER TO SPECIFICATIONS FOR STEEL STUDS REQUIREMENTS. U.L. # U906 AND U419.
EXISTING 2 HOUR RATED BLOCK WALL TO ROOF DECK
2 HOUR FIRE RATED CONCRETE BLOCK WALL UP TO ROOF DECK. U.L. DESIGN NO. U906. PATCH ALL PENETRATIONS EXISTING AND NEW.
NON RATED BLOCK & GYPSUM WALL TO CEILING TYPE 1
NON RATED CONCRETE BLOCK WALL UP TO FIRST COURSE ABOVE CEILING TYPE 2. EXTEND WALL TO BOTTOM OF CEILING TYPE 1 WITH DRYWALL PARTITION (ONE LAYER OF NON-RATED 1/2" GYPSUM BOARD ON ONE SIDE OF 3/8" STEEL STUDS @ 16" O.C. MUD & TAPE ALL JOINTS.)

RENOVATION NOTES

- 1. WHERE HOLES IN WALLS EXIST DUE TO REMOVAL OF ABANDONED MECHANICAL, ELECTRICAL & PLUMBING EQUIPMENT, LINES, AND CONDUIT, CONTRACTOR SHALL PATCH WITH 3/8" METAL STUDS AND 5/8" GYP. BOARD, IF ABOVE CEILING. SEAL HOLES AS NEEDED TO MAINTAIN EXISTING RATINGS. REPAIR CEILING PLANS AND FIELD. VERIFY & MATCH EXISTING CONDITIONS, VERTICAL LOCATIONS AND QUANTITIES. PATCHES.
2. REPAINT EXISTING WALLS IN RENOVATION AREAS WHERE WALLS ARE DAMAGED DURING NEW CONSTRUCTION. SEE SPECIFICATIONS FOR INFORMATION.
3. CONTRACTOR SHALL VERIFY THAT EXISTING WALLS SHOWN AS RATED ARE SEALED TO DECK & ALL PENETRATIONS SHALL BE SEALED PROPERLY TO MAINTAIN RATING. THIS INCLUDES EXISTING PENETRATIONS, ABANDONED PENETRATIONS AND NEW.
4. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND CONTACT THE ARCHITECT IMMEDIATELY, IN WRITING, IF ANY DISCREPANCIES ARE DISCOVERED.
ALL PATCHING NOTES
EXISTING INTERIOR AND EXTERIOR MASONRY AND GYP BD / MTL STUD WALLS SHALL HAVE ALL EXIST ABANDONED HOLES FROM REMOVED CIRCUITS, CONDUITS, DUCT, PIPING, ETC PATCH/REPAIRED TO MATCH EXISTING CONSTRUCTION AS REQUIRED TO MAINTAIN FIRE RATING OR FULL HEIGHT SPACE SEPARATIONS AS SHOWN ON PLANS
EXISTING INTERIOR AND EXTERIOR MASONRY AND GYP BD/MTL STUD WALLS ARE TO HAVE NEW HOLES CORED ONLY AS REQUIRED FOR NEW CIRCUITS, CONDUITS, DUCT, PIPING, ETC. NEW PENETRATIONS ARE TO BE PATCHED/REPAIRED TO MATCH EXISTING CONSTRUCTION AND FIRESTOPPED/CAULKED AS REQUIRED TO MAINTAIN FIRE RATING OR FULL HEIGHT SPACE SEPARATIONS AS SHOWN ON PLANS



TYPICAL DETAIL - NO SPOST PROJECT SIGN

3/4" = 1'-0" (F20 A101)

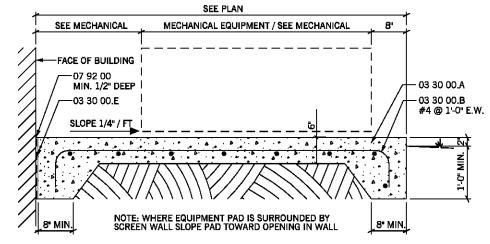

TYPICAL SECTION EXTERIOR EQUIPMENT PAD

3/4" = 1'-0" (H18 A101)

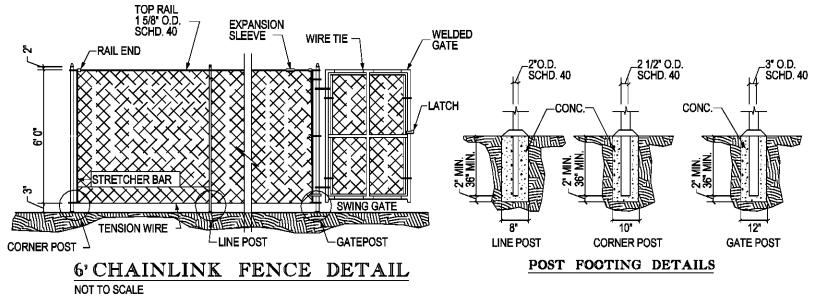

Order Plans @ WWW.DIline.com

Southern A&E L.L.C. architects & engineers
7951 Iron Circle, Austell, Ga. 30168
HVAC RENOVATIONS FOR EAST COWETA MIDDLE SCHOOL GYMNASIUM
COWETA COUNTY SCHOOL SYSTEM, NEWNAN, GEORGIA
Drawing Number: A101