

**GENERAL NOTES:**

- A. REFER TO SHEET IS1 FOR FINISHES AND RESPONSIBILITIES
- B. OUTLETS AND OUTLET COVER PLATES TO MATCH PAINT ADJACENT SURFACE. SEE ELECTRICAL PLANS FOR OUTLET SPECS
- C. WHERE APPLICABLE, ALL SPRINKLER HEADS IN STOCK ROOM TO BE 18" ABOVE THE HIGHEST STOCK SHELF (MINIMUM)
- D. REFER TO ELECTRICAL PLANS FOR ADDITIONAL INFORMATION
- E. DIMENSIONS ARE TO THE CENTERLINE OF OBJECTS, UNLESS NOTED OTHERWISE
- F. THE EMERGENCY LIGHTS WILL PROVIDE AN AVERAGE OF ONE (1) FOOTCANDLE ALONG THE ENTIRE MEANS OF EGRESS PER NFPA 101, 7.9
- G. LIGHTING IN STOCK ROOM TO BE CENTERED IN STORAGE SHELF ASBLES
- H. WHERE CEILING PANELS ARE TO BE REMOVED FOR LIGHT FIXTURE RELOCATION, REPLACE PANEL TO MATCH EXISTING
- I. CONTRACTOR SHALL REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL REQUIREMENTS AND MANUFACTURER'S INSTRUCTIONS NOT SHOWN ON THIS PLAN
- J. TRACK SHALL BE INSTALLED DIRECTLY TO SUSPENDED CEILING GRID OR ON THE SOFFIT
- K. EC SHALL INSTALL ADDITIONAL WIRE THE SUPPORT FROM HANGING GRID STRUCTURE ABOVE FOR SUPPORT OF LIGHT FIXTURES ATTACHED TO GRID
- L. ALL EMERGENCY LIGHTS AND EXIT SIGNS SHALL BE BATTERY BACKUP (NON-UTILITY SOURCE) IN CASE OF POWER LOSS. SELECT ELECTRICAL PLANS
- M. ALL CEILING MOUNTED FIXTURES AND TRACK LIGHTS SHALL BE SPRAYED WITH MATE PAINT TO MATCH EXISTING TRACK LIGHTS (C-1)
- N. FOR NEW ACP CEILING, CENTER ON SPACE AS NOTED
- O. ANY ALL CEILING ELEMENTS TO BE HUNG FROM TOP CHORD OF TRUSS SYSTEM
- P. ANY EXISTING TRACK LIGHTS TO BE REMOVED AND TRACKS TO BE SPRAYED SPECIFIED (C-1) FINISH / COLOR
- Q. ALL ITEMS IN PLENUM CEILING SHALL BE LISTED TO UL 148 CUL LISTING PER CODE AND IF ANY PVC PIPE SHALL BE SLEEVED/Wrapped IF NOT PLENUM RATED.
- R. ALL SECURITY ITEMS SHALL MATCH ADJACENT WALL OR CEILING FINISH COLOR.
- S. ALL TRACK LIGHTS SHALL BE CENTERED ON SPACE AS NOTED
- T. ALL OVERHEAD PERSONAL VIEW MONITORS SHALL BE CENTERED ON SPACE AS NOTED
- U. ALL OVERHEAD PERSONAL VIEW MONITORS SHALL BE CENTERED ON SPACE AS NOTED
- V. ALL OVERHEAD PERSONAL VIEW MONITORS SHALL BE CENTERED ON SPACE AS NOTED
- W. ALL OVERHEAD PERSONAL VIEW MONITORS SHALL BE CENTERED ON SPACE AS NOTED
- X. ALL OVERHEAD PERSONAL VIEW MONITORS SHALL BE CENTERED ON SPACE AS NOTED
- Y. ALL OVERHEAD PERSONAL VIEW MONITORS SHALL BE CENTERED ON SPACE AS NOTED
- Z. ALL OVERHEAD PERSONAL VIEW MONITORS SHALL BE CENTERED ON SPACE AS NOTED

**KEY NOTES:**

1. LINE OF STOREFRONT SIGN ABOVE. SEE SIGN SHOP DRAWINGS
2. WATER HEATER ABOVE
3. HVAC DIFFUSER. SEE MECHANICAL PLANS
4. EXIT SIGN WALL MOUNTED, CENTERED ABOVE DOOR
5. EXIT SIGN CEILING MOUNTED, CENTERED ABOVE DOOR
6. SPEAKER SYSTEM. COORDINATE LOCATIONS W/ VENDOR. CENTER IN CEILING PANEL AS SHOWN. SEE ELECTRICAL DRAWINGS
7. ANY EXISTING BASE BUILDING ROOF INSULATION IS TO REMAIN
8. GC SHALL FURNISH & INSTALL NEW INSULATION AT DECK HEIGHT (R-19)
9. 4" DIA GROMMET IN CEILING PANEL FOR NETWORK RACK CABLING
10. STOREFRONT GRAPHICS DISPLAY (EYEHOOKS). INSTALL AS CLOSE TO MULLION AS POSSIBLE. OFFSET EVERY 4" OC. WHERE SUSPENDED GRID OCCURS, ATTACH TO THE GRID.
11. NOT USED
12. NOT USED
13. NOT USED
14. OVERHEAD PERSONAL VIEW MONITOR, CENTER IN CEILING PANEL AS SHOWN. MOUNTING HEIGHT TBD. COORDINATE W/ VENDOR, OWNER. REFER TO ELECTRICAL DRAWINGS FOR MORE INFO.
15. G.C. TO INSTALL CAN LIGHTS AS CLOSE TO GATE HOOD AS POSSIBLE.

**SYMBOL LEGEND**

LABEL	DESCRIPTION
	RETURN AIR DIFFUSER SECURED TO CEILING (TO MATCH C-1)
	SUPPLY AIR DIFFUSER SECURED TO CEILING (TO MATCH C-1)
	SPEAKER AND SUB WOOFER (TO MATCH C-1)
	ACOUSTIC CEILING PANEL AND GRID (C-1)
	GWB. SEE FINISH SCHEDULE ON IS1
	CEILING HEIGHT ABOVE FINISHED FLOOR


**SECURITY LEGEND**

LABEL	DESCRIPTION
	DOOR CONTACT
	GLASS BREAK
	360° MOTION DETECTOR
	MOTION DETECTOR
	PERSONAL VIEW MONITOR
	KEYPAD
	CAMERA


**SHOW FOR REFERENCE ONLY. COORDINATE ALL SECURITY EQUIPMENT LOCATION WITH OWNER PRIOR TO INSTALLATION. GC TO INSTALL ELECTRICAL DATA AS REQ'D AT CAMERA LOCATIONS. MONITOR, CAMERAS, AND MOTION DETECTORS F & I BY VENDOR. REFER TO ELECTRICAL DRAWINGS FOR SPECIFICS.**

**Order Plans**


**1 REFLECTED CEILING PLAN**  
 SCALE: 1/8" = 1'-0"

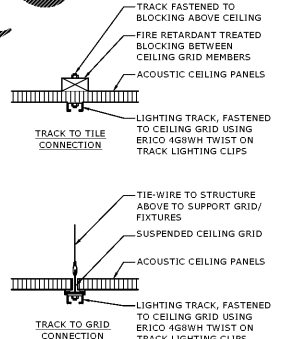


**2 TRACK MOUNTING DETAIL**  
 SCALE: 3/4" = 1'-0"

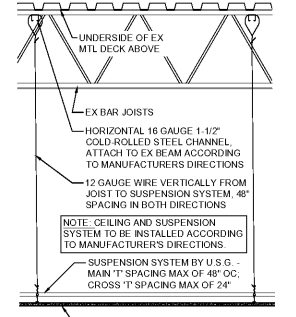

**3 TYP GWB SUSPENSION DETAIL**  
 SCALE: 3/4" = 1'-0"

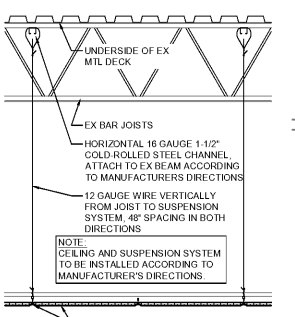

**4 TYP ACP SUSPENSION DETAIL**  
 SCALE: 3/4" = 1'-0"

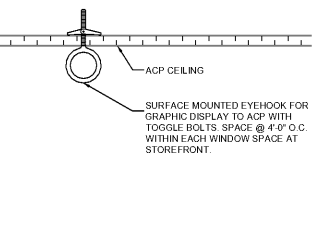

**5 EYEHOOK GRAPHIC DISPLAY DETAIL**  
 SCALE: 3/4" = 1'-0"

**LIGHTING FIXTURE SCHEDULE**

SYMBOL	TYPE	MFG	PRODUCT NO.	LAMPING	VOLTS	MTG METHOD	MTG HEIGHT	COMMENTS
	A	ATTAIN LED	AT-PN-22-30-40-WH	30W LED	120	LAY-IN	CEILING	SPLENDOR 2X2 LED PANEL, SECURED TO CEILING
	A1	ATTAIN LED	AT-PN-22-30-40-WH	30W LED	120	GWB	CEILING	TYPE A1 W/ GWB ADAPTER, SECURED TO CEILING
	B	ATTAIN LED	62216-A-T-WH	30W LED	120	LAY-IN	CEILING	SPLENDOR 2X2 LED PANEL WITH EMERGENCY BALLAST, SECURED TO CEILING
	B1	ATTAIN LED	DF-22-W	30W LED	--	GWB	CEILING	TYPE B1 W/ GWB ADAPTER, SECURED TO CEILING
	C	CONTECH	CTL2838N-W	(1) 14W LED PAR 38	120	TRACK	CEILING	GIMBAL TRACK HEAD
	T1	JUNO	SINGLE CIRCUIT TRACK 2, 4, 6, 8' (WHITE)	--	120	CEILING	CEILING	T1# = TRACK LENGTH. SEE ELECTRICAL PLANS FOR LENGTHS & CURRENT LIMITERS (IF APPLICABLE). 1 CIRCUIT TRACK. SEE TYP MOUNTING DETAIL.
	E1	BEST	EXZTEU-2-G-W-EM	INTEGRAL LED	120	UNIVERSAL	RECESSED / ADJUSTABLE	SEE ELEVATIONS OR 6" ABOVE EXIT
	F	CONTECH	RDA-L-WHIT	14W LED	120	RECESSED / ADJUSTABLE	CEILING	ADJUSTABLE. DRIVERS RUN TO BACK OF HOUSE AREA
	EF	BROAN	A70L-WHITE	LED A19	120	RECESSED	CEILING	FAN / LIGHT COMBO
	G	GREEN CREATIVE	28319	22.5W LED	120	PENDANT / SURFACE	12'-0" AFF / CEILING	SINGLE-LAMP LED NARROW STRIP
	H	GREEN CREATIVE	28319	22.5W LED	120	PENDANT / SURFACE	12'-0" AFF / CEILING	SINGLE-LAMP LED NARROW STRIP, W/ EMERGENCY BALLAST (10W EM BACKUP)
	M	BEST	DBEL-BR-SDT-CW	INTEGRAL LED	120	SURFACE	ABOVE REAR DOOR	DECORATIVE OUTDOOR LED EMERGENCY LIGHTING UNIT
	N	BEST	LEDR-1	INTEGRAL LED	120	SURFACE	CEILING	LED EMERGENCY LIGHTING UNIT F&I BY GC

- ALL FIXTURES TO BE NEW UNLESS NOTED OTHERWISE. EXISTING TO BE RELOCATED FIXTURES NOTED WITH 'XR'. FIXTURES EXISTING TO REMAIN NOTED WITH 'X'.
- WHERE EXISTING FIXTURES ARE TO REMAIN, REPLACE FIXTURES/BALLASTS AND LAMPS AS NEEDED FOR LIKE NEW APPEARANCE AND OPERATION.
- ALL NEW LIGHTS TO BE 4000K. RELAMP ANY EXISTING FIXTURES TO 4000K, IF APPLICABLE.
- FIXTURE SUBSTITUTE AS EQUAL ARE ACCEPTABLE FOR BID PURPOSE.



NO.	DATE	DESCRIPTION