DRAWING NOTES:

1. INSTALL NEW PUMP AND CONNECT TO NEW PIPING, CONTROLS, AND WIRING.
2. TRANSITION TO STEEL PIPE PRIOR TO PUMP INLET. ALL NEW PIPING IN MECHANICAL ROOM TO BE STEEL.
3. UNDERGROUND PIPING TO BE POLYPROPYLENE (PP-R) PIPE. REFER TO SPEC SECTION 332114.
4. INSTALL NEW MAKE-UP WATER LINE TO COOLING TOWER RETURN PIPE IN MECHANICAL ROOM. PROVIDE SOLENOID VALVE CONTROLLED BY COOLING TOWER WATER LEVEL CONTROLLER.

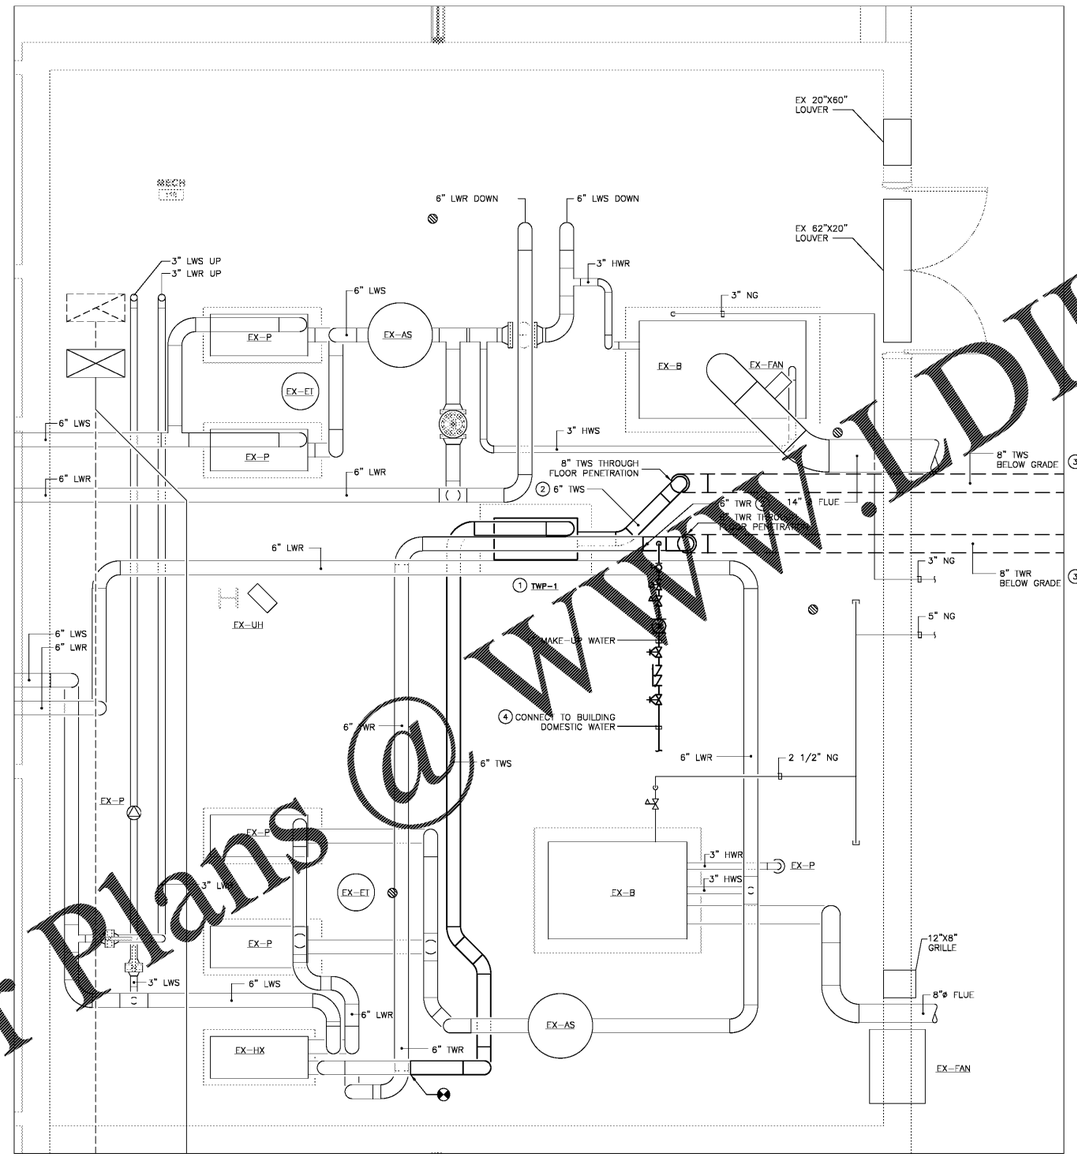

1 / M-201 MAIN MECHANICAL ROOM FLOOR PLAN – LOWER LEVEL

SCALE: 1/2" = 1' 0"

GRAPHIC SCALE

2 1 0 2 4

SCALE: 1/2"=1'-0"
UNIT OF MEASURE: FEET

KEY PLAN



Order Plans @ WWW.LDILine.com

CDH ARCHITECTURE
675 Tower Road
Marietta, GA 30060-6958
770.423.0016
www.cdhpartners.com

COPYRIGHT © 2018 by CDH PARTNERS INC.
All rights reserved.

FULTON COUNTY SCHOOL SYSTEM

EVOLINE C. WEST ELEMENTARY SCHOOL - RENOVATIONS

7040 RIVERTOWN RD
FAIRBURN, GA 30213

PROJECT NO: 18048.00

01	50% CD	08/07/2019
02	50% CD - re-submittal	11/20/2019
03	90% CD	10/04/2019
04	PERMIT SET	11/15/2019
05	BID SET	12/21/2019

GEORGIA REGISTERED PROFESSIONAL ENGINEER DANIEL NOTO

SHEET TITLE

MECHANICAL PART PLAN - MECHANICAL ROOM

SHEET NUMBER

M201