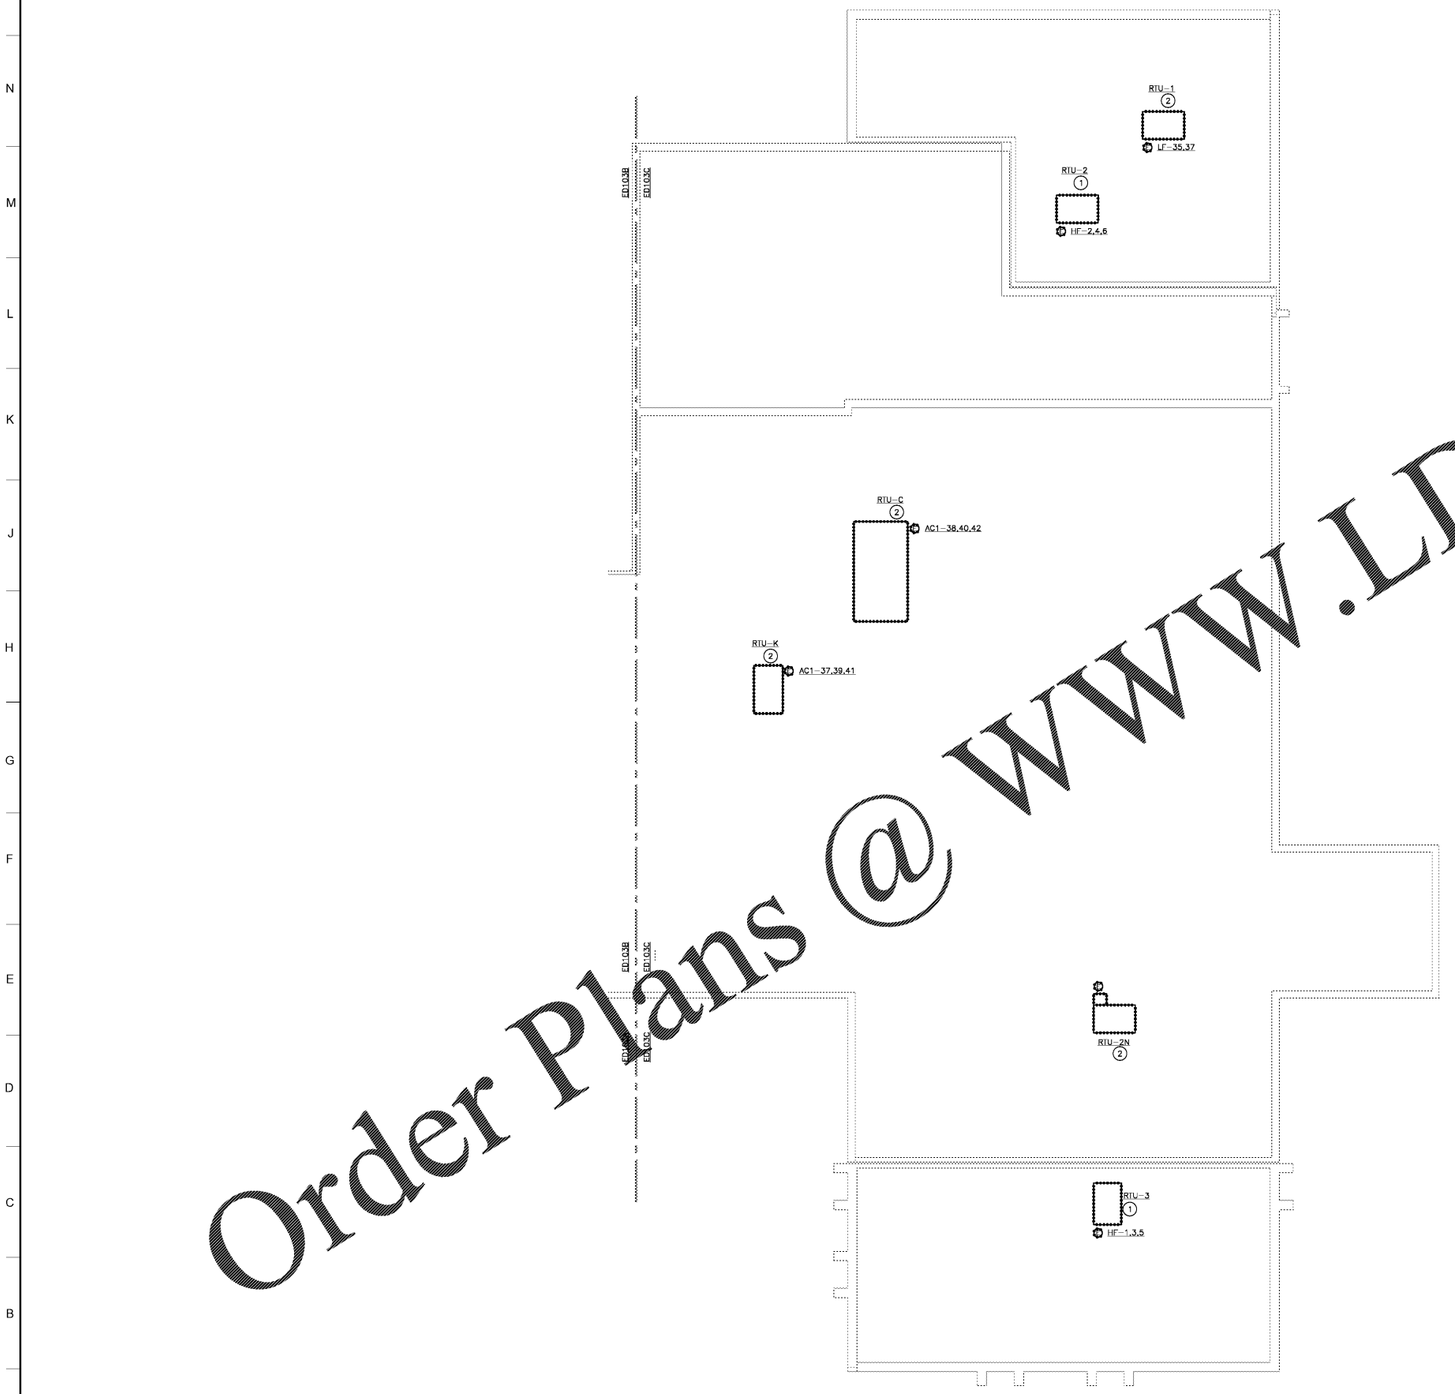

ELECTRICAL DEMOLITION PLAN – ROOF

SCALE: 1/8" = 1' 0"

GENERAL NOTES:

1. CONTRACTOR SHALL FIELD VERIFY EXACT CIRCUITS SERVING EXISTING MECHANICAL EQUIPMENT.
2. COORDINATE DEMOLITION WITH FIELD CONDITIONS AND MECHANICAL DRAWINGS.
3. ALL EXISTING CIRCUITS PROVIDING POWER TO MECHANICAL EQUIPMENT ARE EXISTING TO REMAIN UON.

DRAWING NOTES:

1. DISCONNECT EXISTING CIRCUIT FOR ROOFTOP AIR HANDLING UNIT. MAINTAIN EXISTING CONDUIT AND CONDUCTORS FOR RECONNECTION OF NEW EQUIPMENT.
2. DISCONNECT EXISTING CIRCUIT FOR ROOFTOP AIR HANDLING UNIT. DEMOLISH EXISTING DISCONNECTED CIRCUIT; REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE. REUSE EXISTING ROOF PENETRATION FOR NEW CONNECTION TO NEW EQUIPMENT.

GRAPHIC SCALE

8 4 0 8 16

SCALE: 1/8"=1'-0"
UNIT OF MEASURE: FEET

KEY PLAN

CDH ARCHITECTURE
675 Tower Road
Marietta, GA 30060-6958
770.423.0016
www.cdhpartners.com

COPYRIGHT © 2019 by CDH PARTNERS INC.
All rights reserved.

FULTON COUNTY SCHOOL SYSTEM

EVOLINE C. WEST ELEMENTARY SCHOOL - RENOVATIONS

7040 RIVERTOWN RD
FAIRBURN, GA 30213

PROJECT NO: 18048.00

50% CD	08/07/2019
50% CD - re-submittal	11/20/2019
90% CD	10/04/2019
PERMIT SET	11/15/2019
BID SET	12/20/2019

GEORGIA REGISTERED No. PE037930 PROFESSIONAL ENGINEER BETH ANN CRUTCHFIELD

SHEET TITLE

ELECTRICAL DEMOLITION PLAN - ROOF

SHEET NUMBER

ED103C

Order Plans @ WWW.LDILine.com