



**ROOF GENERAL NOTES**

1. ALL DIMENSIONS TO BE FIELD VERIFIED. DO NOT SCALE DRAWINGS. IF DIMENSIONS ARE IN QUESTION, OBTAIN CLARIFICATION FROM ARCHITECT.
2. COORDINATE EXHAUST FAN AND MECHANICAL UNIT LOCATIONS WITH MECHANICAL AND ELECTRICAL CONTRACTORS.
3. SEE PLUMBING DRAWINGS FOR LOCATIONS OF ALL PLUMBING VENTS AND GAS PIPING (COORDINATE WITH ALL TRADES)
4. COORDINATE ALL PENETRATIONS THROUGH ROOF W/ STRUCTURAL, PLUMBING, MECHANICAL, AND ELECTRICAL. PROVIDE ALL FLASHING AT PENETRATIONS PER SMACNA DETAILS UNLESS OTHERWISE NOTED.
5. ROOF CURBS FOR ALL MECHANICAL UNITS AND EQUIPMENT TO BE FURNISHED BY M.C. AND INSTALLED AND FLASHED BY G.C. UNLESS OTHERWISE NOTED.
6. G.C. WILL COORDINATE, LOCATE, AND INSTALL DRAINS AND CURBS. ROOFING CONTRACTOR SHALL FLASH AND SEAL ALL DRAINS, ROOF PENETRATIONS, ROOF EDGES, AND TERMINATIONS AS PART OF THIS CONTRACT ALL INCLUSIVE OF WARRANTY AS LISTED IN THE PROJECT MANUAL.
7. ROOF PLAN AND DETAILS ARE FOR GENERAL DESIGN INTENT. G.C. TO SUBMIT COMPLETE SHOP DRAWINGS SHOWING ALL CONSTRUCTION DETAILS AND LAYOUTS FOR A COMPLETE JOB ADHERING TO MANUFACTURERS' WARRANTIES.
8. PROVIDE ALL TAPERS AND CRICKETS FOR PROPER DRAINAGE.
9. SLOPE ALL ROOF AREAS AT A MIN. OF 1/4" PER FOOT UNLESS OTHERWISE NOTED.
10. ALL CONCEALED WOOD BLOCKING SHALL BE P.T. SECURE TO DECKING AND SUBSTRATE WITH ANCHOR BOLTS.
11. UNLESS NOTED OTHERWISE, PRIME & PAINT ALL EXPOSED STEEL MEMBERS W/ EXTERIOR GRADE HIGH PERFORMANCE COATINGS. SEE SPECIFICATIONS.
12. ALL SHEET METAL APPLICATIONS SHALL BE INSTALLED PER NRCA'S "THE ROOFING MANUAL" AND SMACNA'S "ARCHITECTURAL SHEET METAL MANUAL" SEVENTH EDITION APPROVED DETAILING, INCLUDING (BUT NOT LIMITED TO) COPING, STEP FLASHING, METAL WALL FLASHING, ROOF PENETRATION FLASHING, STANDING SEAM METAL ROOFS, GUTTERS, SCUPPERS, GUTTER STOPS, CONDUCTOR HEADS, AND MISC. JOINTS BETWEEN SHEET METAL MEMBERS.
13. ALL RIGID INSULATION USED IN ROOF ASSEMBLIES SHALL MEET THE REQUIREMENTS OF UL 1256 AND FMG 4450.
14. DOWNSPOUTS FOR PRE-ENGINEERED SHALL BE SIZED BY METAL CANOPY MFR.
15. ROOF ACCESS LADDERS SHALL MEET OSHA AND BUILDING CODE REQUIREMENTS.
16. METAL GAUGES SHALL COMPLY WITH ANSIS/PRIE-1 REQUIREMENTS FOR SHOP FORMED METAL COPINGS.
17. ALL WOOD MEMBERS SHALL BE PRESERVATIVE TREATED.
18. ALL MECHANICAL EQUIPMENT, EXHAUST FANS, AND SKYLIGHTS SHALL BE ON ROOF CURBS. ALL ROOF CURBS SHALL BE INSULATED AND THE VOID BENEATH ITEMS WITHIN THE CURB SPACE SHALL BE FILLED WITH INSULATION.
19. ALL CRICKETS ARE ANGLED 30 DEGREES MIN. UNLESS NOTED OTHERWISE.
20. ALL CRICKET SLOPES ARE 1/4" PER 1'-0" UNLESS NOTED OTHERWISE.
21. ALL OBJECTS GREATER THAN 24" IN WIDTH ACROSS SLOPE SHALL HAVE CRICKETS TO DIVERT WATER AROUND THEM.
22. ANYWHERE EXPOSED FASTENERS ARE USED IN THE ROOFING SYSTEM, COPING SYSTEM, EXPANSION JOINT SYSTEM, OR FLASHING SYSTEM, THEY SHALL UTILIZE SEALING WASHERS.

Order Plans @ WWW.DILine.com

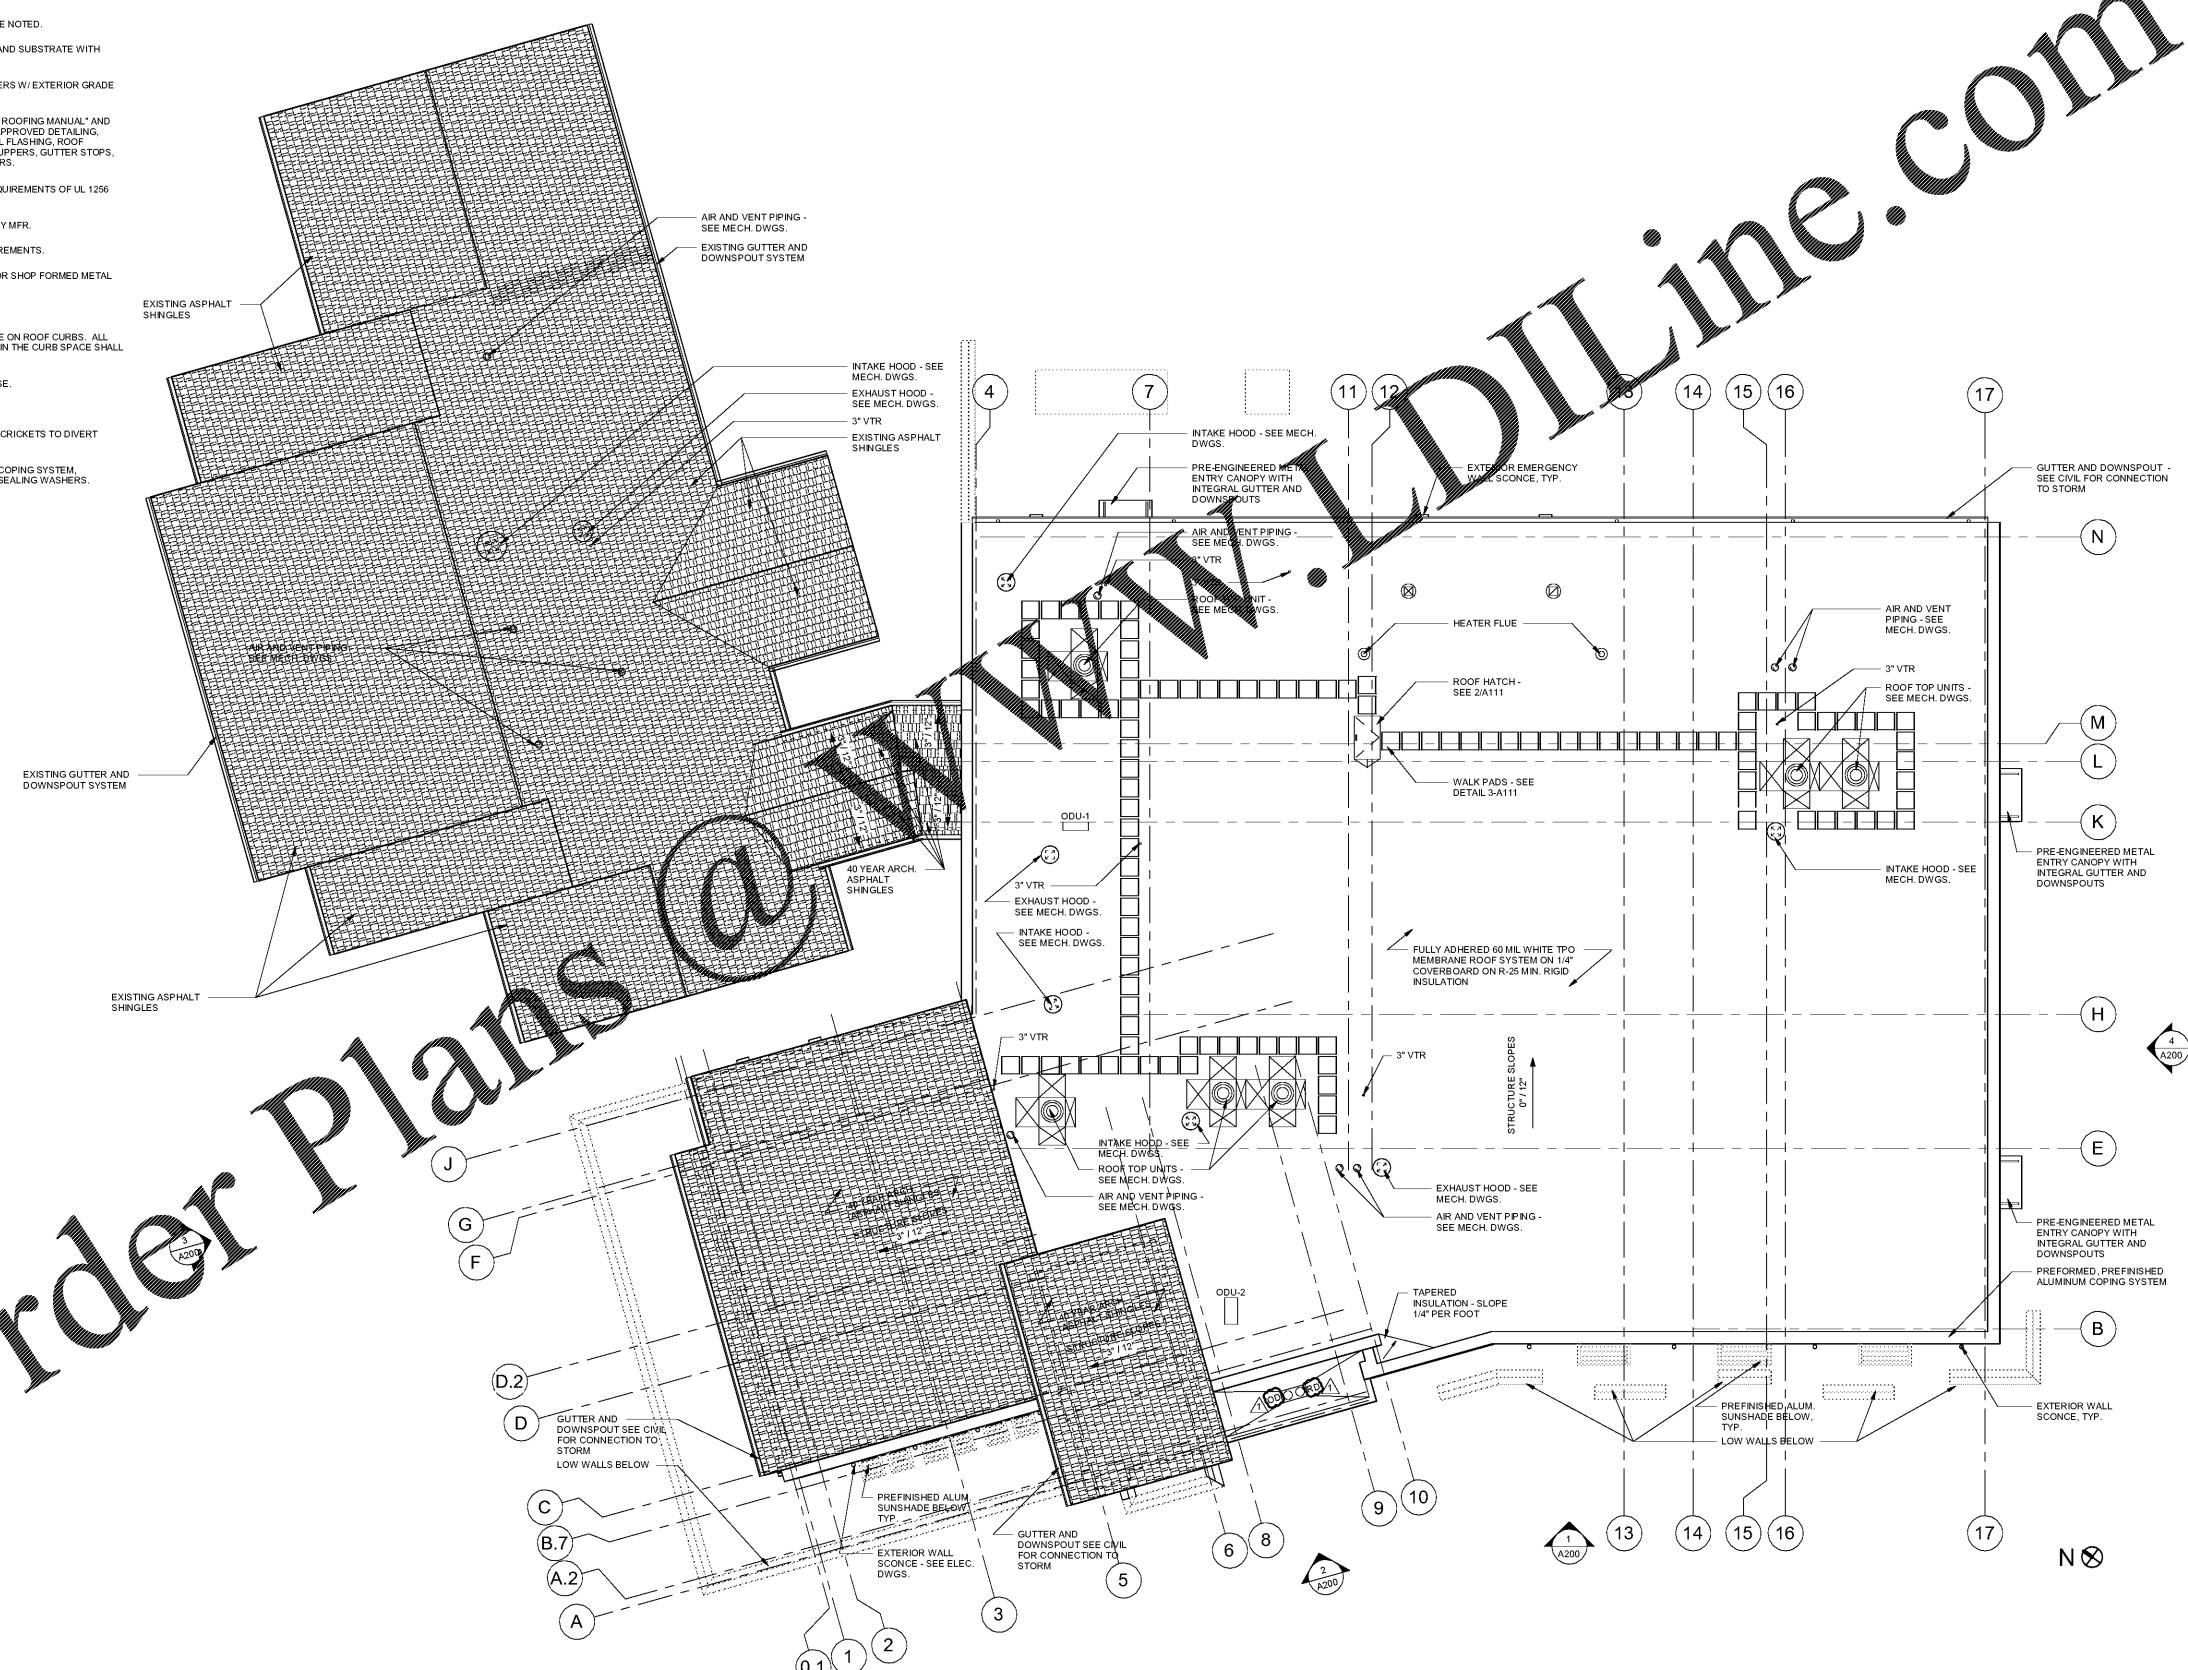

A NEW POLICE FACILITY FOR  
**ABERDEEN POLICE DEPARTMENT**

804 N. Sandhills Blvd.  
Aberdeen, NC 28315

**ROOF PLAN**

DATE: 11-22-2019  
PROJECT NO: 18062

REVISIONS		
NO.	DATE	DESCRIPTION
1	12.20.19	COORDINATION

THIS DRAWING IS THE PROPERTY OF ADW ARCHITECTS, P.A. AND SHALL NOT BE REPRODUCED OR COPIED IN WHOLE OR PART. IT SHALL NOT BE USED ON ANY OTHER PROJECT OR GIVEN TO ANY OTHER COMPANY OR AGENCY WITHOUT THE CONSENT OF ADW ARCHITECTS, P.A.



SHEET NUMBER

**A110**