

RENOVATION AND
ADDITION FOR
**ABERDEEN
POLICE
DEPARTMENT**



10/25/2019

FIRST FLOOR
POWER PLAN -
NEW CONSTRUCTION

DATE: 10/25/2019
PROJECT NO: 18062


REVISIONS

NO.	DATE	DESCRIPTION

THIS DRAWING IS THE PROPERTY OF ADW ARCHITECTS, P.A. AND SHALL NOT BE REPRODUCED OR COPIED IN WHOLE OR PART. IT SHALL NOT BE USED ON ANY OTHER PROJECT OR GIVEN TO ANY OTHER COMPANY OR AGENCY WITHOUT THE CONSENT OF ADW ARCHITECTS, P.A.

SHEET NUMBER

E201

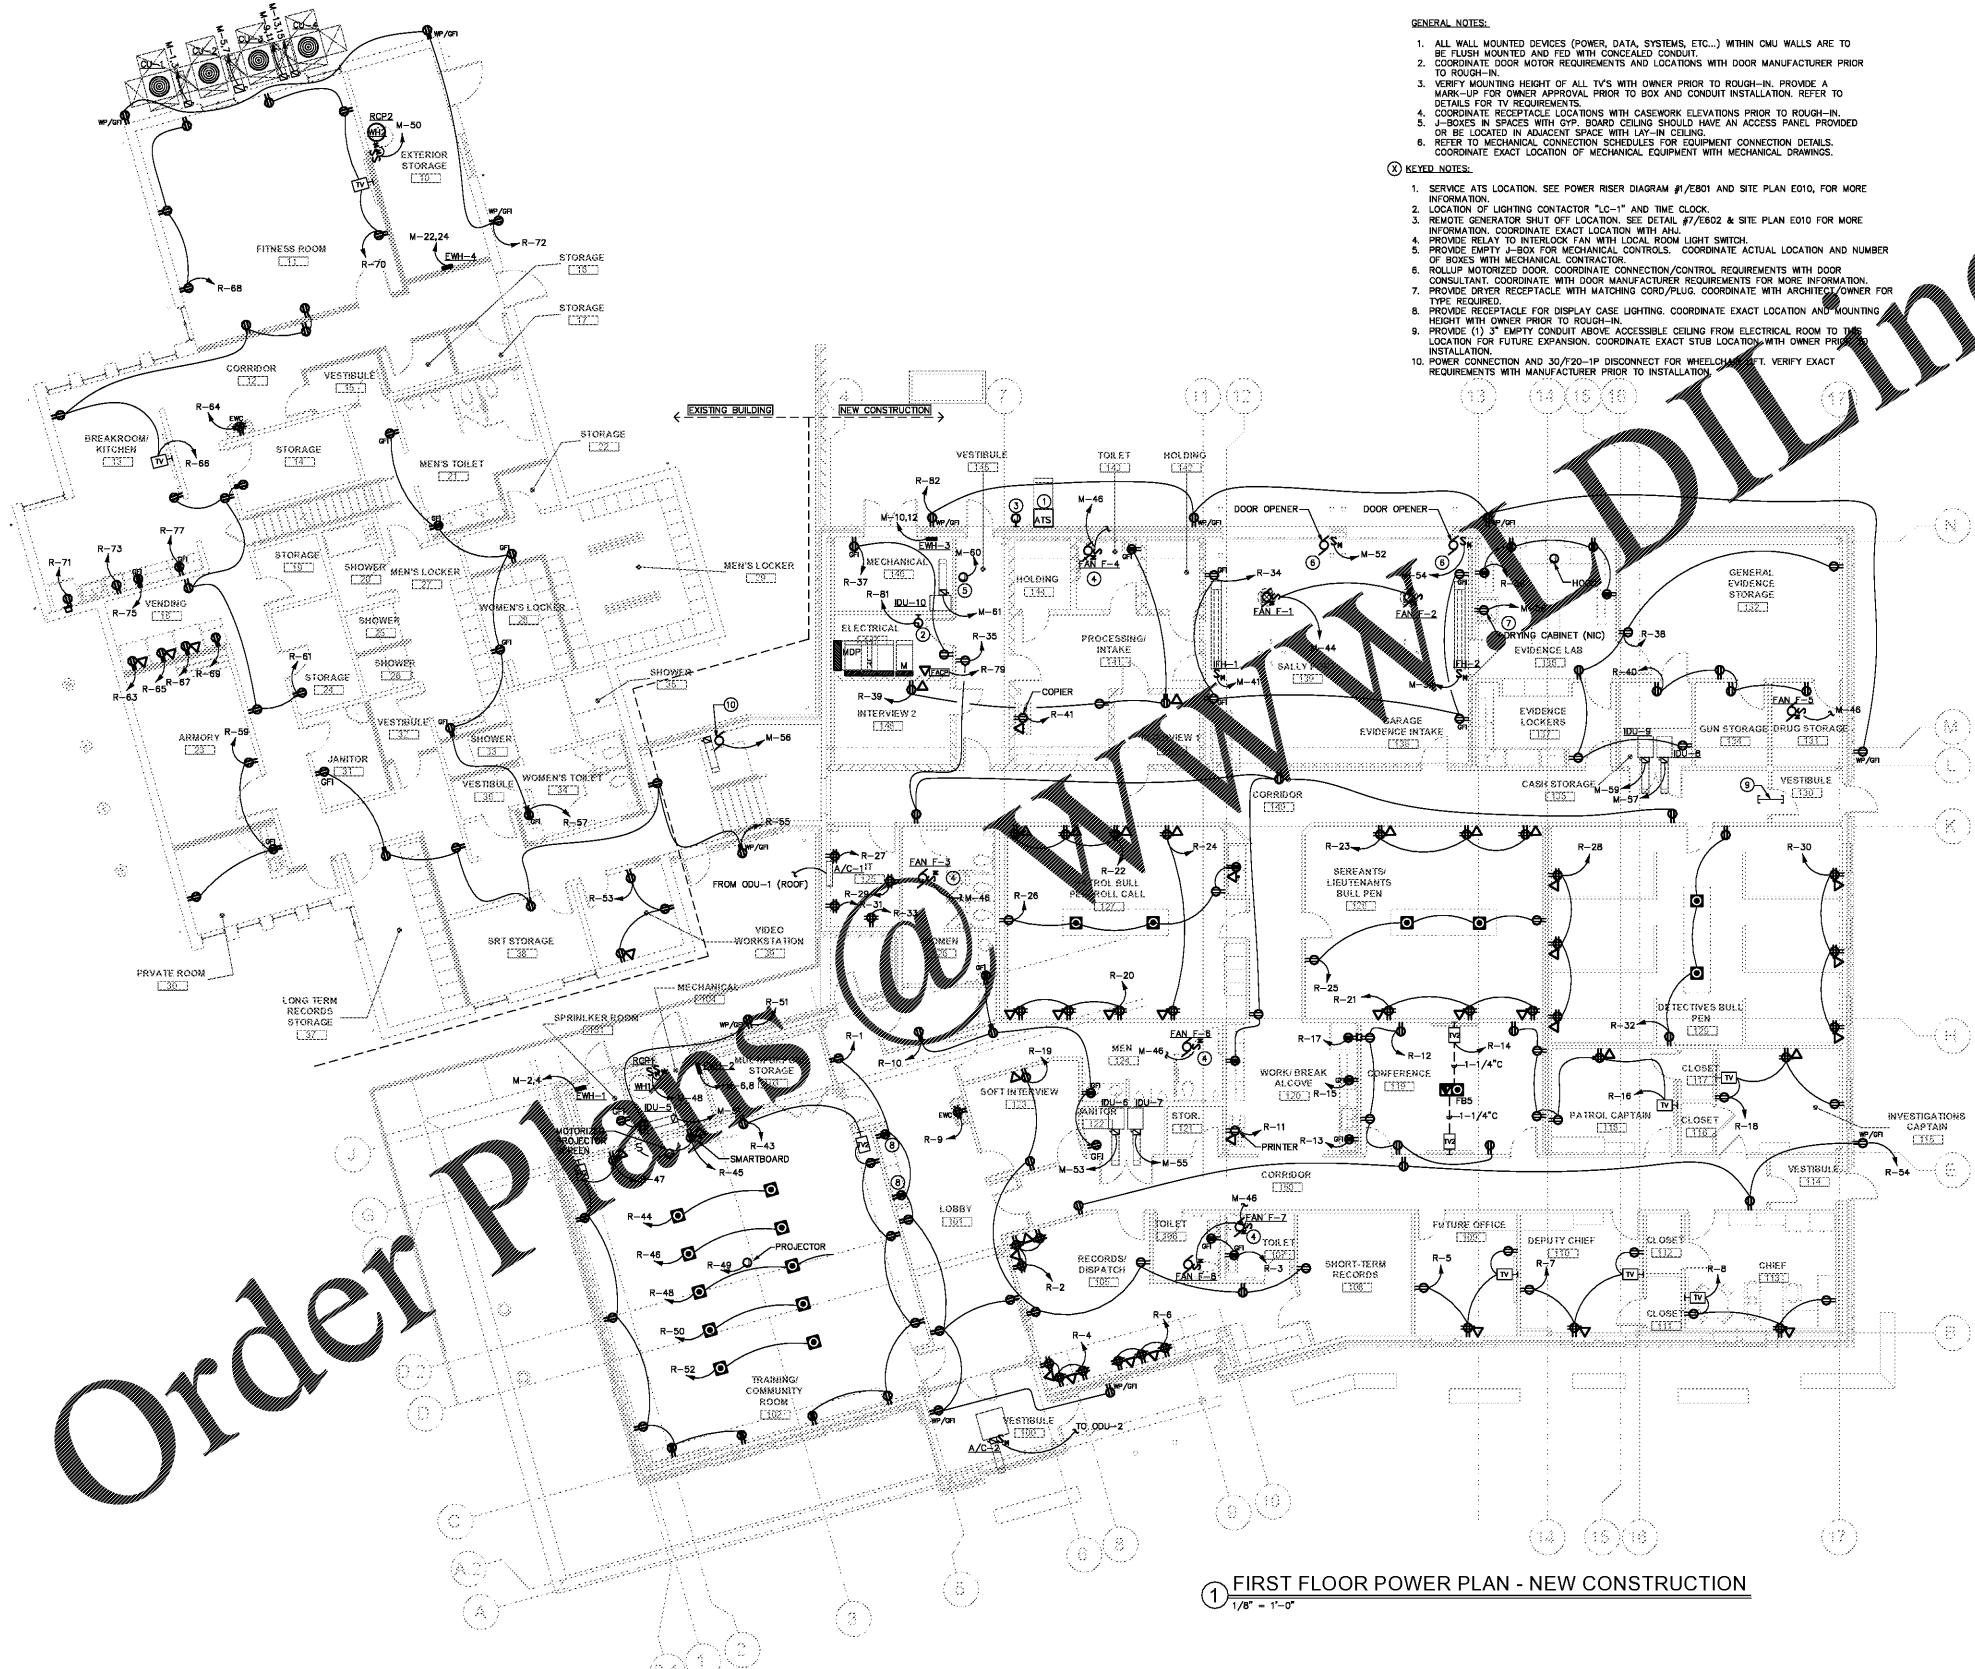

- GENERAL NOTES:**
1. ALL WALL MOUNTED DEVICES (POWER, DATA, SYSTEMS, ETC.) WITHIN CMU WALLS ARE TO BE FLUSH MOUNTED AND FED WITH CONCEALED CONDUIT.
 2. COORDINATE DOOR MOTOR REQUIREMENTS AND LOCATIONS WITH DOOR MANUFACTURER PRIOR TO ROUGH-IN.
 3. VERIFY MOUNTING HEIGHT OF ALL TV'S WITH OWNER PRIOR TO ROUGH-IN. PROVIDE A MARK-UP FOR OWNER APPROVAL PRIOR TO BOX AND CONDUIT INSTALLATION. REFER TO DETAILS FOR TV REQUIREMENTS.
 4. COORDINATE RECEPTACLE LOCATIONS WITH CASEWORK ELEVATIONS PRIOR TO ROUGH-IN.
 5. J-BOXES IN SPACES WITH POP BOARD CEILING SHOULD HAVE AN ACCESS PANEL PROVIDED OR BE LOCATED IN ADJACENT SPACE WITH LAY-IN CEILING.
 6. REFER TO MECHANICAL CONNECTION SCHEDULES FOR EQUIPMENT CONNECTION DETAILS. COORDINATE EXACT LOCATION OF MECHANICAL EQUIPMENT WITH MECHANICAL DRAWINGS.
- KEYED NOTES:**
1. SERVICE ATS LOCATION. SEE POWER RISER DIAGRAM #1/E801 AND SITE PLAN E010, FOR MORE INFORMATION.
 2. LOCATION OF LIGHTING CONTACTOR "LC-1" AND TIME CLOCK.
 3. REMOTE GENERATOR SHUT OFF LOCATION. SEE DETAIL #7/E502 & SITE PLAN E010 FOR MORE INFORMATION. COORDINATE EXACT LOCATION WITH AHI.
 4. PROVIDE RELAY TO INTERLOCK FAN WITH LOCAL ROOM LIGHT SWITCH.
 5. PROVIDE EMPTY J-BOX FOR MECHANICAL CONTROLS. COORDINATE ACTUAL LOCATION AND NUMBER OF BOXES WITH MECHANICAL CONTRACTOR.
 6. ROLLUP MOTORIZED DOOR. COORDINATE CONNECTION/CONTROL REQUIREMENTS WITH DOOR CONSULTANT. COORDINATE WITH DOOR MANUFACTURER REQUIREMENTS FOR MORE INFORMATION.
 7. PROVIDE DRYER RECEPTACLE WITH MATCHING CORD/PLUG. COORDINATE WITH ARCHITECT/OWNER FOR TYPE REQUIRED.
 8. PROVIDE RECEPTACLE FOR DISPLAY CASE LIGHTING. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT WITH OWNER PRIOR TO ROUGH-IN.
 9. PROVIDE (1) 3" EMPTY CONDUIT ABOVE ACCESSIBLE CEILING FROM ELECTRICAL ROOM TO THE LOCATION FOR FUTURE EXPANSION. COORDINATE EXACT STUB LOCATION WITH OWNER PRIOR TO INSTALLATION.
 10. POWER CONNECTION AND 30/20-1" DISCONNECT FOR WHEELCHAIR LIFT. VERIFY EXACT REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION.

Order Plans @

1 FIRST FLOOR POWER PLAN - NEW CONSTRUCTION
1/8" = 1'-0"