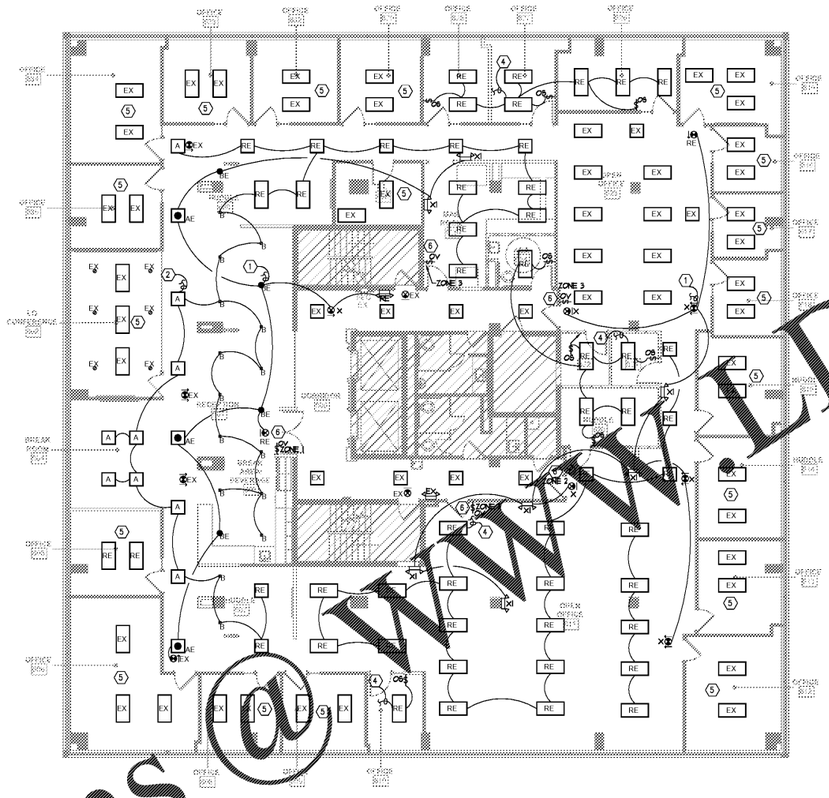

1 L-1.6 LIGHTING PLAN
1/8"=1'-0"

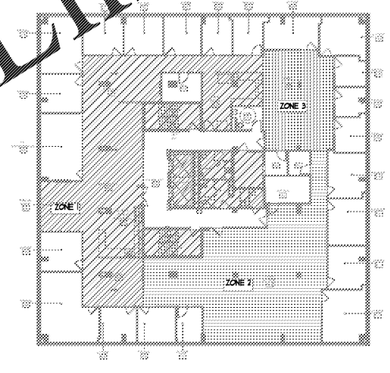

2 L-1.6 LIGHTING CONTROL ZONING
NTS

GENERAL NOTES:
(APPLY TO THIS SHEET ONLY)

1. REFER TO DRAWING E-0.0 FOR SYMBOLS LEGEND AND LIGHTING FIXTURE SCHEDULE.
2. ALL FIXTURES SHALL BE NEW UNLESS OTHERWISE NOTED. 'EX' ADJACENT TO A FIXTURE INDICATES A FIXTURE THAT IS EXISTING TO REMAIN. "RE" ADJACENT TO A FIXTURE INDICATES THE NEW LOCATION OF AN EXISTING FIXTURE.
3. COORDINATE EXISTING DEVICES TO BE REMOVED AND RETURNED TO OWNER WITH ARCHITECT.
4. CIRCUIT NUMBERS ARE SHOWN FOR INTENT ONLY. FIELD VERIFICATION WILL DETERMINE BRANCH CIRCUITS AVAILABLE FOR USE BY THIS TENANT. BRANCH CIRCUITS USED SHOULD BE NOTED AND UPDATED ON ALL PANEL SCHEDULES.
5. ALL UPDATED ELECTRICAL PANEL BOARD SCHEDULES SHALL BE TYPED, NOT HAND WRITTEN.
6. HATCHING INDICATED AREA NOT IN SCOPE.
7. DRAWINGS ARE DIAGRAMMATIC. COORDINATE WITH ALL TRADES. CONFIRM NO CONFLICTS BETWEEN LIGHTING AND MECHANICAL SYSTEMS PRIOR TO INSTALLATION.

LEGEND NOTES:
(APPLY TO THIS SHEET ONLY)

1. CONNECT TO EXISTING CIRCUIT SERVING EMERGENCY LIGHTING ON THIS FLOOR/AREA. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THAT CIRCUIT WILL NOT BE OVERLOADED BY ADDITION, AND ADD AN ADDITIONAL CIRCUIT IF NECESSARY.
2. PROVIDE CONNECTION TO EXISTING NORMAL POWER LIGHTING CIRCUIT SERVING EXISTING RECEPTION. REROUTE EXISTING HOMERUN THROUGH NEW BLUE BOX LIGHTING CONTROL PANEL. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THAT CIRCUIT WILL NOT BE OVERLOADED BY ADDITION, AND ADD AN ADDITIONAL CIRCUIT AND RELAY IN LIGHTING CONTROL PANEL IF NECESSARY.
3. PROVIDE CONNECTION TO EXISTING NORMAL POWER LIGHTING CIRCUIT SERVING THIS AREA. REROUTE EXISTING HOMERUN THROUGH NEW BLUE BOX LIGHTING CONTROL PANEL. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THAT CIRCUIT WILL NOT BE OVERLOADED BY ADDITION, AND ADD AN ADDITIONAL CIRCUIT AND RELAY IN LIGHTING CONTROL PANEL IF NECESSARY.
4. PROVIDE CONNECTION TO EXISTING NORMAL POWER LIGHTING CIRCUIT SERVING ENCLOSED OFFICES. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THAT CIRCUIT SERVING ENCLOSED OFFICES DOES NOT ALSO SERVE OPEN AREAS SUCH AS CORRIDORS AND OPEN OFFICES. IN THE EVENT THAT THE CIRCUIT ALSO SERVES THE OPEN AREAS, PROVIDE NEW 20/1 BREAKER IN PANEL "1I" AND PROVIDE NEW HOMERUN TO THIS BREAKER. NEW CIRCUIT SHALL ONLY SERVE ENCLOSED ROOMS/OFFICES IN THIS AREA. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THAT CIRCUIT WILL NOT BE OVERLOADED BY ADDITION, AND ADD AN ADDITIONAL CIRCUIT AND RELAY IN LIGHTING CONTROL PANEL IF NECESSARY.
5. LIGHTING IN ROOM IS EXISTING TO REMAIN. MAINTAIN EXISTING SWITCHING.
6. PROVIDE LIGHTING CONTROL OVERRIDE SWITCH FOR TENANT USE. OVERRIDE SWITCH SHALL CONTROL ZONE AS INDICATED. REFER TO LIGHT CONTROL ZONE DIAGRAM FOR ZONING. COORDINATE LOCATION WITH ARCHITECT AND OWNER. PROVIDE ALL CONNECTIONS REQUIRED FOR A COMPLETE INSTALLATION.

PROJECT NORTH

BW&A Barrett, Woodyard & Associates, Inc.
3495 Holcomb Bridge Road
Norcross, GA 30092
Phone (770) 810-8800

©This drawing is copyrighted. It may not be reproduced nor used in any other form or in any other project.
BW & A# # 2019-3477

Hendrick
1201 Peachtree Street, NE
400 Colony Square
Suite 1900
Atlanta, GA 30361

T: 404.261.9383
F: 404.240.9398
www.hendrickinc.com

GEORGIA
REGISTERED ARCHITECT
KEVIN W. PRICE

No.	Date	Description
	01/08/2020	ISSUED/RELEASED FOR CONSTRUCTION

Project Name

FranklinStreet

FRANKLIN STREET
3384 PEACHTREE ROAD
NE, SUITE 650
ATLANTA, GA 30326

ISSUE
ISSUED/RELEASED FOR CONSTRUCTION

LIGHTING PLAN

RS	Drawn
KP	Checked
As indicated	Scale
01/08/2020	Date
142-001-01	Project No.

This drawing and all reproductions are the property of Hendrick, Inc and may be used or reproduced only with the written permission of Hendrick, Inc.

L-1.6
Drawing Number

Order Plans @ WWW.LDILine.com