

**GENERAL NOTES**      **SHEET NOTES**      **DEMOLITION REQUIREMENTS**

REFER TO SHEET R1 FOR NOTES PERTAINING TO THIS SHEET

**EPA CLEAN AIR ACT**

COMPLY WITH CLEAN AIR ACT, TITLE V, SECTION 608 AND CODE OF FEDERAL REGULATION TITLE 40, PART 82 WHEN ADDING OR REMOVING REFRIGERATED EQUIPMENT. RECORD ALL EQUIPMENT IDENTIFICATION NUMBERS, MODEL AND SERIAL NUMBERS, THE AMOUNT OF REFRIGERANT RECOVERED FROM EACH UNIT, THE DATE OF DECOMMISSIONING, COMPANY NAME AND SIGNATURE OF ON-SITE SUPERVISOR.

ALL WORK ON THIS SHEET IS TO BE COMPLETED BY A WALMART APPROVED CONTRACTOR

- SALES FLOOR TO BE ACCESSIBLE TO CUSTOMERS DURING NON-CONSTRUCTION HOURS. PROVIDE TEMPORARY COVERS CAPABLE OF WITHSTANDING SHOPPING CART TRAFFIC AND OCCUPANTS FOR PITS AND TUNNELS. REMOVE CONSTRUCTION FENCING AND DUST WALLS INTERFERING WITH CUSTOMER CIRCULATION OR ACCESS.
- REMOVE WALL STANDARDS ABOVE 20' AFF. DEMOLITION INCLUDES BUT IS NOT LIMITED TO ITEMS SHOWN DASHED. REF DEMOLITION REQUIREMENT NOTE ON THIS SHEET.
- REMOVE ALL DOORS SHOWN DASHED. REFER TO ENLARGED PLANS AND DOOR SCHEDULE FOR DOOR AND FRAME REPLACEMENT. REMOVE CARPET AND GLUE FROM COLUMNS PATH AND REPAIR COLUMNS TO SMOOTH SURFACE PRIOR TO PAINTING.
- COORDINATE REMOVAL AND DISPOSAL OF EXISTING REFRIGERATED CASES AND FIXTURES WITH MECHANICAL SERVICES CONSTRUCTION MANAGER.

- ALL DEMOLITION SHALL BE CARRIED OUT IN A SAFE MANNER AND IN STRICT ACCORDANCE WITH OSHA REGULATIONS.
- THE CONTRACTOR SHALL FIELD VERIFY THE EXTENT OF DEMOLITION. THE WORK INCLUDES, BUT IS NOT LIMITED TO, THE DEMOLITION AND REMOVAL OF REFRIGERATION EQUIPMENT, REFRIGERATION LINES, AND ELECTRICAL ITEMS INCLUDING CONDUITS AS SHOWN ON DRAWING OR AS REQUIRED FOR THE INSTALLATION OF NEW WORK FOR A COMPLETE JOB.
- WHEN UTILITIES ARE REMOVED, CAP AND SEAL A MINIMUM OF 8" BELOW FINISH FLOOR OR A MINIMUM OF 6" ABOVE FINISHED CEILING. SHOW ALL ABANDONED AND CAPPED UTILITIES ON AS-BUILTS, DRAWINGS, AND RECORDED DOCUMENTS.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE ADEQUATE SHORING, BRACING, AND SUPPORT SYSTEMS TO KEEP THE EXISTING STRUCTURE UPRIGHT AND IN A SAFE CONDITION THROUGHOUT THE REMOVAL OF STRUCTURAL ITEMS AND NEW CONSTRUCTION.
- THE CONTRACTOR SHALL OBTAIN A REGISTERED PROFESSIONAL ENGINEER TO DESIGN THE SHORING AND SPECIFY THE REQUIRED BRACING.
- IT IS THE CONTRACTOR'S RESPONSIBILITY FOR PLANS AND METHODS OF DEMOLITION AND NEW CONSTRUCTION PRIOR TO THE EXCAVATION OF FOUNDATIONS ADJACENT TO THE EXISTING STRUCTURE. PROVIDE ADEQUATE SUPPORT FOR THE SUB-BASE TO PREVENT UNDERMINING.
- DURING DEMOLITION AND RECONSTRUCTION, THE CONTRACTOR SHALL COORDINATE WITH THE WALMART CONSTRUCTION MANAGER ANY REQUIRED SAFETY BARRIERS OR BARRICADES. REFER TO THE WALMART CONSTRUCTION MANAGER FOR PHASING AND SCHEDULING DEMOLITION AND NEW CONSTRUCTION.
- CONDUCT ALL DEMOLITION AND REMOVAL OF DEBRIS AS REQUIRED TO INSURE MINIMUM INTERFERENCE WITH BUILDING'S FACILITIES AND OPERATIONS. REFERENCE SALVAGE REQUIREMENTS.
- NOTES INDICATING DEMOLITION WORK ARE NOT CONFIRMED SOLELY TO THE DEMOLITION PLANS. THE GENERAL CONTRACTOR SHALL REVIEW ALL CONSTRUCTION DOCUMENTS, INCLUDING OF SCHEDULES AND SPECIFICATIONS TO DETERMINE FULL EXTENT OF DEMOLITION WORK.

**DEMOLITION LEGEND**

- EXISTING TO REMAIN
- DEMOLISH/REMOVE
- AREA TO BE DEMOLISHED
- RELOCATE

**STIPULATION FOR REUSE**

THE CONTRACTOR SHALL FIELD VERIFY THE EXTENT OF DEMOLITION. THE WORK INCLUDES, BUT IS NOT LIMITED TO, THE DEMOLITION AND REMOVAL OF REFRIGERATION EQUIPMENT, REFRIGERATION LINES, AND ELECTRICAL ITEMS INCLUDING CONDUITS AS SHOWN ON DRAWING OR AS REQUIRED FOR THE INSTALLATION OF NEW WORK FOR A COMPLETE JOB.

**CONSULTANTS**

ITC ENGINEERING, INC.  
1000 W. BROADWAY, SUITE 100  
HOUSTON, TEXAS 77002  
PH: 281.441.1111  
WWW.ITCENGINEERING.COM

**SALVAGE REQUIREMENTS**

IMMEDIATE SALVAGE/LEGAL DISPOSAL OF ALL DECOMMISSIONED EQUIPMENT AND CONSTRUCTION DEBRIS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. THE GENERAL CONTRACTOR WILL COORDINATE DISPOSAL OF OTHER MATERIALS WITH AES AND/OR WASTE MANAGEMENT.

RECLAIMED REFRIGERANT WILL REMAIN IN THE POSSESSION OF WALMART STORES, INC. ON APPLICABLE PROJECTS INVOLVING GAS CONVERSION THE CONTRACTOR SHALL ASSIST WALMART IN THE SCHEDULING OF APPROPRIATE CYLINDERS FOR THE COLLECTION OF REFRIGERANTS WHICH WALMART WILL PROCESS THROUGH THEIR VENDOR RECLAMATION PROGRAM, OR USE IN OTHER WALMART EQUIPMENT. AT THE DISCRETION OF THE WALMART CONSTRUCTION MANAGER, THE CONTRACTOR AND WALMART CONSTRUCTION MANAGER MUST RECORD THE USAGE OR DECOMMISSIONING OF THE REFRIGERANT LOGS AT THE COMPRESSOR RACKS.

INSTALLING CONTRACTOR WILL REMOVE AXP DEVICES MOUNTED ON WALK-IN BOXES PRIOR TO THE BOX DEMO AND HANDOVER TO STORE MANAGEMENT FOR SAFE STORAGE OF EQUIPMENT. GENERAL CONTRACTOR WILL PROVIDE NEW CONDUIT IN THE SAME LOCATION ON THE NEW WALK-IN BOXES. INSTALLING CONTRACTOR WILL NOTIFY CTS OF EQUIPMENT/SAFE RE-INSTALL DATE. CTS WILL ARRANGE FOR CABLING CONTRACTOR TO RUN WIRE AND RE-INSTALL AXP DEVICES.

SALVAGE OF WALK-IN PANELS AND WALK-IN DOORS WILL BE THE RESPONSIBILITY OF THE PANEL MANUFACTURER.

NOTICE: THESE SALVAGE REQUIREMENTS DO NOT INCLUDE HVAC EQUIPMENT, RACKHOUSES, CONDENSERS, REMOVE CONDENSING UNITS, COOLING TOWERS AND FLUID COOLER REPLACEMENTS.

**ROLE OF WASTE MANAGEMENT:**

- DELIVER CONTAINERS BASED ON DELIVERY DATES PROVIDED BY THE GENERAL CONTRACTOR.
- SERVICE FOR THE CONTAINERS AS REQUESTED SUPPORT PERSONNEL AT ALL TIMES DURING THE PROJECT DURATION.
- REPORTING FOR SERVICES THAT OCCUR AT THE END OF THE PROJECT.

**ROLE OF GENERAL CONTRACTOR (GC):**

- CONTACT WASTE MANAGEMENT 72 HOURS PRIOR TO PROJECT LAUNCH TO HAVE ESTABLISHED SERVICES DELIVERED.

**WASTE MANAGEMENT C&D TEAM**

1-866-338-2342 OR OAKLEAFCDTEAM@WM.COM

**BERNICE MURPHY** 1-850-265-6317 OR BMURPHY2@WM.COM

**MICHAEL LASSONDE** 1-850-265-6317 OR MLASSONDE@WM.COM

ESTABLISHED SERVICES WILL BE DETERMINED FROM THE PROJECT ESTIMATION FORM FILLED OUT BY THE GC.

REQUEST ALL NEEDS FOR CONTAINERS FOR SERVICE VIA PHONE OR EMAIL TO WMS NATIONAL ACCOUNTS OFFICE.

Walmart  
CAMDEN, SC  
STORE NO: 0634-296  
JOB NUMBER: 1950111

**ISSUE BLOCK**


NO.	DATE	DESCRIPTION

CHECKED BY: KK  
DRAWN BY: KS  
PROTO CYCLE: 10/25/19  
DOCUMENT DATE: 12/18/19

DOCUMENTS THAT DO NOT HAVE THE ARCHITECT OR ENGINEER OF RECORD SEAL AND SIGNATURE SHALL BE CONSIDERED NOT FOR CONSTRUCTION

**REFRIGERATION DEMO PLAN**

SHEET: RD1

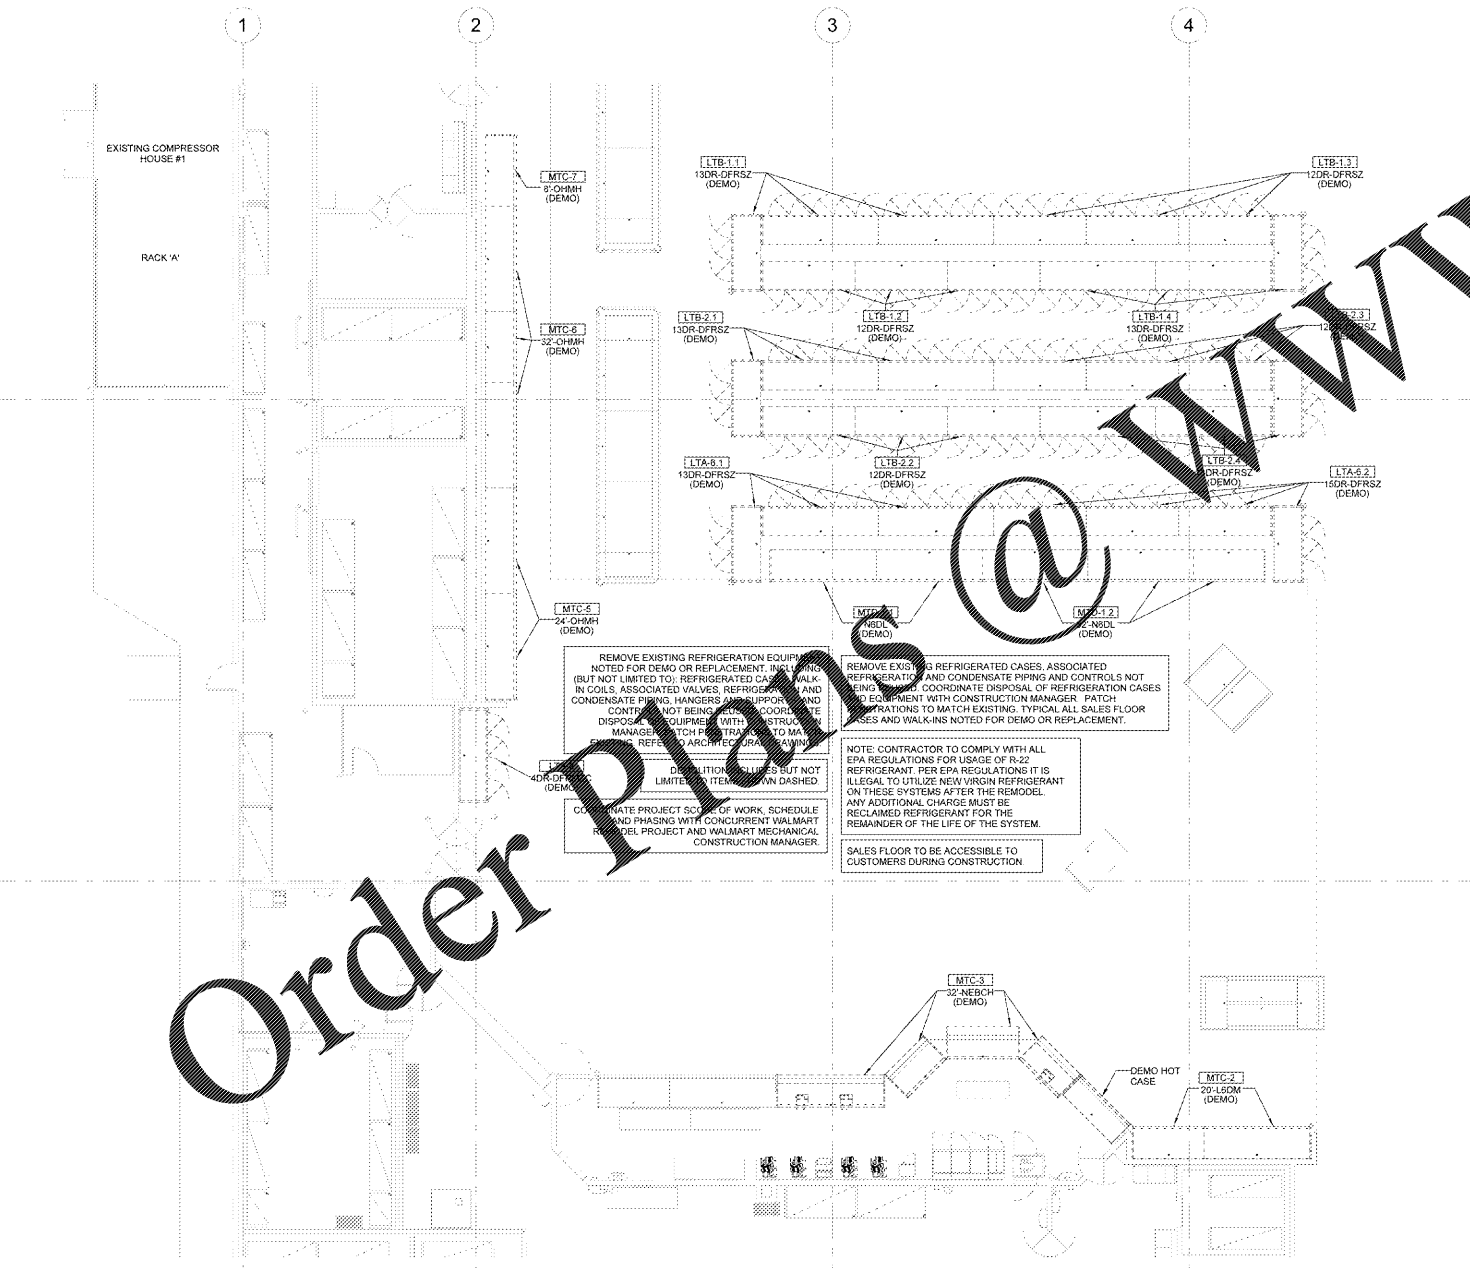

**1 FRONT REFRIGERATION DEMO PLAN**  
1/8" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELVES WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.