

GENERAL NOTES

REFER TO SHEET RD1 FOR GENERAL NOTES PERTAINING TO THIS SHEET.

STABILIZATION FOR REUSE  
THE CONTRACTOR SHALL STABILIZE ALL EXISTING CONCRETE SLABS TO BE REUSED IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION 05100 OF THE SDC SPECIFICATIONS. THE CONTRACTOR SHALL PROVIDE A LETTER OF SUBMITTAL TO THE ARCHITECT AND ENGINEER FOR REVIEW AND APPROVAL PRIOR TO COMMENCING WORK.

CONSULTANTS  
SDC ENGINEERING, INC.  
1000 W. UNIVERSITY BLVD.  
SUITE 200  
CAMPDEN, SC 29523  
PH: 803.733.1111  
PROJECT NUMBER: 1900111

Walmart  
CAMDEN, SC  
STORE NO: 0634-226  
JOB NUMBER: 1900111

ISSUE BLOCK


NO.	DESCRIPTION	DATE

CHECKED BY: KK  
DRAWN BY: KS  
PROTO CYCLE: 10/25/19  
DOCUMENT DATE: 12/18/19

DOCUMENTS THAT DO NOT HAVE THE ARCHITECT OR ENGINEER OF RECORD SEAL AND SIGNATURE SHALL BE CONSIDERED NOT FOR CONSTRUCTION

REFRIGERATION DEMO PLAN

SHEET: RD1.1

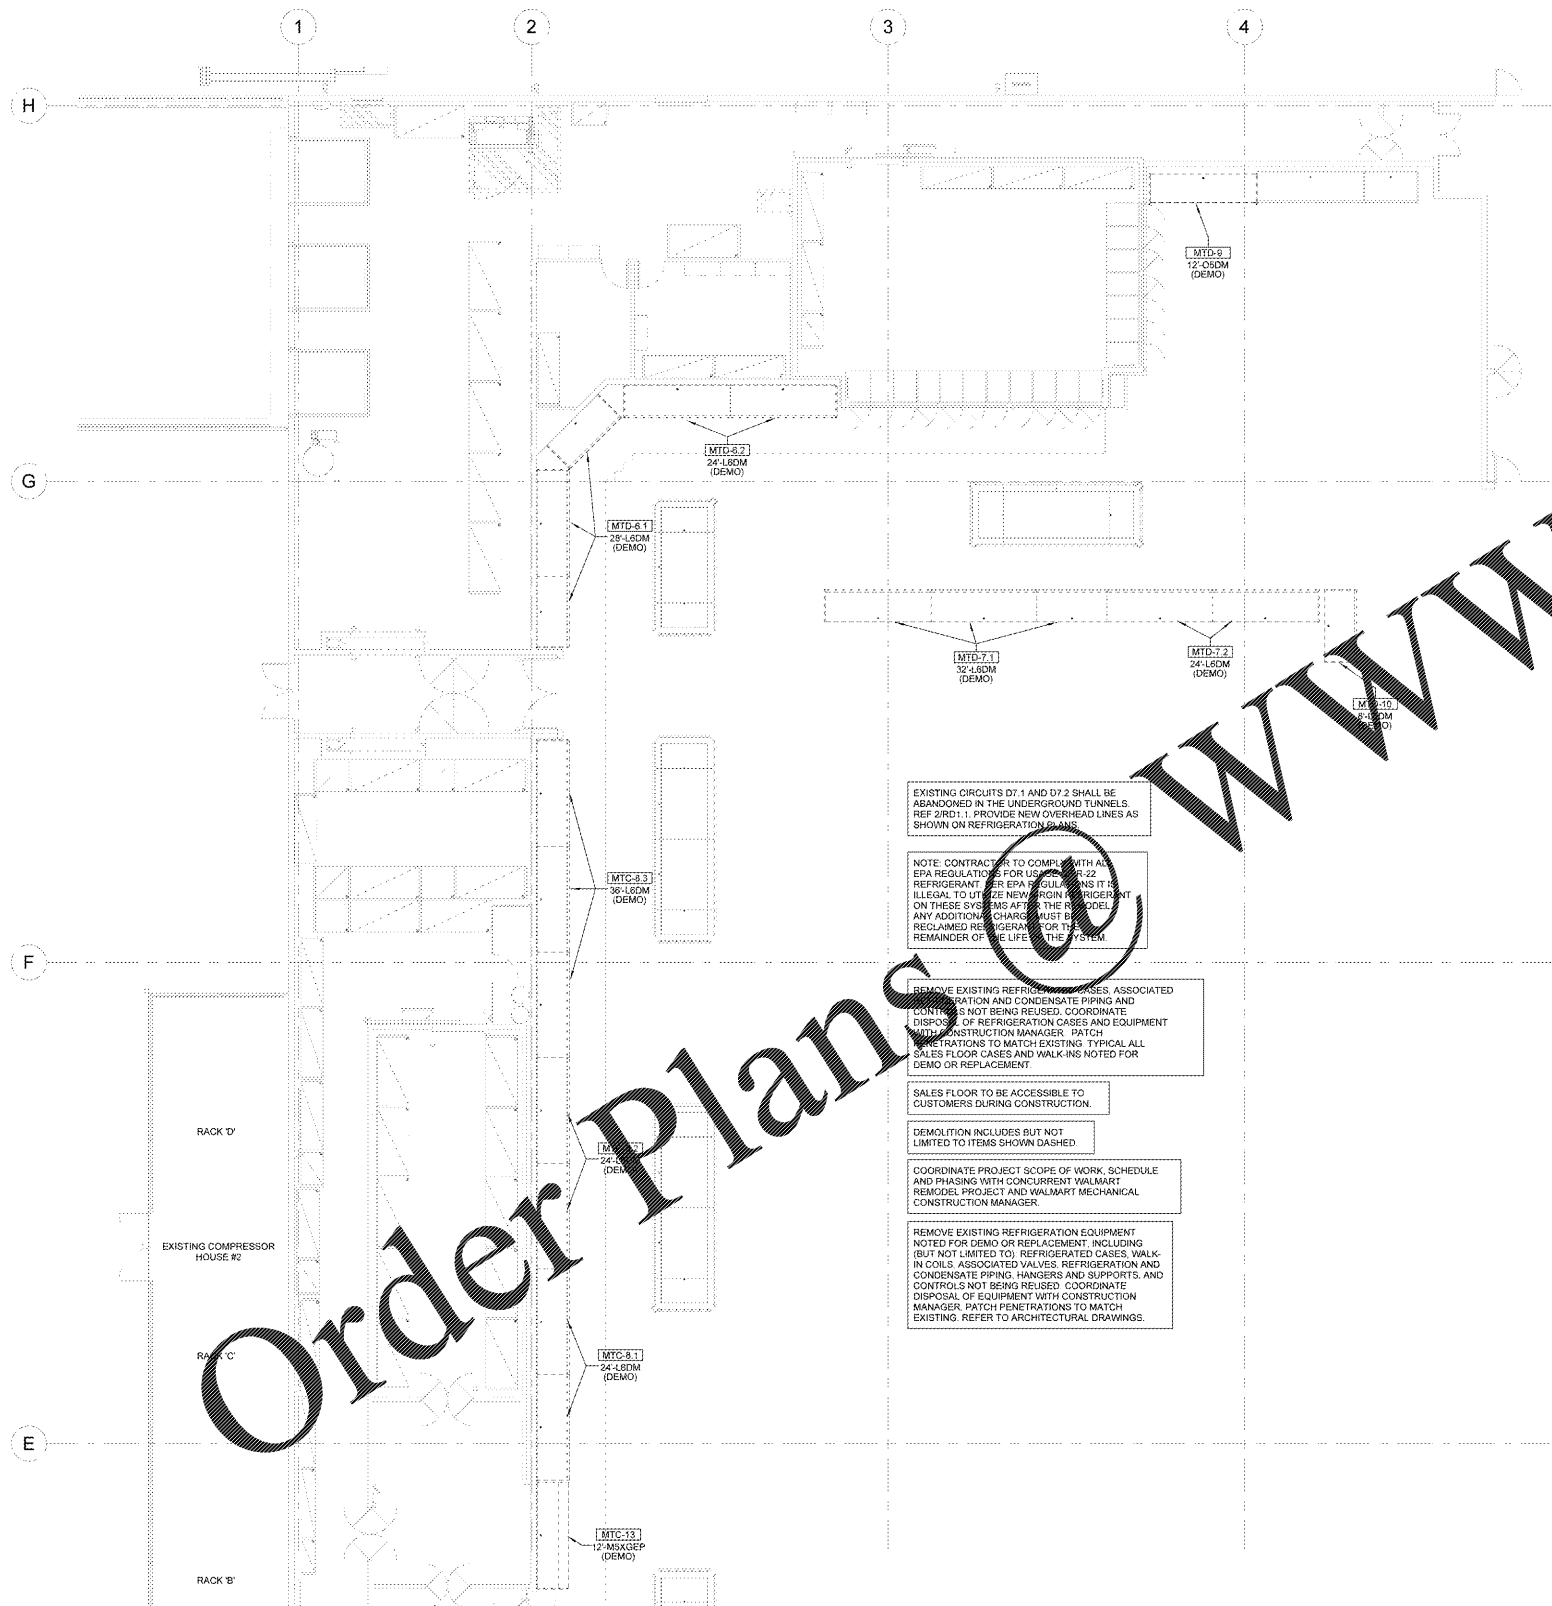

EXISTING CIRCUITS D7 1 AND D7 2 SHALL BE ABANDONED IN THE UNDERGROUND TUNNELS. REF 2/RD1.1. PROVIDE NEW OVERHEAD LINES AS SHOWN ON REFRIGERATION PLAN.

NOTE: CONTRACTOR TO COMPLY WITH ALL EPA REGULATIONS FOR USE OF R22 REFRIGERANT. PER EPA REGULATIONS IT IS ILLEGAL TO UTILIZE NEW R22 REFRIGERANT ON THESE SYSTEMS AS OF THE DATE. ANY ADDITIONAL CHARGES MUST BE RECLAIMED REFRIGERANT FOR THE REMAINDER OF THE LIFE OF THE SYSTEM.


REMOVE EXISTING REFRIGERATION CASES, ASSOCIATED REFRIGERATION AND CONDENSATE PIPING AND CONDENSATE PIPING. ITEMS NOT BEING REUSED. COORDINATE DISPOSAL OF REFRIGERATION CASES AND EQUIPMENT WITH CONSTRUCTION MANAGER. PATCH PENETRATIONS TO MATCH EXISTING TYPICAL ALL SALES FLOOR CASES AND WALK-INS NOTED FOR DEMO OR REPLACEMENT.

SALES FLOOR TO BE ACCESSIBLE TO CUSTOMERS DURING CONSTRUCTION.

DEMOLITION INCLUDES BUT NOT LIMITED TO ITEMS SHOWN DASHED.

COORDINATE PROJECT SCOPE OF WORK, SCHEDULE AND PHASING WITH CONCURRENT WALMART REMODEL, PROJECT AND WALMART MECHANICAL CONSTRUCTION MANAGER.

REMOVE EXISTING REFRIGERATION EQUIPMENT NOTED FOR DEMO OR REPLACEMENT, INCLUDING (BUT NOT LIMITED TO): REFRIGERATED CASES, WALK-IN COILS, ASSOCIATED VALVES, REFRIGERATION AND CONDENSATE PIPING, HANGERS AND SUPPORTS, AND CONTROLS NOT BEING REUSED. COORDINATE DISPOSAL OF EQUIPMENT WITH CONSTRUCTION MANAGER. PATCH PENETRATIONS TO MATCH EXISTING. REFER TO ARCHITECTURAL DRAWINGS.

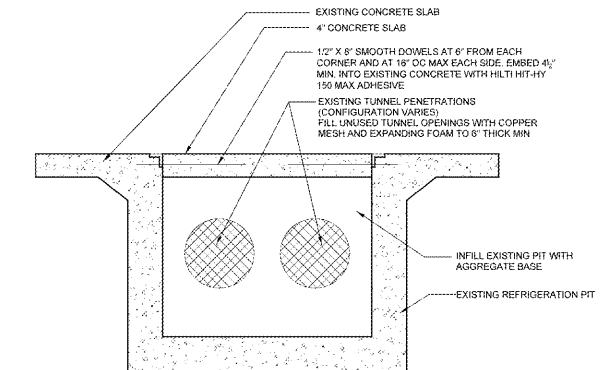

2 CONCRETE PIT COVER DETAIL  
12" x 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELVES WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

Order Plans.com

www.LDILine.com

1 REAR REFRIGERATION DEMO PLAN  
1/8" = 1'-0"