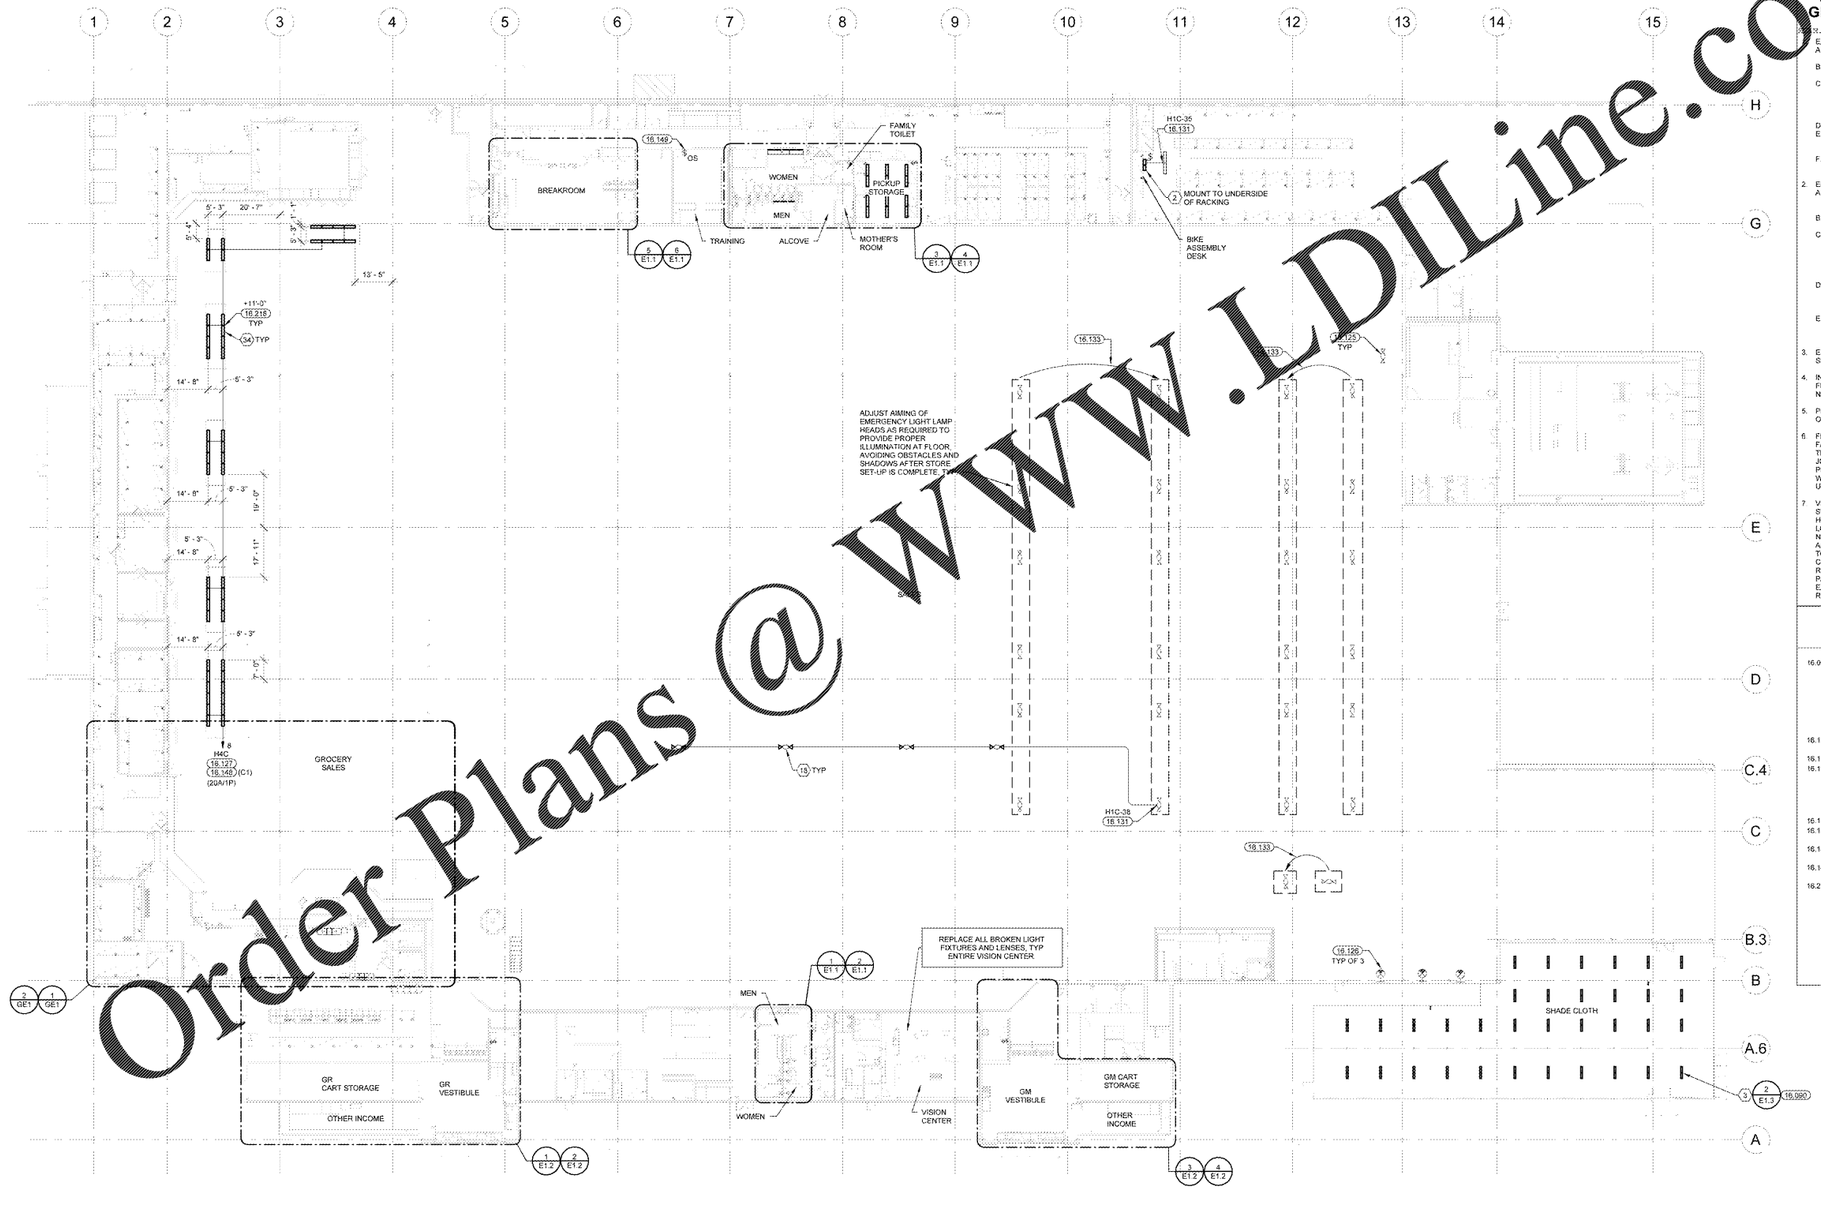

1 LIGHTING PLAN
1" = 20'-0"

EXISTING LIGHTING FIXTURES NOT SHOWN ARE EXISTING TO REMAIN AND ARE NOT AFFECTED BY THE SCOPE OF WORK ON THIS PROJECT. THIS INCLUDES ALL GENERAL LIGHTING, EGRESS LIGHTING AND EXIT LIGHTING.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

OCCUPANCY SENSOR NOTES

1. OCCUPANCY SENSORS IN RESTROOMS SHALL BE PROGRAMMED FOR AUTOMATIC ON AND MAXIMUM AVAILABLE TIME DELAY SETTINGS.
2. OCCUPANCY SENSORS IN DELI, PRODUCE, AND BAKERY PREP AREAS SHALL BE PROGRAMMED WITH MAXIMUM AVAILABLE TIME DELAY SETTINGS.
3. OCCUPANCY SENSORS IN WALK-IN COOLERS/FREEZERS SHALL BE LOW TEMPERATURE RATED, WALL MOUNTED IN WP BOX AND PROGRAMMED FOR AUTOMATIC ON AND 10 MINUTE TIME DELAY SETTING.
4. ALL OTHER OCCUPANCY SENSORS SHALL BE PROGRAMMED WITH THE MINIMUM AVAILABLE TIME DELAY SETTING UNLESS NOTED OTHERWISE.
5. ALL SINGLE-POLE OCCUPANCY SENSORS SHALL BE PROGRAMMED FOR MANUAL ON LIGHTING CONTROL UNLESS NOTED OTHERWISE.
6. ALL BI-LEVEL OCCUPANCY SENSORS SHALL BE PROGRAMMED FOR AUTOMATIC ON LIGHTING CONTROL [illegible] OF FIXTURES AND WITH MANUAL ON MODE FOR REMAINING FIXTURES.
7. WHERE TWO OCCUPANCY SENSORS ARE SHOWN IN THE SAME LOCATION, THEY ARE FOR PARALLEL OPERATION.

GENERAL LIGHTING NOTES

1. EXIT SIGN MOUNTING
   A. WALL FIXTURE: CENTER 12" ABOVE DOOR OPENING.
   B. CEILING FIXTURE: ON CEILING OR AT HEIGHT SPECIFIED ON DRAWINGS.
   C. PENDANT FIXTURE: MATCH HEIGHT OF EXISTING PENDANT MOUNTED EXIT SIGNS. IF STORE DOES NOT HAVE PENDANT MOUNTED EXIT SIGNS, THEN PENDANT MOUNT SIGN 24" BELOW BOTTOM OF BAR JOIST.
   D. VERIFY MOUNTING HEIGHT WITH AHJ.
   E. COORDINATE LOCATIONS OF EXIT SIGNS TO ENSURE STORE SIGNAGE DOES NOT OBSTRUCT THEIR VIEW.
   F. THE USE OF TRITIUM BASED RADIOACTIVE EXIT SIGNAGE IS PROHIBITED.
2. EMERGENCY LIGHT FIXTURE INSTALLATION
   A. WALL FIXTURE: 12" BELOW FINISHED CEILING OR +12'-0" IN AREAS OF EXPOSED STRUCTURE, UNLESS NOTED OTHERWISE.
   B. PENDANT FIXTURE: BOTTOM CHORD OF BAR JOIST OR AT HEIGHT SPECIFIED ON DRAWINGS.
   C. REMOTE HEAD FIXTURE: HEADS CENTERED ABOVE DOOR OPENING +0'-6", UNLESS NOTED OTHERWISE AND BATTERY PACK MOUNTED ON INTERIOR SIDE OF WALL 12" BELOW FINISHED CEILING OR AT BAR JOIST IN AREAS OF EXPOSED STRUCTURE.
   D. REFER TO MANUFACTURER'S WRITTEN INSTRUCTIONS. ALLOW BATTERY TO CHARGE CONTINUOUSLY FOR A MINIMUM OF 24 HOURS BEFORE INITIAL TESTING.
   E. AFTER EMERGENCY LIGHT HAS BEEN POWERED DO NOT TURN OFF FOR EXTENDED PERIODS OF TIME.
3. EXIT SIGNS, EMERGENCY LIGHTS AND NIGHT LIGHTS SHALL NOT BE SWITCHED.
4. IN AREAS OF OPEN STRUCTURE, MOUNT STRIP FIXTURE TO BOTTOM CHORD OF BAR JOIST, UNLESS NOTED OTHERWISE.
5. PROVIDE SEPARATE BOXES FOR GANGED SWITCHES ON SEPARATE BRANCH CIRCUITS.
6. FIXTURES DENOTED WITH "ABJ" ARE TO BE FASTENED ON UNISTRUT CHANNELS MOUNTED TO THE BOTTOM SIDE OF THE TOP CHORD OF BAR JOISTS. LOCATE THE FIXTURES RUNNING PERPENDICULAR TO BAR JOISTS WITHIN BAR JOISTS WEBBING SPACES. DO NOT FASTEN FIXTURE OR UNISTRUT CHANNELS TO ROOF DECK.
7. VERIFY THAT THE OPERATING MECHANISM OF LIGHT SWITCHES IN THE BUILDING ARE MOUNTED AT A HEIGHT THAT IS IN ACCORDANCE WITH ADA AND LOCAL ACCESSIBILITY REQUIREMENTS. ANY SWITCH NOT IN ACCORDANCE WITH ADA AND LOCAL ACCESSIBILITY REQUIREMENTS IS TO BE LOWERED TO THE APPROPRIATE HEIGHT. GENERAL CONTRACTOR SHALL REPAIR WALL AND FINISHES AS REQUIRED. EXISTING CONTROLS AND LIGHTING PATTERNS ARE TO BE MAINTAINED. EXTEND/REROUTE EXISTING BRANCH CIRCUITRY AS REQUIRED.

KEYNOTES

16.090	REPLACE EXISTING LIGHT FIXTURES IN THIS AREA WITH TYPE AND QUANTITY INDICATED. INSTALL NEW LIGHT FIXTURE IN SAME LOCATION AS EXISTING LIGHT FIXTURE BEING REPLACED. RECONNECT TO EXISTING CIRCUITRY AND CONTROLS. COORDINATE EXACT LIGHT FIXTURES TO BE REPLACED WITH WALMART CONSTRUCTION MANAGER PRIOR TO PERFORMING WORK.
16.125	EXISTING LIGHT FIXTURES TO REMAIN UNLESS NOTED OTHERWISE.
16.126	EXISTING LIGHT FIXTURE TO BE DEMOLISHED.
16.127	FURNISH AND INSTALL NEW 20 AMP, 277 VOLT CIRCUIT(S). FEED FROM PANELBOARD AS INDICATED. PROVIDE 20A-1P CIRCUIT BREAKER IF NEEDED. E.C. SHALL MATCH MANUFACTURER, TYPE AND A/C RATINGS OF EXISTING CIRCUIT BREAKERS.
16.131	CONNECT TO EXISTING CIRCUIT.
16.133	EXISTING LIGHT FIXTURES TO BE RELOCATED TO NEW LOCATION AS SHOWN.
16.148	ROUTE CIRCUIT THROUGH CONTACTOR. REFER TO POWER AND BAS ONE-LINE DIAGRAMS.
16.149	REPLACE EXISTING LIGHT SWITCH WITH OCCUPANCY SENSOR.
16.218	PROVIDE AIRCRAFT CABLE TO SUSPEND FIXTURE(S) TO HEIGHT INDICATED UTILIZING HANGERS FURNISHED WITH FIXTURE. INSTALL FIRST CABLE WITHIN 18" OF END OF EACH ROW. PROVIDE POWER TO EACH FIXTURE ROW VIA 1/2" FLEXIBLE METAL CONDUIT. FIXTURES ARE SHIPPED WITH INTEGRAL WIRING HARNESS AND MECHANICAL CONNECTORS FOR CONTINUOUS ROW MOUNTING. REFERENCE MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR DETAIL ON MOUNTING AND CONNECTING. TYP.

Order Plans @ WWW.LDILine.com

STIPULATION FOR REUSE
THESE DRAWINGS AND SPECIFICATIONS ARE AND SHALL REMAIN THE PROPERTY OF RTM ENGINEERING CONSULTANTS. THEY ARE NOT TO BE USED IN WHOLE OR IN PART FOR ANY PROJECT OTHER THAN THE ONE FOR WHICH THEY WERE PREPARED. ANY REUSE OF THESE DRAWINGS AND SPECIFICATIONS WITHOUT WRITTEN VERIFICATION OR ADAPTATION BY RTM ENGINEERING CONSULTANTS FOR THE SPECIFIC PURPOSE INTENDED WILL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO RTM ENGINEERING CONSULTANTS. ANY SUCH UNAUTHORIZED REUSE MAY BE CONSTRUED TO BE CONTRARY TO COPYRIGHT LAWS.

CONSULTANTS
rtm engineering consultants
3330 E. Bayshore Road, Ste. 1002
Palo Alto, CA 94303
rtmengineering.com | 917.584.3930

Walmart
CAMDEN, SC
STORE NO: 00634-236
19520111 | PROTO: | 172 PROTO SC
2020 GENERAL REMODEL
JOB NUMBER:

ISSUE BLOCK

CHECKED BY:	JEE
DRAWN BY:	TJP
PROTO CYCLE	10/25/19
DOCUMENT DATE:	12/18/19

NOT FOR CONSTRUCTION

LIGHTING PLAN

SHEET: E1