KEYNOTES

16.125	EXISTING LIGHT FIXTURES TO REMAIN UNLESS NOTED OTHERWISE.
16.126	EXISTING LIGHT FIXTURE TO BE DEMOLISHED.
16.129	CONNECT TO EXISTING CIRCUIT PREVIOUSLY SERVING AREA LIGHTING THAT WAS REMOVED. MAINTAIN EXISTING CIRCUIT CONTROL UNLESS NOTED OTHERWISE. PROVIDE CONSTANT HOT FOR EMERGENCY EXIT AND LOCALLY CONTROLLED LIGHT FIXTURES.
16.131	CONNECT TO EXISTING CIRCUIT.

CONTRACTOR IS RESPONSIBLE FOR THE COMPLETE INSTALLATION OF THE LIGHTING SYSTEM AS INDICATED ON PLANS AND/OR AS MODIFIED TO ACCOMMODATE EXISTING OBSTRUCTIONS. IDENTIFY CONFLICTS PRIOR TO ROUGH-IN. WHERE CONFLICTS WITH EXISTING UTILITIES OCCUR ADJUST FIXTURE LOCATION AS REQUIRED. FIXTURES SHALL BE INSTALLED AS NEAR AS POSSIBLE TO LOCATIONS INDICATED ON PLANS WITH EVEN SPACING MAINTAINED

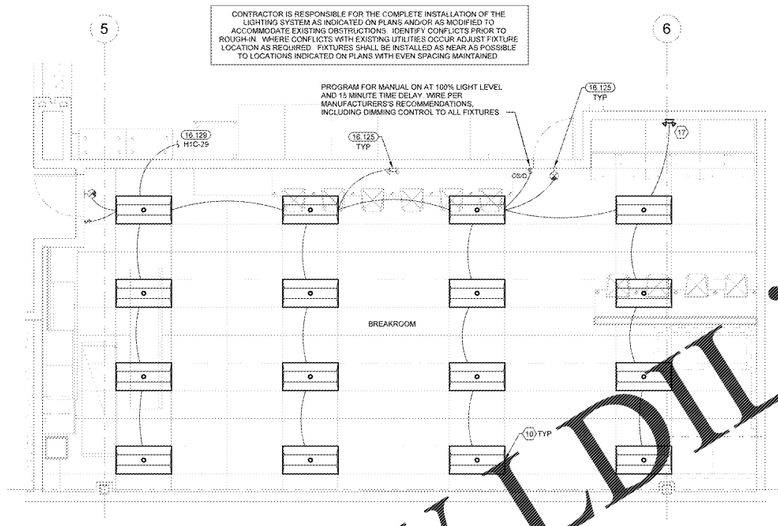

6 BREAKROOM LIGHTING PLAN
1/4" = 1'-0"

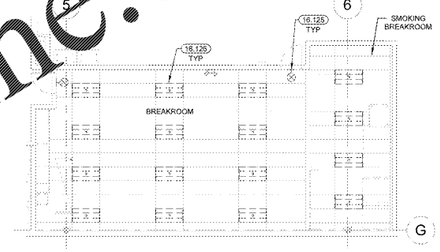

5 BREAKROOM LIGHTING DEMO PLAN
1/8" = 1'-0"

PROVIDE STAINLESS STEEL COVER PLATES TYP IN RESTROOMS

COORDINATE RESTROOM LIGHT FIXTURE LOCATIONS WITH CEILING STRUCTURE, DUCT WORK DIFFUSERS, SPRINKLERS AND GC. LIGHTING LAYOUT ADJUSTMENTS SHALL BE KEPT TO A MINIMUM. MAINTAIN LAYOUT AS CLOSELY AS POSSIBLE

REMOVE RESTROOM NEEDS CLEANING LIGHT SWITCHES TYPICAL AT RESTROOMS. PROVIDE STAINLESS STEEL BLANK COVER PLATE WITH TAMPER RESISTANT SCREWS AT OUTLETS.

EXISTING LIGHTING (NOT SHOWN) SHALL REMAIN.

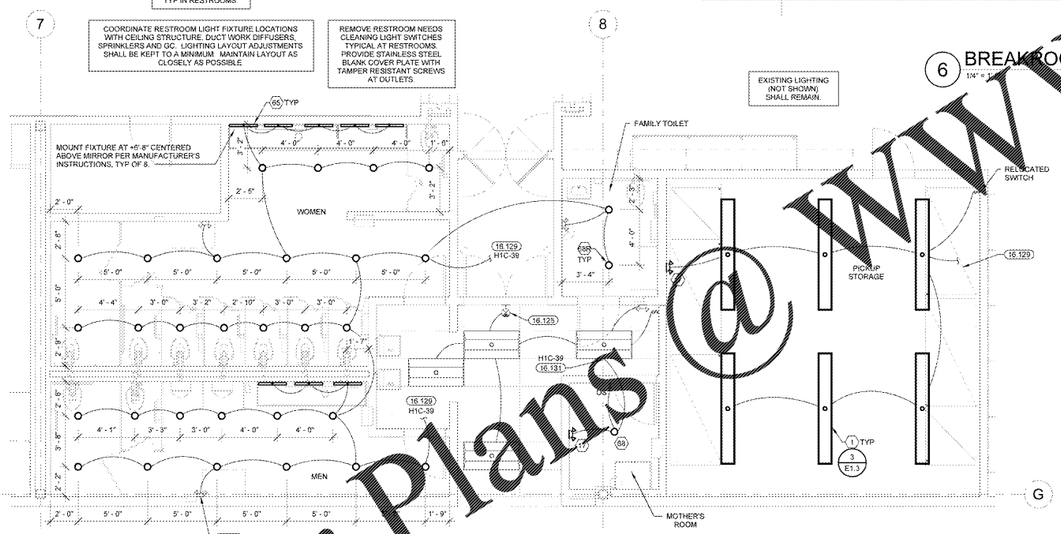

4 REAR RESTROOM LIGHTING PLAN
1/4" = 1'-0"

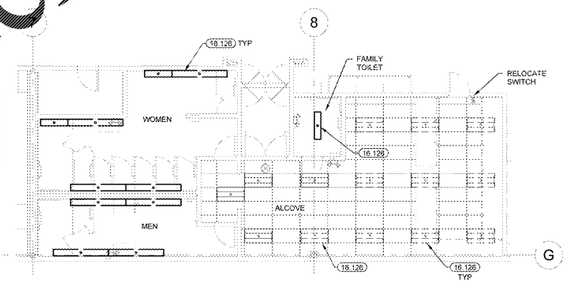

REMOVE RESTROOM NEEDS CLEANING LIGHT SWITCHES TYPICAL AT RESTROOM. PROVIDE STAINLESS STEEL BLANK COVER PLATE WITH TAMPER RESISTANT SCREWS AT OUTLETS. REMOVE RESTROOM NEEDS CLEANING SIGN FROM COURTESY DESK/CUSTOMER SERVICE/SITE TO STORE AREA(S). COORDINATE CEILING TILE REPLACEMENT WITH GC. IF WALL MOUNTED FIXTURE, PROVIDE COVER PLATE TO MATCH EXISTING ELECTRICAL DEVICES.

3 REAR RESTROOM LIGHTING DEMO PLAN
1/8" = 1'-0"

COORDINATE RESTROOM LIGHT FIXTURE LOCATIONS WITH CEILING STRUCTURE, DUCT WORK DIFFUSERS, SPRINKLERS AND GC. LIGHTING LAYOUT ADJUSTMENTS SHALL BE KEPT TO A MINIMUM. MAINTAIN LAYOUT AS CLOSELY AS POSSIBLE.

PROVIDE STAINLESS STEEL COVER PLATES TYP IN RESTROOMS

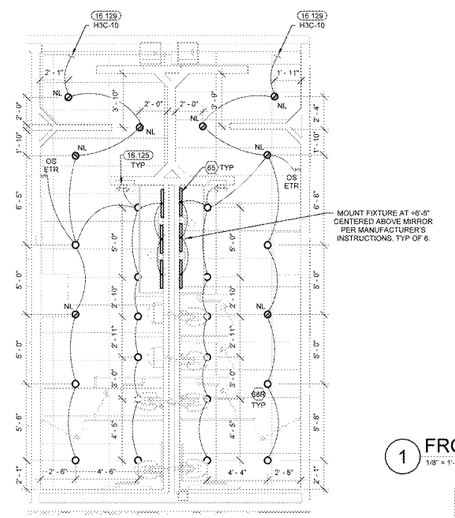

2 FRONT RESTROOM LIGHTING PLAN
1/4" = 1'-0"

REMOVE RESTROOM NEEDS CLEANING LIGHT SWITCHES TYPICAL AT RESTROOM. PROVIDE STAINLESS STEEL BLANK COVER PLATE WITH TAMPER RESISTANT SCREWS AT OUTLETS. REMOVE RESTROOM NEEDS CLEANING SIGN FROM COURTESY DESK/CUSTOMER SERVICE/SITE TO STORE AREA(S). COORDINATE CEILING TILE REPLACEMENT WITH GC. IF WALL MOUNTED FIXTURE, PROVIDE COVER PLATE TO MATCH EXISTING ELECTRICAL DEVICES.



1 FRONT RESTROOM LIGHTING DEMO PLAN
1/8" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

Order Plans @ WWW.LDILine.com

STIPULATION FOR REUSE

THESE DRAWINGS AND PERFORMANCES OF WORK EMBODIED IN THESE DRAWINGS ARE AND SHALL REMAIN THE PROPERTY OF RTM ENGINEERING CONSULTANTS. THEY ARE NOT TO BE USED IN WHOLE OR IN PART FOR ANY PROJECT OTHER THAN THE PROJECT FOR WHICH THEY WERE PREPARED AND DEVELOPED UNLESS SPECIFICALLY AUTHORIZED BY RTM ENGINEERING CONSULTANTS. VISUAL CONTACT WITH THESE DRAWINGS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS. ANY UNAUTHORIZED USE MAY BE CONSIDERED TO BE IN VIOLATION OF COPYRIGHT LAWS.

CONSULTANTS

rtm engineering consultants
3333 E. Battlefield Road, Ste. 1502
Springfield, MO 65804
rtmengineering.com | 417.881.3020

Walmart

CAMDEN, SC
STORE NO.: 00634-236

JOB NUMBER:	15620111
PROTO:	172 PROTO SC

2020 GENERAL REMODEL

ISSUE BLOCK

CHECKED BY:	JEE
DRAWN BY:	TJP
PROTO CYCLE	10/25/19
DOCUMENT DATE	12/18/19

NOT FOR CONSTRUCTION

ENLARGED LIGHTING PLANS

SHEET
E1.1