

KEYNOTES

- 16.125 EXISTING LIGHT FIXTURES TO REMAIN UNLESS NOTED OTHERWISE.
- 16.131 CONNECT TO EXISTING CIRCUIT.
- 16.145 CONNECT CIRCUITS TO EXISTING BRANCH CIRCUITRY. MINIMUM WIRE SIZE AND PANELBOARD CIRCUIT ARE NOTED. VERIFY SIZE, RATING AND CONDITION OF EXISTING BRANCH CIRCUIT CONDUIT AND WIRE PRIOR TO USE TO ENSURE THEY MEET REQUIRED SIZE AND ALL U.L. RATINGS AND REPLACE AS REQUIRED.
- 16.410A COUNTER MOUNTED DEVICES: ROUTE BRANCH CIRCUITRY AND VOICE/DATA CABLING THROUGH OWNER FURNISHED BLANK POWER POLE ROUTE FLEXIBLE METAL CONDUITS ALONG BACK WALL OF CABINET. MOUNT DEVICES WITHIN CABINET AT "8". EACH DATA BOX IS TO HAVE A SEPARATE CONDUIT ROUTED TO POWER POLE. VERIFY ALL DEVICE LOCATIONS WITH STORE PLANNING SETUP SUPERVISOR PRIOR TO ROUGH-IN.
- 16.410B COUNTER MOUNTED DEVICES: ROUTE BRANCH CIRCUITRY THROUGH OWNER FURNISHED BLANK POWER POLE. ROUTE FLEXIBLE METAL CONDUITS ALONG INSIDE BACK WALL OF CABINET.
- 16.410C WATER HEATERS: A. DISCONNECT EXISTING AND RECONNECT TO WATER HEATERS. COORDINATE WITH MECHANICAL CONTRACTOR. B. PULL AND INSTALL HANDLE LOCKS (LOCK OFF) FOR ALL CIRCUIT BREAKERS FEEDING WATER HEATERS.
- 16.470 FURNISH AND INSTALL NEW 20 AMP, 120 VOLT (CIRCUITS) FEED FROM PANELBOARD AS INDICATED. PROVIDE 20A-1P 50A GFCI CIRCUIT BREAKER FOR PERSONNEL PROTECTION. E.C. SHALL MATCH MANUFACTURER, TYPE AND AIC RATINGS OF EXISTING CIRCUIT BREAKERS.
- 16.475 FURNISH AND INSTALL NEW 20 AMP, 120 VOLT (CIRCUITS) FEED FROM PANELBOARD AS INDICATED. PROVIDE 20A-1P 50A GFCI CIRCUIT BREAKER FOR PERSONNEL PROTECTION. E.C. SHALL MATCH MANUFACTURER, TYPE AND AIC RATINGS OF EXISTING CIRCUIT BREAKERS.
- 16.508 INSECT CONTROL. PROVIDE BROWN DEVICE AND MATCHING COVERPLATE.
- 16.619 PROVIDE RECESSED ALARM JUNCTION BOX IN CEILING WITH 4"x4"x1-1/2" EXTENSION RING WITH RACEWAY ROUTED TO NEAREST ACCESSIBLE CEILING SPACE.
- 16.775 E.C. SHALL DISCONNECT, EXTEND, AND RECONNECT ALL ELECTRICAL CIRCUITRY FOR NEW OR RELOCATED EQUIPMENT. REFER TO POWER PLANS AS APPLICABLE. VERIFY CONDITION OF BRANCH CIRCUIT. CONDUIT AND WIRE PRIOR TO USE TO ENSURE THEY MEET ALL U.L. RATINGS AND REPLACE AS REQUIRED. COORDINATE THIS PROCESS WITH CONSTRUCTION MANAGER TO MINIMIZE DOWNTIME. LABEL ALL ASSOCIATED PANELBOARD SCHEDULES TO REFLECT LOAD DESCRIPTIONS.

STIPULATION FOR REUSE OF DRAWINGS: THIS DRAWING IS THE PROPERTY OF WILSON JONES ARCHITECTS, P.C. IT IS TO BE USED ONLY FOR THE PROJECT AND AT THE LOCATION SPECIFICALLY IDENTIFIED HEREON. IT IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT PERMISSION IN WRITING FROM WILSON JONES ARCHITECTS, P.C. DATE: 08/24/2011

artm
ARCHITECTURAL RENDERING
 CONSULTANTS
 3301 E. BRIDGEMOUNTAIN BLVD.
 SUITE 200
 MESA, ARIZONA 85205

Walmart*
CAMDEN, SC
STORE NO. 0834-236
 PROJECT NO. 160111100
 PROJECT DATE: 08/24/2011
 JOB NUMBER: 172 PROJ/SC

2020 GENERAL REMODEL

ISSUE BLOCK


NO.	DATE	DESCRIPTION

CHECKED BY: JEE
 DRAWN BY: TJP
 PROTO CYCLE: 10/25/19
 DOCUMENT DATE: 12/18/19


NOT FOR CONSTRUCTION

ENLARGED POWER PLANS


E2.2

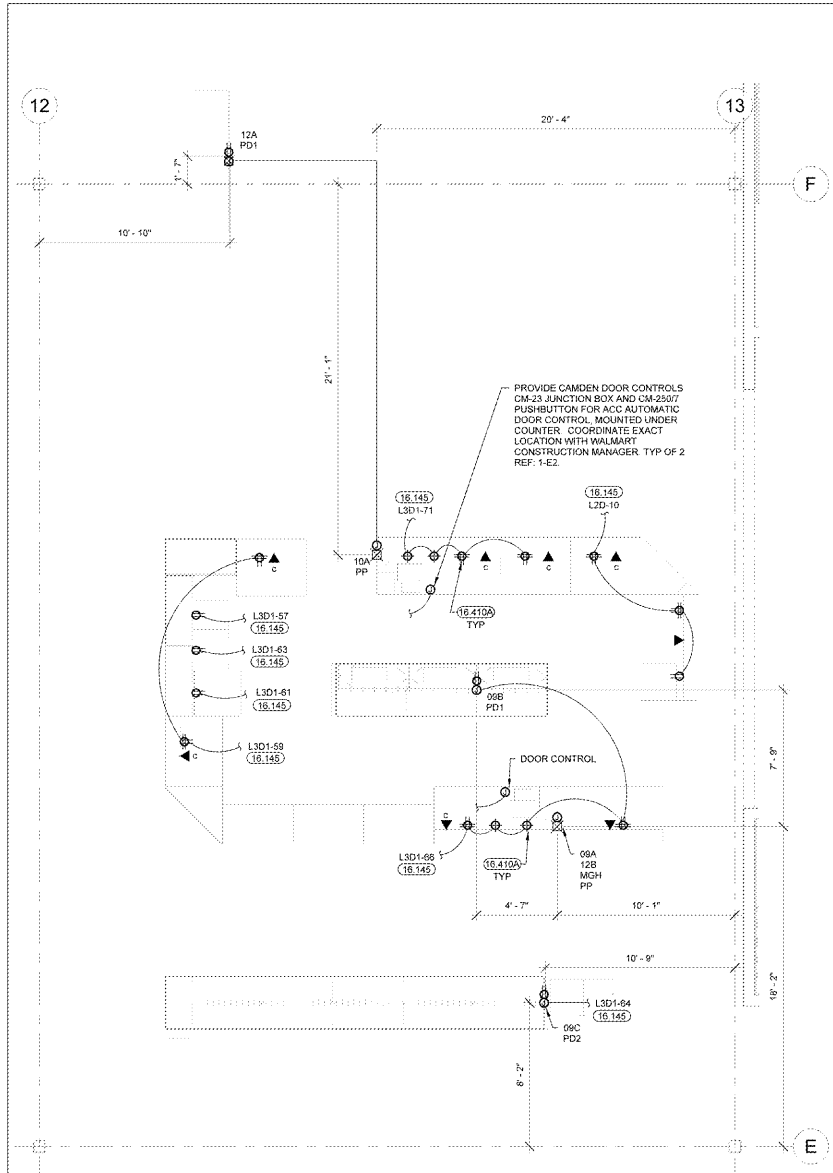


5 ACC/PAINT/SPORTING GOODS POWER PLAN
 1/4" = 1'-0"

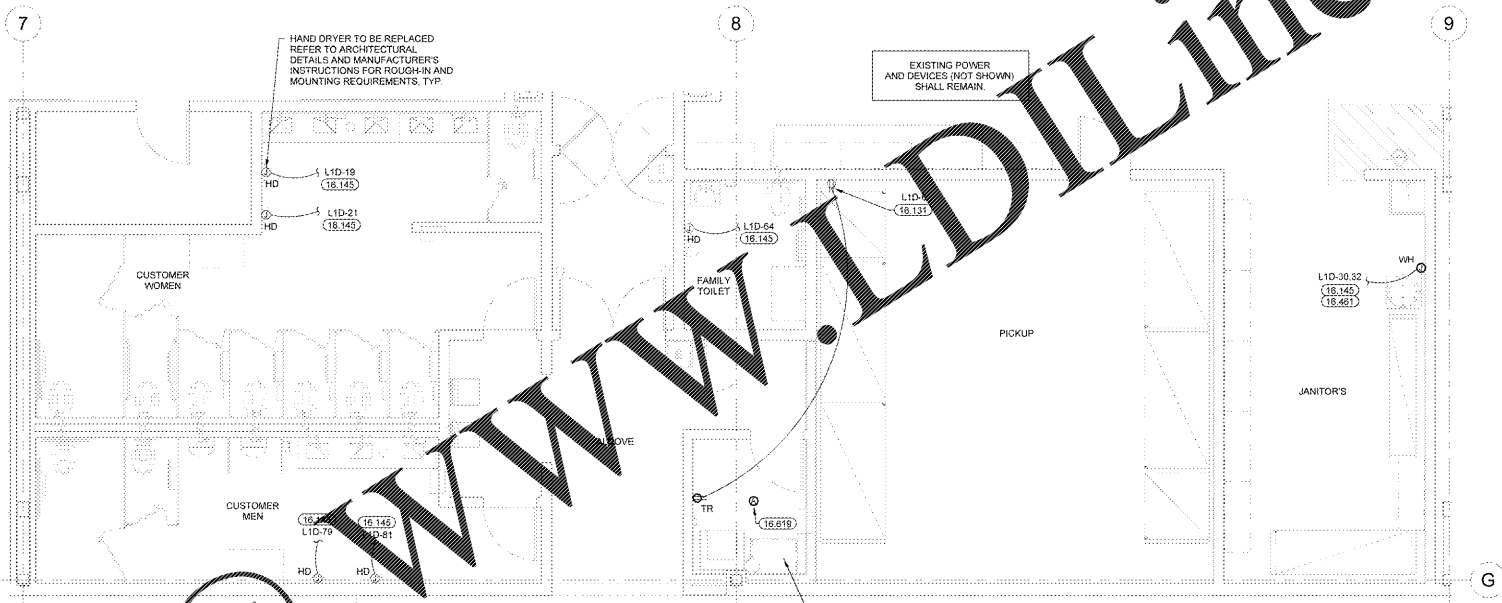


6 CUSTOMER SERVICE POWER PLAN
 1/8" = 1'-0"

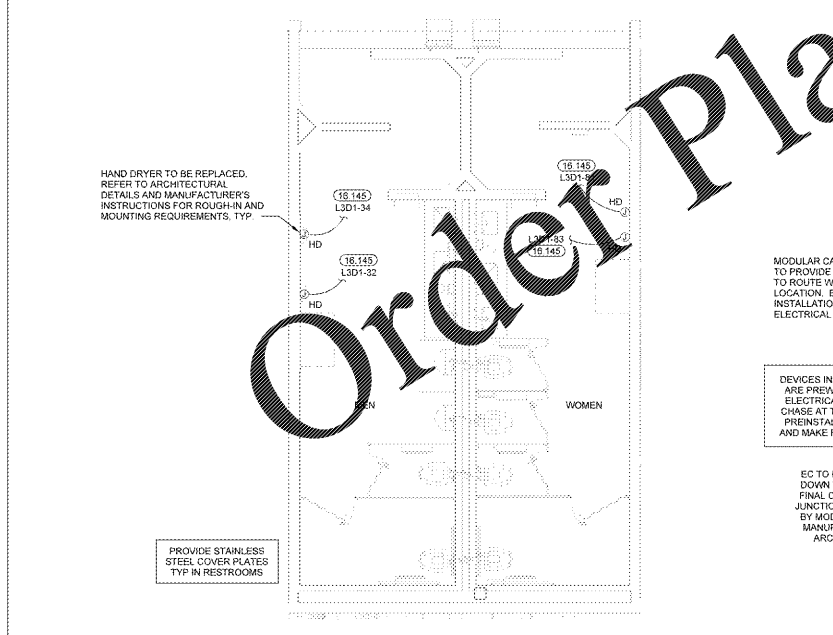

5 FRONT RESTROOM POWER PLAN
 1/4" = 1'-0"

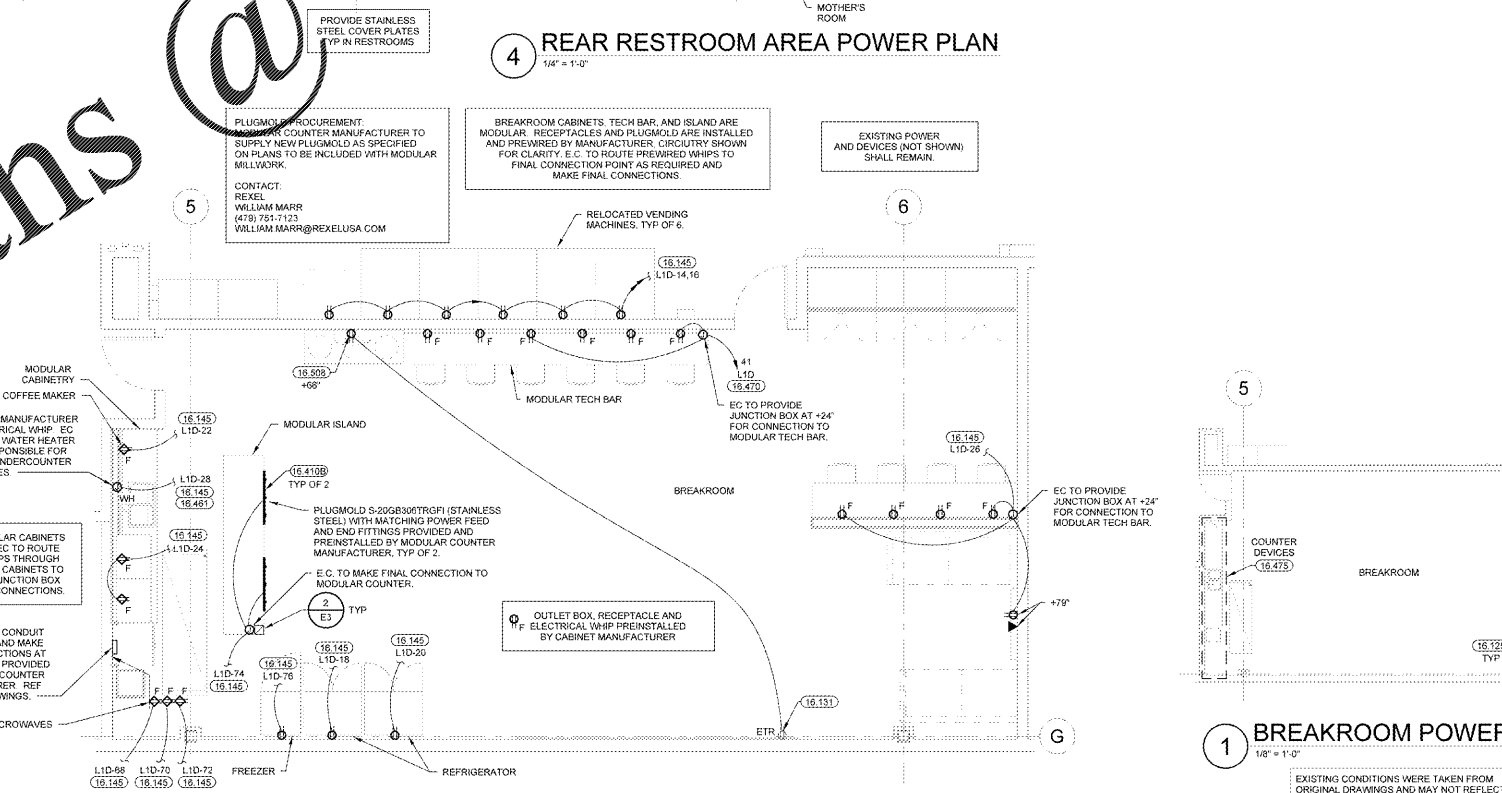

4 REAR RESTROOM AREA POWER PLAN
 1/4" = 1'-0"

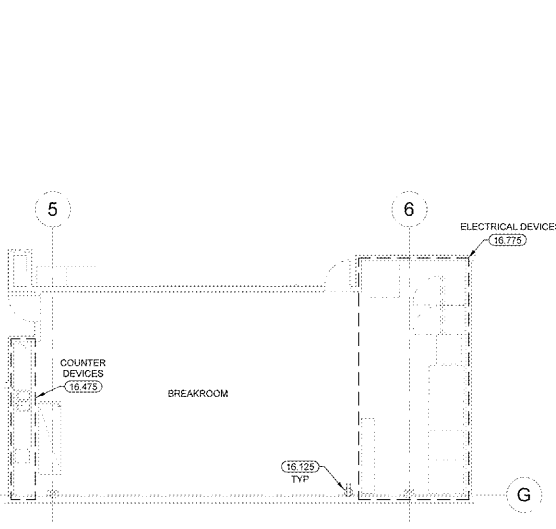

1 BREAKROOM POWER DEMO PLAN
 1/8" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACCURATELY IDENTIFY THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.