

KEYNOTES

1. STUB UP ELECTRICAL FOR RTU INSIDE UNIT CURB AND CONNECT UNIT AT DISCONNECT. CONNECT DUCT SMOKE DETECTOR. REFER TO MECHANICAL EQUIPMENT CONNECTION SCHEDULE FOR RTU CONNECTION REQUIREMENTS. DISCONNECT AND GFCI RECEPTACLE ARE FACTORY INSTALLED AND SHALL BE FIELD WIRED.
2. EXHAUST FAN WITH FACTORY INSTALLED DISCONNECT. ELECTRICAL CONTRACTOR TO PROVIDE CIRCUITRY TO DISCONNECT.
3. EQUIPMENT DISCONNECT SWITCHES SHALL BE SUPPLIED AND PRE-WIRED FOR CONNECTION TO COOLER/FREEZER/STORAGE PACKAGE. E.C. SHALL MAKE ALL FINAL CONNECTIONS.
4. PROVIDE ALL INTERLOCKING BETWEEN EVAPORATOR AND CONDENSER FOR A COMPLETE AND OPERATIONAL SYSTEM AS REQUIRED.
5. PROVIDE CIRCUITRY FOR ELECTRIC DEFROST FROM CONDENSING UNIT TO FREEZER EVAPORATORS. REFERENCE POWER PLAN FOR CIRCUIT REQUIREMENTS.
6. REFER TO MANUFACTURER'S REQUIREMENTS FOR ICE MACHINE WIRING. CONNECT TO INTERIOR EQUIPMENT.
7. E.C. SHALL MAKE CONNECTIONS BETWEEN THE OUTDOOR UNIT (HP-01) AND THE INDOOR UNIT (DFC-01) OF THE MINI-SPLIT SYSTEMS.

HFA
Creative Solution Meaningful Place
HARRISON FRENCH & ASSOCIATES
 ARCHITECTS & ENGINEERS
 1705 S. Walton Blvd., Suite 3
 Bentonville, Arkansas 72712
 t 479.273.7780
 f 888.520.9685
 www.hfa-se.com

STIPULATION FOR REUSE
 THIS DRAWING IS PROVIDED FOR USE ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED. IT IS NOT TO BE REPRODUCED, COPIED, REUSED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF THE ORIGINAL AUTHOR. ANY REUSE OF THIS DRAWING FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF THE ORIGINAL AUTHOR IS STRICTLY PROHIBITED.

1911 HWY 34 W
 DILLON, SC 29536
 FRESH KITCHEN LITE REMODEL/
 SHOWER & LAUNDRY ADDITION/
 FREEZER, COOLER & STORAGE
 ADDITION
 PROJECT NUMBER: 03-18-0371

Loves
Travel Stop & Country Stores


HARRISON FRENCH & ASSOCIATES, LTD
 No. C03060
 SOUTH CAROLINA PROFESSIONAL ENGINEER
 No. 35952
 NATHAN K. CONNORS
 JAN 02 2020

ISSUE BLOCK

STORE NO. 371
 DOCUMENT DATE: 01/03/20
 CHECKED BY: NKC
 DRAWN BY: CAR
 PROTO CYCLE:

ROOF PLAN

SHEET: **E5**

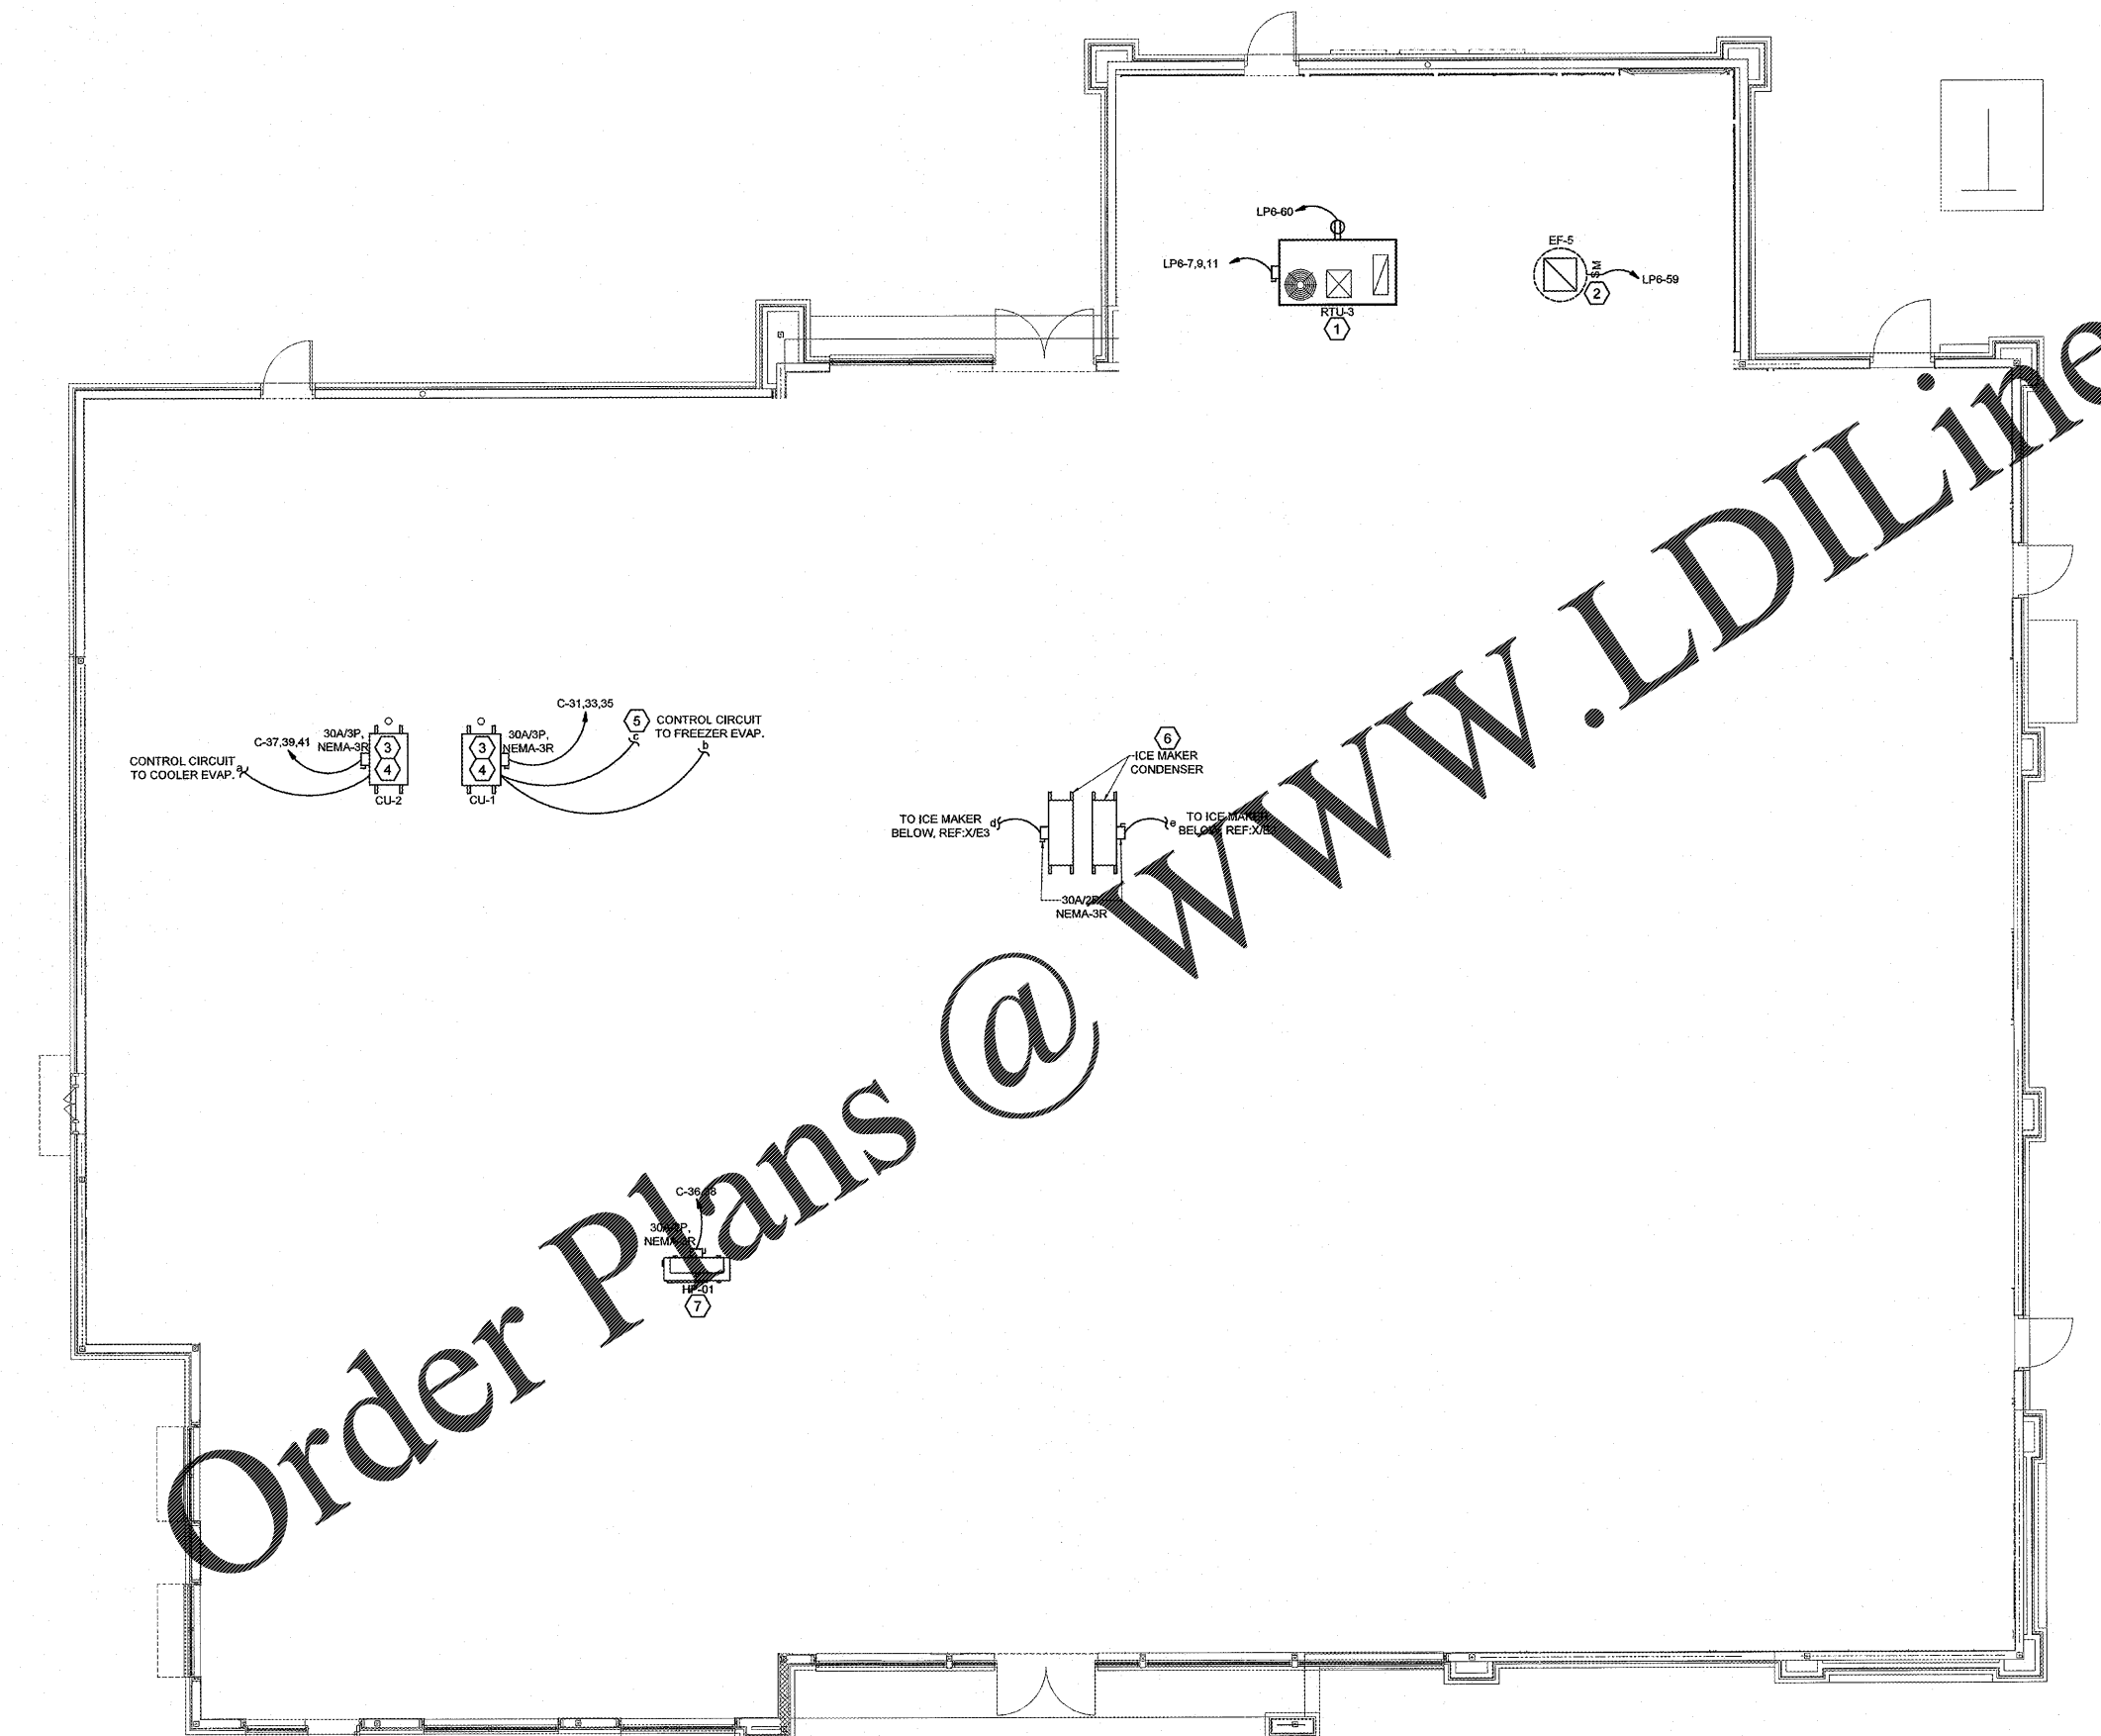

Order Plans @ www.LDILine.com

1 ROOF POWER PLAN
 SCALE: 3/16" = 1'-0"

COORDINATE THE EXTENT OF ALL REQUIRED ELECTRICAL DEMOLITION WITH CONSTRUCTION MANAGER

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT HIMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING HIS WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

1/10/2020 10:49:20am - User: rfr, Job: 03711, Sheet: E5, Project: 03-18-0371, Path: L:\0302-18-0371 Loves - Dillon, SC\3711CONDOS MEPR\400 ES ROOF PLAN.dwg