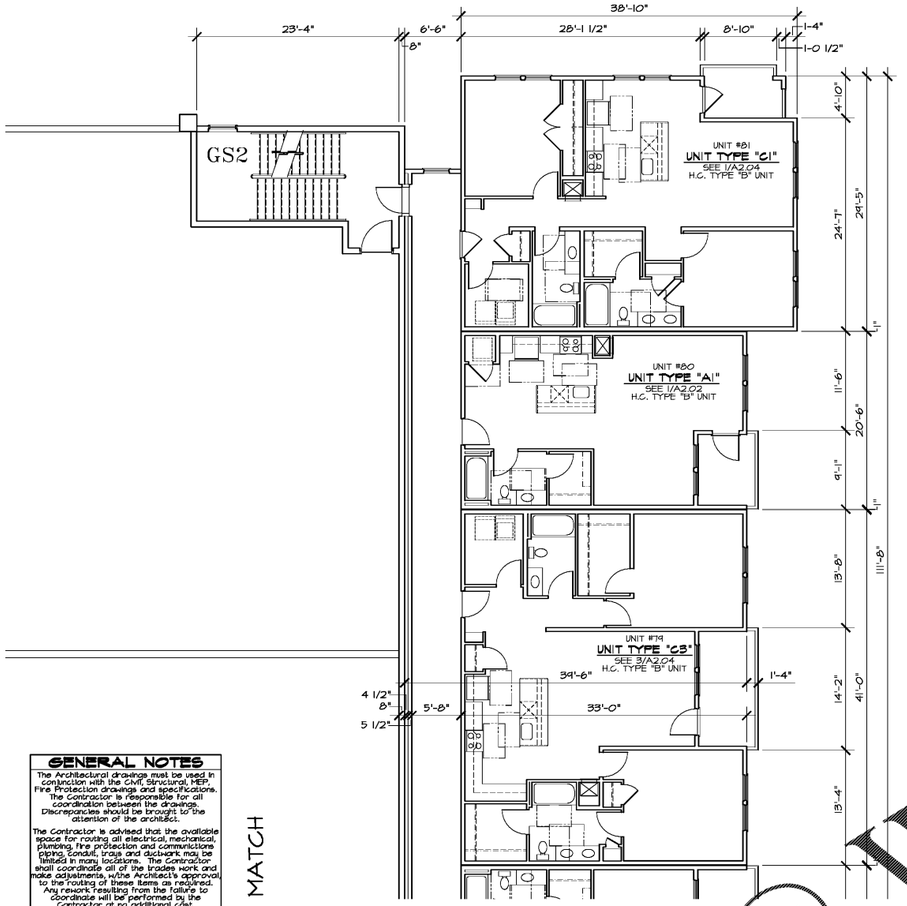

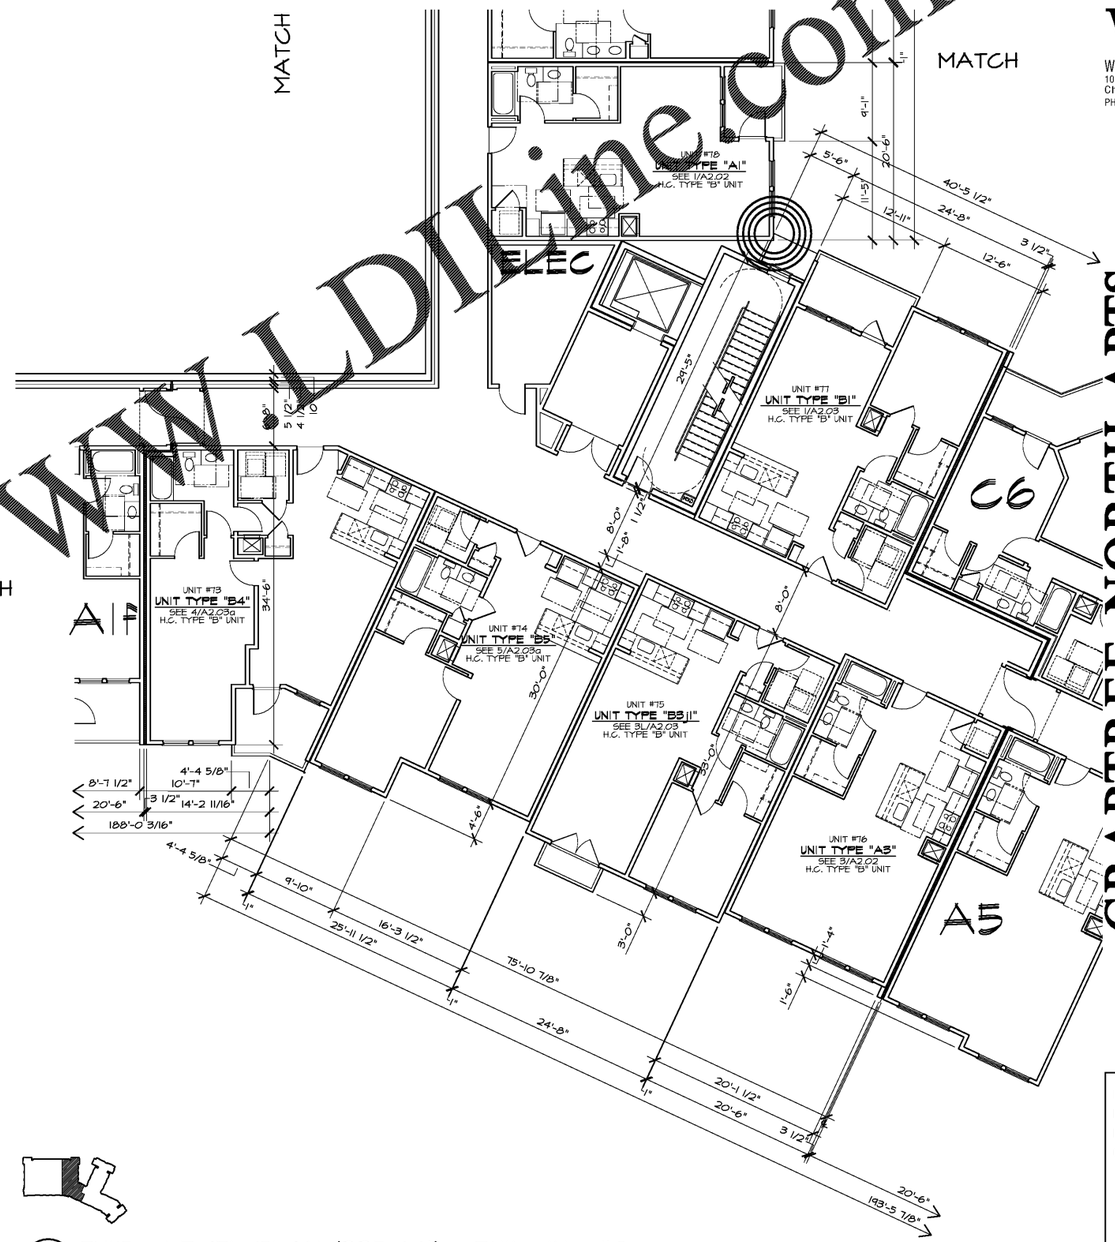

GENERAL NOTES

The Architectural drawings must be used in conjunction with the Civil, Structural, MEP, Fire Protection drawings and specifications. The Contractor is responsible for all coordination between the drawings. Discrepancies should be brought to the attention of the architect.

The Contractor is advised that the available space for routing all electrical, mechanical, plumbing, fire protection and communications piping, conduit, trays and duct-work may be limited in many locations. The Contractor shall coordinate all of the trades work and make adjustments, w/the Architect's approval, to the routing of these items as required. Any rework resulting from the failure to coordinate will be performed by the Contractor at no additional cost.

All dimensions are from face of stud, u.n.o.

All penetrations of fire rated assemblies shall be fire blocked and sealed per UL approved methods.

All concealed fire rated assemblies shall be provided with signage indicating the type of assembly and the fire rating in hours in letters no smaller than 2" high. See 721.2.

FIRE RATING LEGEND

THREE HOUR RATED ASSEMBLIES:

3 HOUR RATED FIRE WALL
3FW 3FW 3FW

GA ASH 28-00 3-HR FIREWALL SEPARATING TYPE-2A FIRE AREA - NCSBC 721.2.11

3 HOUR RATED CONCRETE SLABS
SEE N.C.S.B.C. SECTION 721.(1)
SLABS BETWEEN STORAGE LEVEL AND APT. UNITS ABOVE (BUILDING #2 ONLY)

3 HOUR RATED CONCRETE COLUMNS
SEE N.C.S.B.C. SECTION 721.(1)
COLUMNS SUPPORTING 3 HOUR RATED SLABS

TWO HOUR RATED ASSEMBLIES:

2 HOUR RATED FIRE WALL
2FW 2FW 2FW

UL U-210 2-HR FIREWALL SEPARATING TYPE-5A FIRE AREA

2 HOUR RATED FIRE BARRIER
2FB 2FB 2FB

UL05 - ELEVATOR AND STAIR & MECH. SHAFTS

2 HOUR RATED CEILINGS
GA FILE NO. FC 5725

2 HOUR RATED CONCRETE SLABS
SEE N.C.S.B.C. SECTION 721.(1)
SLAB BETWEEN CLUBHOUSE AND APT. UNITS ABOVE (BUILDING #2 ONLY)

2 HOUR RATED CONCRETE COLUMNS
SEE N.C.S.B.C. TABLE 721.(1)
COLUMNS SUPPORTING 2 HOUR RATED SLABS

ONE HOUR RATED ASSEMBLIES:

1 HOUR RATED FIRE BARRIER
1FB 1FB

UL U-305 1-HR FIRE BARRIER ADJACENT TO ENCLOSED GARAGE WALLS

1 HOUR RATED FIRE PARTITION
1FP 1FP 1FP
ddi ddi ddi

UL U-341 1-HR TENANT SEPARATION WALLS

UL U-305 1-HR CORRIDOR WALLS - BUILT TO ACHIEVE STC50 RATING PER REQS. LISTED IN UL, INCL. FURRING CHANNELS/CLIPS ON CORRIDOR SIDE OF ASSEMBLY. GSB PANELS TO BE PLACED BETWEEN STUD ENDS AND CLIPS AT SHEAR WALL LOCATIONS, COORDINATE WITH THE STRUCTURAL

1 HOUR RATED STRUCTURAL AND NON-STRUCTURAL ELEMENTS
1HR 1HR 1HR

UL U-356 1-HR RATED EXTERIOR BEARING WALL

UL U-305 1-HR RATED UNIT INTERIOR BEARING WALL AND ELEVATOR LOBBIES

1-HR RATED ROOF/CEILING ASSEMBLY, SEE A0.1T GYPSUM ASSOCIATION FILE NO. RC 2603

UL L-528 1-HR RATED FLOOR/CEILING ASSEMBLY

1 A4.19 THIRD LEVEL PLAN (335.44') - BUILDING #2

1/8" = 1'-0"

Order Plans @ WWW.LDLine.com

WLA
WATTS LEAF ARCHITECTS, PA
101 North McDowell Street Suite 112
Charlotte, North Carolina 28204
PH 704 376 1200 FX 704 376 5111

CRABTREE NORTH APTS.

2251 Charles Drive
Raleigh, North Carolina
EYC COMPANIES

PROJECT	1915
DATE	02JAN20
DRAWN BY	WJP
CHECKED BY	CMW

THIRD LEVEL PLAN - BUILDING #2

A4.19