


Order Plans @

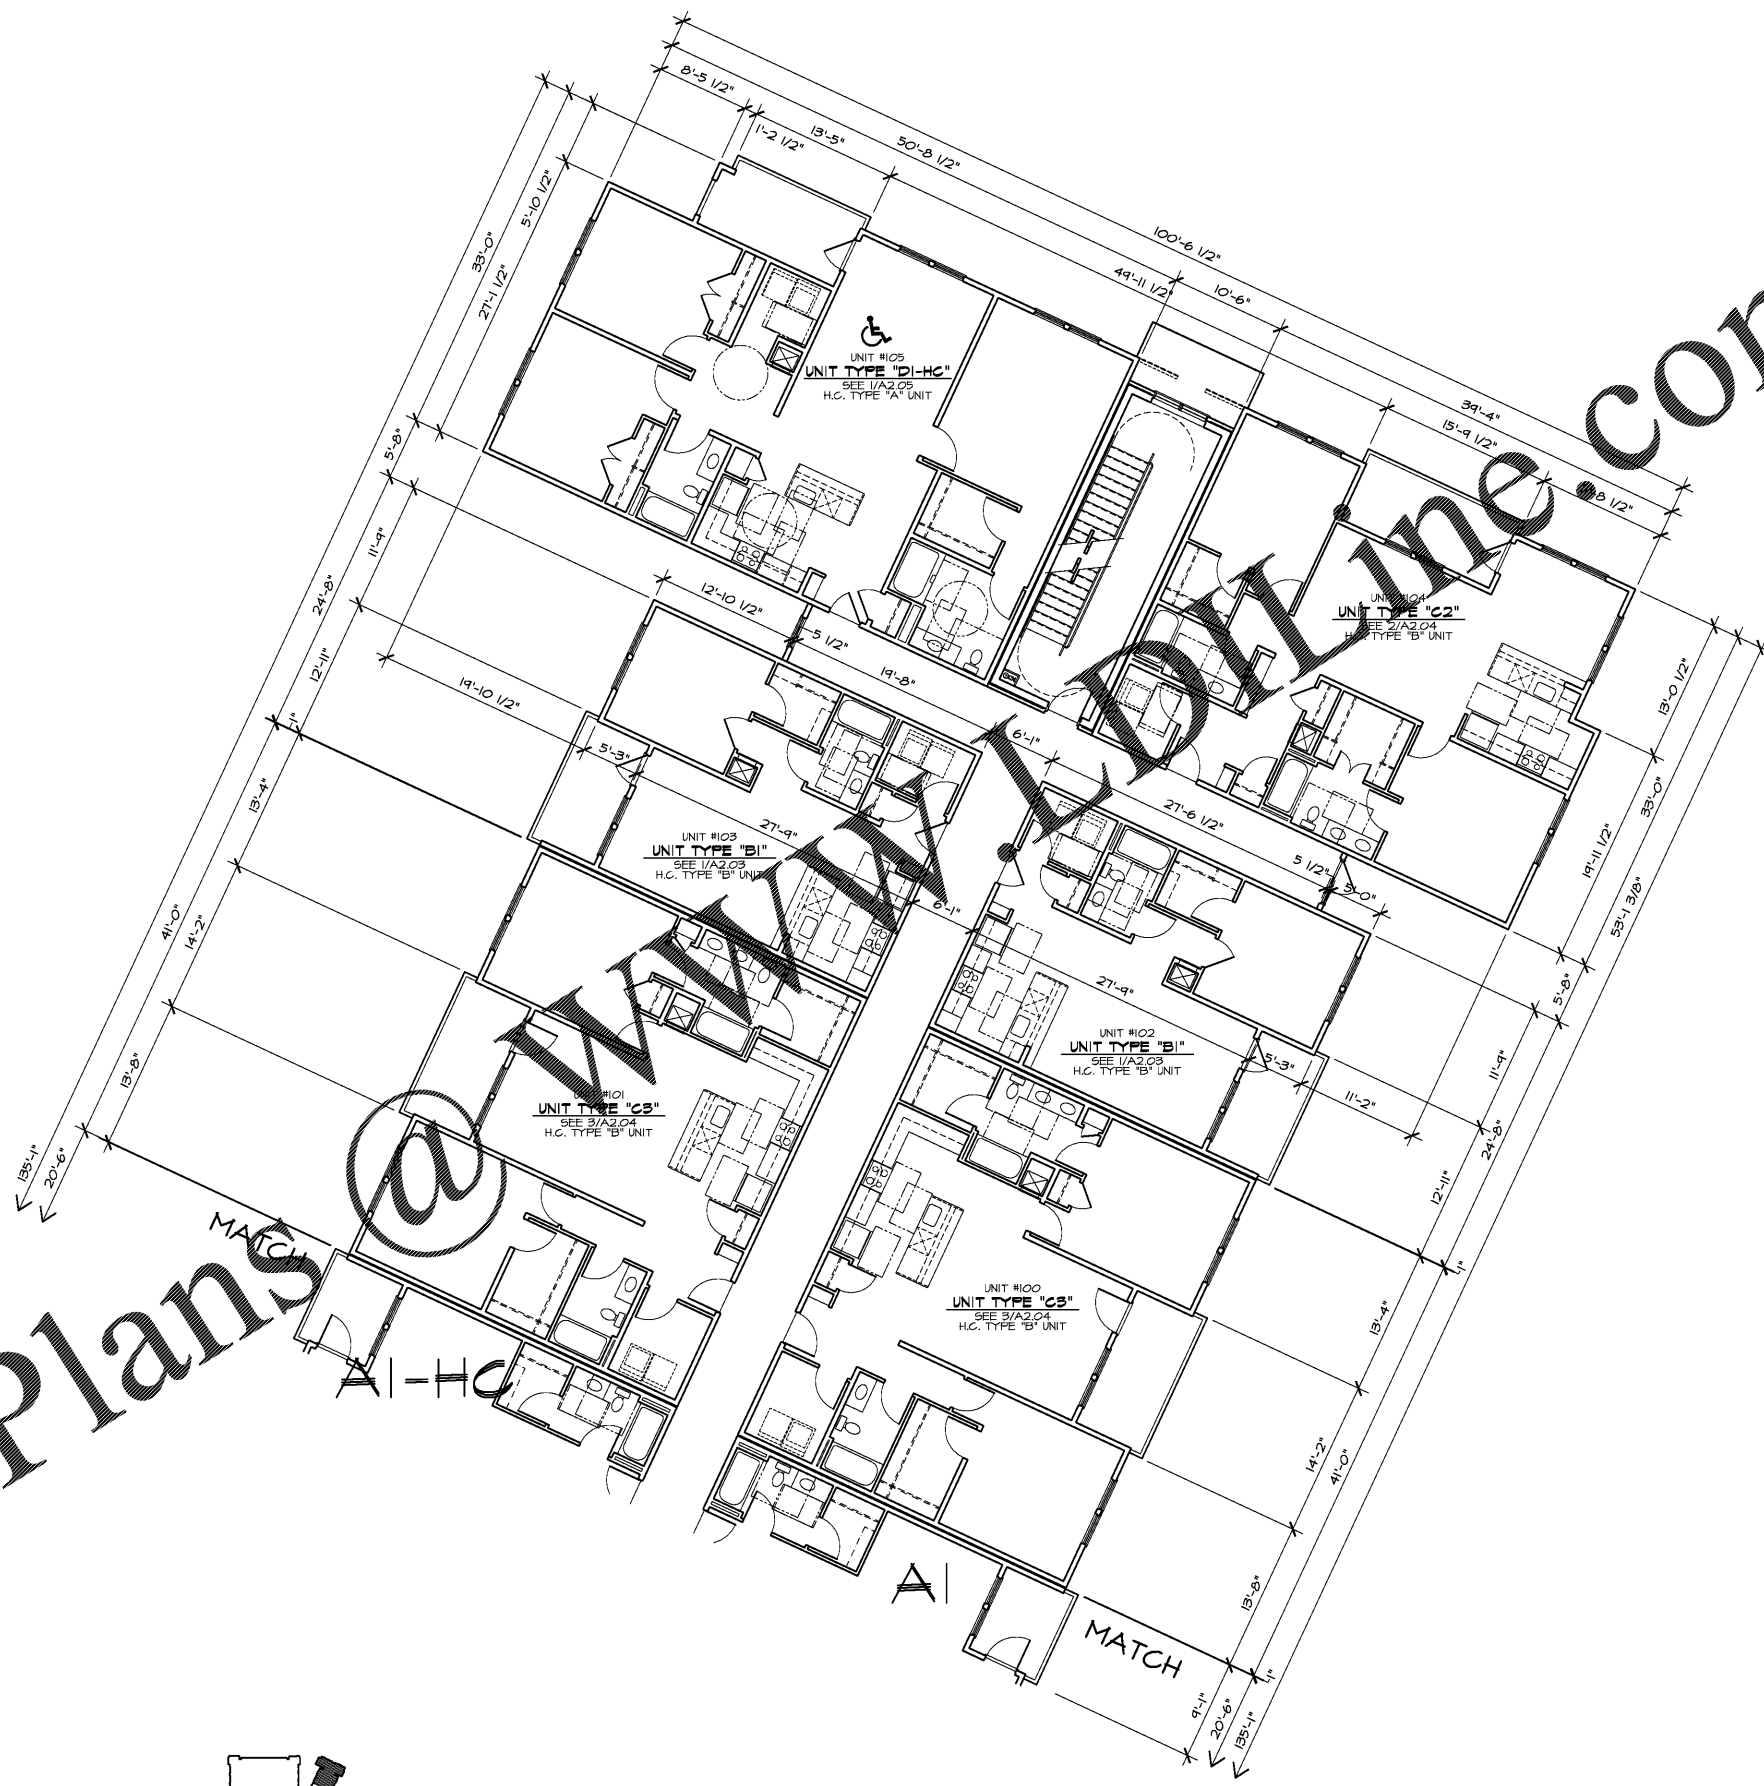

GENERAL NOTES

The Architectural drawings must be used in conjunction with the Civil, Structural, MEP, Fire Protection drawings and specifications. The Contractor is responsible for all coordination between the drawings. Discrepancies should be brought to the attention of the architect.

The Contractor is advised that the available space for routing all electrical, mechanical, plumbing, fire protection and communications piping, conduits, trays and ductwork may be limited in many locations. The Contractor shall coordinate all of the trades work and make adjustments, with the Architect's approval to the routing of these items as required. Any rework resulting from the failure to coordinate will be performed by the Contractor at no additional cost.

All dimensions are from face of stud, u.n.o.

All penetrations of fire rated assemblies shall be fire blocked and sealed per UL approved methods.


All concealed fire rated assemblies shall be provided with signage indicating the type of assembly and the fire rating if hours in letters no smaller than 2" high. See 701.2.

FIRE RATINGS LEGEND

THREE HOUR RATED ASSEMBLIES:	THREE HOUR RATED FIRE WALL	3FW	3FW
6A ASH 2600 3-HR FIREHALL SEPARATING TYPE 5A FIRE AREA	NC50C 121.1		
3 HOUR RATED CONCRETE SLABS	SEE NC5.B.C. SECTION 121.0		
SLABS BETWEEN STORAGE LEVEL AND APT. UNITS ABOVE BUILDING #2 ONLY			
3 HOUR RATED CONCRETE COLUMNS	SEE NC5.B.C. SECTION 121.0		
COLUMNS SUPPORTING 3 HOUR RATED SLABS			
TWO HOUR RATED ASSEMBLIES:	TWO HOUR RATED FIRE WALL	2FW	2FW
UL U-210 2-HR FIREHALL SEPARATING TYPE 5A FIRE AREA			
2 HOUR RATED FIRE BARRIER	2FB	2FB	
UL105 - ELEVATOR AND STAIR & MECH. SHAFTS			
2 HOUR RATED CEILING	2FC	2FC	
6A FILE NO. FC 5122			
2 HOUR RATED CONCRETE SLABS	SEE NC5.B.C. SECTION 121.0		
SLAB BETWEEN GARAGEHOUSE AND APT. UNITS ABOVE BUILDING #2 ONLY			
2 HOUR RATED CONCRETE COLUMNS	SEE NC5.B.C. TABLE 121.0		
COLUMNS SUPPORTING 2 HOUR RATED SLABS			
ONE HOUR RATED ASSEMBLIES:	ONE HOUR RATED FIRE BARRIER	1FB	1FB
UL U-305 1-HR FIRE BARRIER ADJACENT TO ENCLOSED GARAGE HALLS			
1 HOUR RATED FIRE PARTITION	1FP	1FP	
UL U-541 1-HR TENANT SEPARATION WALLS			
UL U-305 1-HR CORRIDOR WALLS - BUILT TO ACHIEVE STC60 RATING PER REQS. LISTED IN UL INC. FURNISH CHANNELS/CLIPS ON CORRIDOR SIDE OF ASSEMBLY. OSB PANELS TO BE PLACED BETWEEN STUD ENDS AND GLIPS AT BEAR WALL LOCATIONS. COORDINATE WITH THE STRUCTURAL			
1 HOUR RATED STRUCTURAL AND NON-STRUCTURAL ELEMENTS	1HR	1HR	
UL U-356 1-HR RATED EXTERIOR BEARING WALL			
UL U-305 1-HR RATED INT. INTERIOR BEARING WALL AND ELEVATOR LOBBIES			
1-HR RATED ROOF/GELING ASSEMBLY, SEE A011 BYPSM ASSOCIATION FILE NO. RC 2609			
UL L-528 1-HR RATED FLOOR/GELING ASSEMBLY			

WLA
 WATTS LEAF ARCHITECTS, PA
 101 North McDowell Street, Suite 112
 Charlotte, North Carolina 28204
 PH 704 376 1200 FX 704 376 5111

CRABTREE NORTH APTS.
 2251 Charles Drive
 Raleigh, North Carolina
 EYC COMPANIES



1 FIRST LEVEL PARTIAL PLAN (312.05) - BUILDING #3

A4.22a

1/8" = 1'-0"

PROJECT	1915
DATE	29JAN20
DRAWN BY	WJP
CHECKED BY	CMW
FIRST LEVEL PARTIAL PLAN - BUILDING #3	
A4.22a	