


Order Plans @

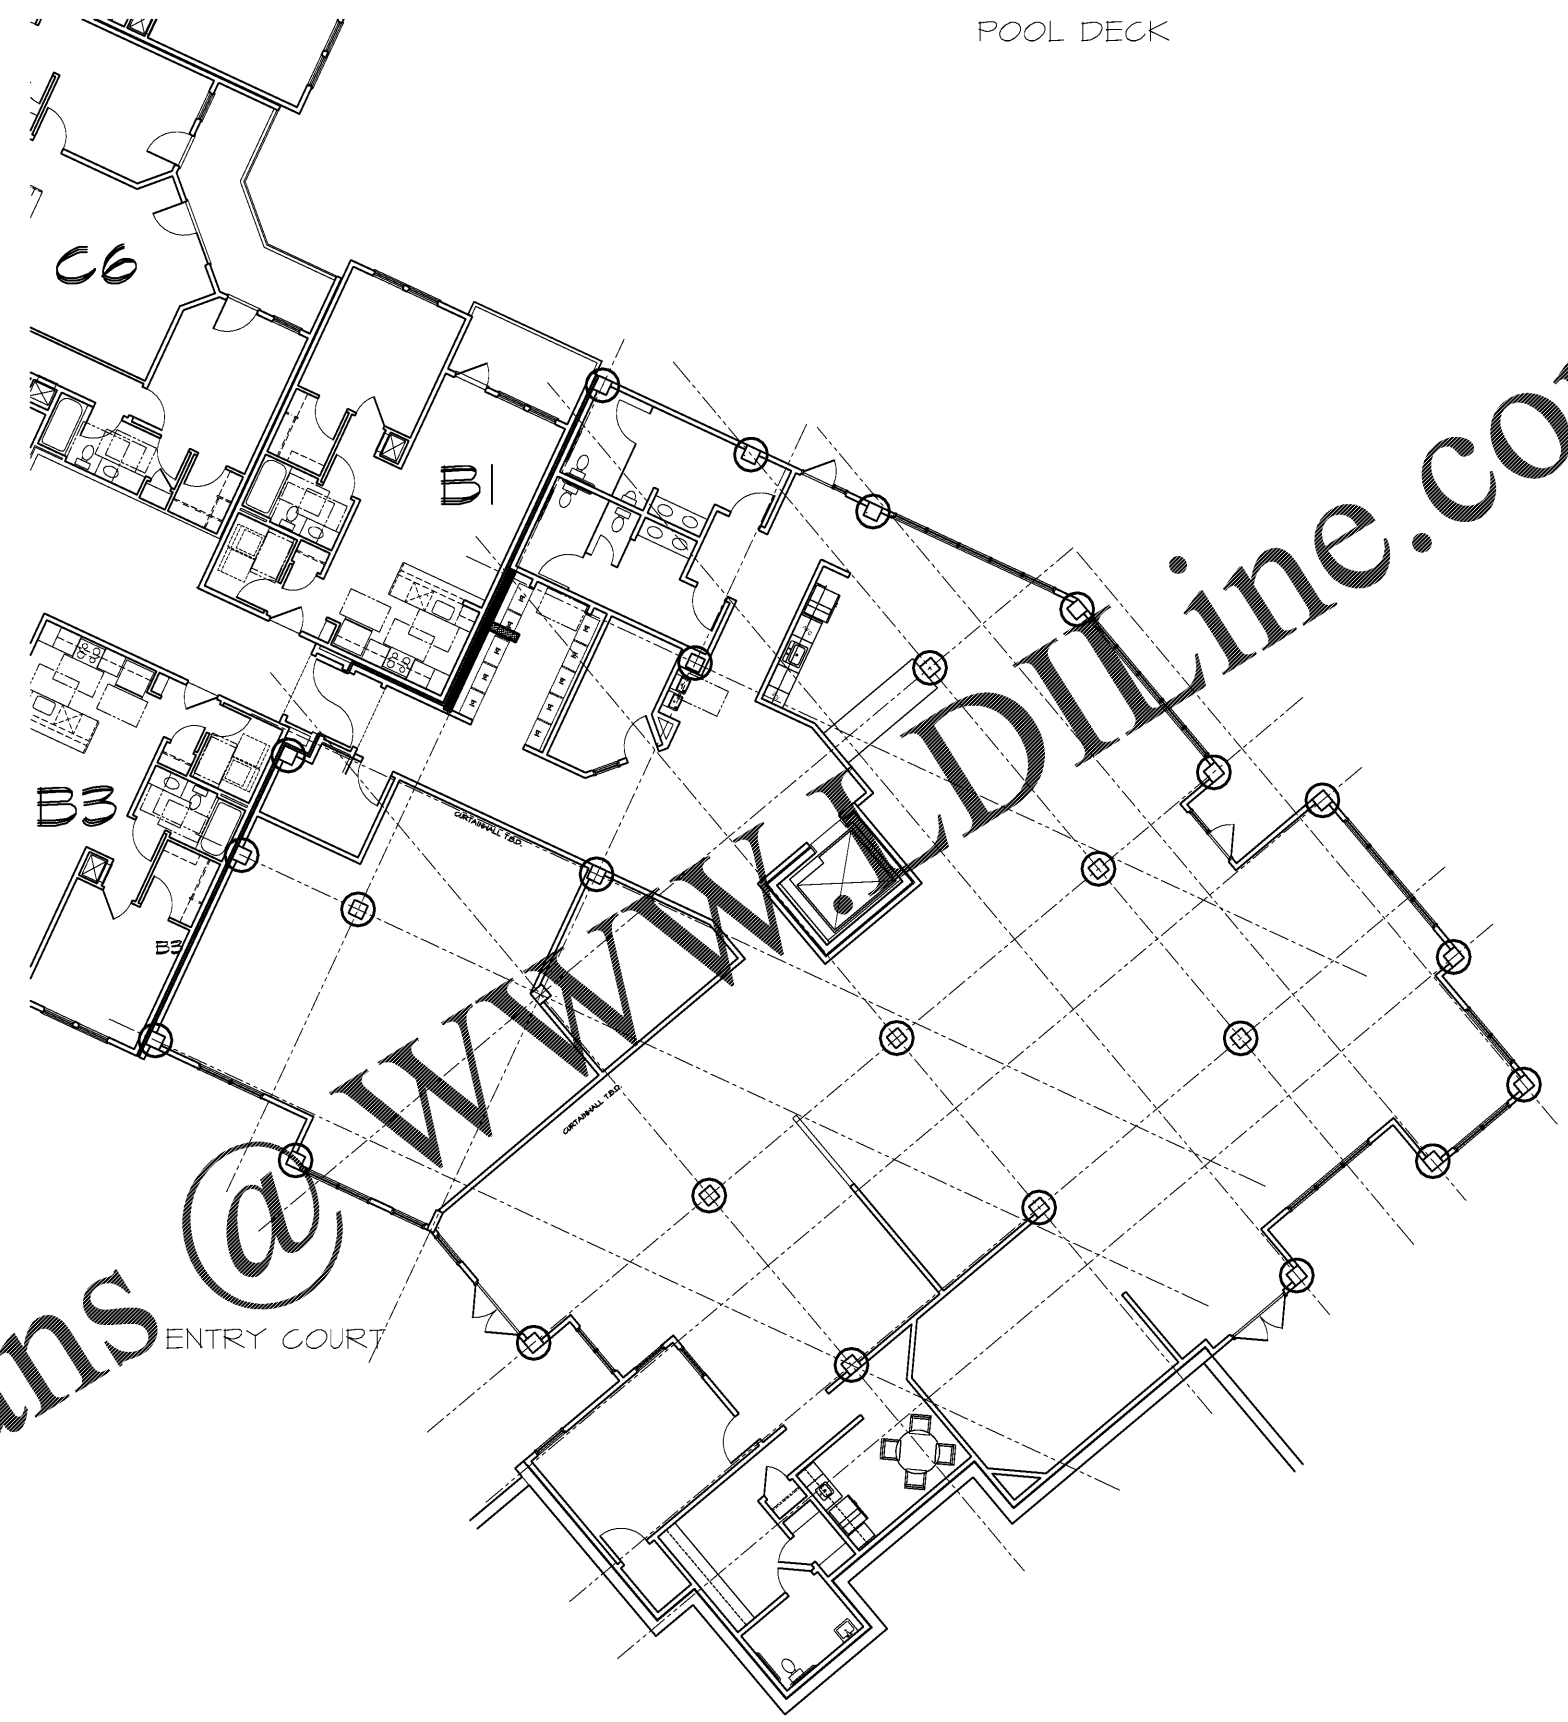

POOL DECK

ENTRY COURT

GENERAL NOTES

The Architectural drawings must be used in conjunction with the Civil, Structural, MEP, Fire Protection drawings and specifications. The Contractor is responsible for all coordination between the drawings. Discrepancies should be brought to the attention of the architect.

The Contractor is advised that the available space for routing all electrical, mechanical, plumbing, fire protection and communications piping, conduit, trays and ductwork may be limited in many locations. The Contractor shall coordinate all of the trades work and make adjustments, with the Architect's approval, to the routing of these items as required. Any rework resulting from the failure to coordinate will be performed by the Contractor at no additional cost.

All dimensions are from face of stud, u.n.o.

All penetrations of fire rated assemblies shall be fire blocked and sealed per U.L. approved methods.

All concealed fire rated assemblies shall be provided with signage indicating the type of assembly and the fire rating in hours. Letters no smaller than 2" high. See 101.2.

FIRE RATINGS LEGEND

3 HOUR RATED FIRE MALL

3FW 3FW

3 HOUR RATED FIRE MALL

3FW 3FW

3 HOUR RATED CONCRETE SLABS

SEE N.C.S.B.C. SECTION 1210(J)

SLABS BETWEEN STORAGE LEVEL AND APT. UNITS ABOVE BUILDING #2 ONLY

3 HOUR RATED CONCRETE COLUMNS

SEE N.C.S.B.C. SECTION 1210(J)

COLUMNS SUPPORTING 3 HOUR RATED SLABS

2 HOUR RATED FIRE MALL

2FW 2FW

2 HOUR RATED FIRE MALL

2FW 2FW

UL U-210 2-HR FIREHALL SEPARATING TYPE SA FIRE AREA

2 HOUR RATED FIRE BARRIER

2FB 2FB

2FB 2FB

ULCS - ELEVATOR AND STAIR # MECH. SHAFTS

2 HOUR RATED CEILING

2A FILE NO. FC 5129

2 HOUR RATED CONCRETE SLABS

SEE N.C.S.B.C. SECTION 1210(J)

SLAB BETWEEN CLUBHOUSE AND APT. UNITS ABOVE BUILDING #4 ONLY

2 HOUR RATED CONCRETE COLUMNS

SEE N.C.S.B.C. TABLE 1210(I)

COLUMNS SUPPORTING 2 HOUR RATED SLABS

1 HOUR RATED ASSEMBLIES

1 HOUR RATED FIRE BARRIER

1FB 1FB

1FB 1FB

UL U-305 1-HR FIRE BARRIER ADJACENT TO ENCLOSED GARAGE WALLS

1 HOUR RATED FIRE PARTITION

1FP 1FP

1FP 1FP

UL U-341 1-HR TENANT SEPARATION WALLS

UL U-305 1-HR CORRIDOR WALLS - BUILT TO ACHIEVE STC66 RATING PER RECS. LISTED IN U.L. INCL. FIRING CHANNELS/GLASS ON CORRIDOR SIDE OF ASSEMBLY. DSB PANELS TO BE PLACED BETWEEN STID ENDS AND GLIPS AT STAIR HALL LOCATIONS. COORDINATE WITH THE STRUCTURAL.

1 HOUR RATED STRUCTURAL AND NON-STRUCTURAL ELEMENTS

1HR 1HR

1HR 1HR

UL U-305 1-HR RATED EXTERIOR BEARING WALL


UL U-305 1-HR RATED UNIT INTERIOR BEARING WALL AND ELEVATOR LOBBIES

1HR RATED ROOF/CEILING ASSEMBLY, SEE AGOIT SYSTEM ASSOCIATION FILE NO. RG 2609

UL L-528 1-HR RATED FLOOR/CEILING ASSEMBLY

WLA
 WATTS LEAF ARCHITECTS, PA
 101 North McDowell Street, Suite 112
 Charlotte, North Carolina 28204
 PH 704 376 1200 FX 704 376 5111

CRABTREE NORTH APTS.
 2251 Charles Drive
 Raleigh, North Carolina
 EYC COMPANIES



FIRST LEVEL PLAN (312.05') - BUILDING #4

1/8" = 1'-0"

PROJECT	1915
DATE	06NOV19
DRAWN BY	WJP
CHECKED BY	CMW
FIRST LEVEL PLAN - BUILDING #4	
A4.27	