


CITY MULTI
SYSTEM SCHEMATIC DWG.

CONT'NO	PAGE
1	1

Canterbury School
 DISCONNECT LEGEND
 POWER WIRE
 CONTROL WIRE
 REF. PIPE

Additional refrigerant charge is needed depending on the size and length of extended piping. Please refer the amount of pre-charge and the formula of calculation which is mentioned on the data book.
 1.25mm² (16 AWG) : 1.25mm² (16 AWG) or max. (1.5mm²) (14 AWG) : 1.5mm² (14 AWG) and (1.5mm²) (14 AWG)

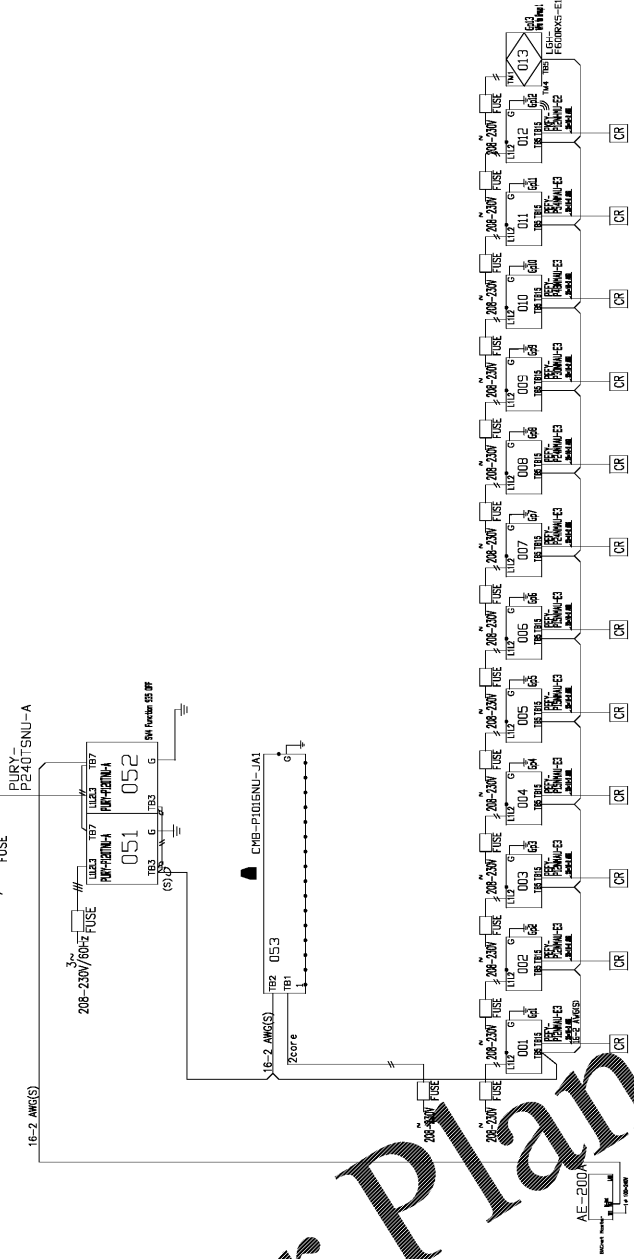

4133B
 Mitsubishi Electric
 Demand System Sizer
 1/27/2020
 1:40 PM

CITY MULTI
SYSTEM SCHEMATIC DWG.

CONT'NO	PAGE
1	1

Canterbury School
 DISCONNECT LEGEND
 POWER WIRE
 CONTROL WIRE
 REF. PIPE

Additional refrigerant charge is needed depending on the size and length of extended piping. Please refer the amount of pre-charge and the formula of calculation which is mentioned on the data book.
 1.25mm² (16 AWG) : 1.25mm² (16 AWG) or max. (1.5mm²) (14 AWG) : 1.5mm² (14 AWG) and (1.5mm²) (14 AWG)




4133B
 Mitsubishi Electric
 Demand System Sizer
 1/27/2020
 1:17 PM

Order Plans @ WWW.LDILINE.COM

HVAC VRF SYSTEM SCHEMATICS

NO SCALE



EUBANKS
 ENGINEERING P.C.
 HUMPHREY
 102 Hilday St., Suite 200
 Greensboro, NC 27401
 Phone 336.379.0653
 Fax 336.379.0653
 NO FIRM LICENSE: C-2272

TEAGUE
 FREYALDENHOVEN
 FREYALDENHOVEN
 ARCHITECTS & PLANNERS, LLP
 100 NORTH GREENE STREET
 SUITE 200
 GREENSBORO
 NORTH CAROLINA 27401
 TEL. 336.273.0101
 FAX. 336.273.0141

CANTERBURY SCHOOL
 P. DAVID BROWN LIBRARY AND
 ADMINISTRATION BUILDING
 5400 OLD LAKE JEANETTE RD
 GREENSBORO, NORTH CAROLINA

DATE	30JAN20
EHEPC PROJECT #	1969
REVISIONS	

THIS DRAWING AND ITS CONTENTS OR ANY PART THEREOF ARE THE PROPERTY OF EUBANKS ENGINEERING P.C. AND ARE NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF EUBANKS ENGINEERING P.C.

SHEET
M-6
 OF 6