


# LANDSCAPE SPECIFICATIONS

**1. SCOPE OF WORK**  
THE CONTRACTOR SHALL BE REQUIRED TO PERFORM ALL CLEARING, FINISHED GRADING, SOIL PREPARATION, PERMANENT SEEDING OR SODDING, PLANTING AND MULCHING INCLUDING ALL LABOR, MATERIALS, TOOLS AND EQUIPMENT NECESSARY FOR THE COMPLETION OF THIS PROJECT, UNLESS OTHERWISE CONTRACTED BY THE GENERAL CONTRACTOR.


**2. MATERIALS**  
A. GENERAL - ALL HARDWARE MATERIALS SHALL MEET OR EXCEED SPECIFICATIONS AS OUTLINED IN THE STATE DEPARTMENT OF TRANSPORTATION'S SPECIFICATIONS.  
B. TOPSOIL - NATURAL, FRIABLE, LOAMY SILT SOIL HAVING AN ORGANIC CONTENT NOT LESS THAN 5%, A PH RANGE BETWEEN 4.5-7.0. IT SHALL BE FREE OF DEBRIS, ROCKS LARGER THAN ONE INCH (1"), WOOD, ROOTS, VEGETABLE MATTER AND CLAY CLODS.  
C. LAWN - ALL DISTURBED AREAS ARE TO BE TREATED WITH A MINIMUM SIX INCH (6") THICK LAYER OF TOPSOIL OR AS DIRECTED BY THE LOCAL ORDINANCE OR CLIENT, AND SEEDED OR SODDED IN ACCORDANCE WITH THE PERMANENT STABILIZATION METHODS INDICATED WITHIN THE SOIL EROSION AND SEDIMENT CONTROL NOTES.  
1. LAWN SEED MIXTURE SHALL BE FRESH, CLEAN NEW CROP SEED.  
2. SOD SHALL BE STRONGLY ROOTED, WEED AND DISEASE/FEST FREE WITH A UNIFORM THICKNESS.  
3. SOD INSTALLED ON SLOPES GREATER THAN 4:1 SHALL BE PEGGED TO HOLD SOD IN PLACE.  
D. MULCH - THE MULCH AROUND THE PERIMETER OF THE BUILDING SHALL BE A 3" LAYER OF DOUBLE SHREDDED BLACK CEDAR MULCH ONLY. ALL OTHER AREAS SHALL BE MULCHED WITH A 3" LAYER OF DOUBLE SHREDDED DARK BROWN HARDWOOD BARK MULCH, UNLESS OTHERWISE STATED ON THE LANDSCAPE PLAN.  
E. FERTILIZER  
1. FERTILIZER SHALL BE DELIVERED TO THE SITE MIXED AS SPECIFIED IN THE ORIGINAL UNOPENED STANDARD BAGS SHOWING WEIGHT, ANALYSIS AND NAME OF MANUFACTURER. FERTILIZER SHALL BE STORED IN A WEATHERPROOF PLACE SO THAT IT CAN BE KEPT DRY PRIOR TO USE.  
2. FOR THE PURPOSE OF BIDDING, ASSUME THAT FERTILIZER SHALL BE 10% NITROGEN, 6% PHOSPHORUS AND 4% POTASSIUM BY WEIGHT. A FERTILIZER SHOULD NOT BE SELECTED WITHOUT A SOIL TEST PERFORMED BY A CERTIFIED SOIL LABORATORY.  
F. PLANT MATERIAL  
1.1. ALL PLANTS SHALL IN ALL CASES CONFORM TO THE REQUIREMENTS OF THE "AMERICAN STANDARD FOR NURSERY STOCK" (ANSI Z60.1), LATEST EDITION, AS PUBLISHED BY THE AMERICAN NURSERY & LANDSCAPE ASSOCIATION.  
1.2. IN ALL CASES, BOTANICAL NAMES SHALL TAKE PRECEDENCE OVER COMMON NAMES FOR ANY AND ALL PLANT MATERIAL.  
1.3. PLANTS SHALL BE LEGIBLY TAGGED WITH THE PROPER NAME AND SIZE. TAGS ARE TO REMAIN ON AT LEAST ONE PLANT OF EACH SPECIES FOR VERIFICATION PURPOSES DURING THE FINAL INSPECTION.  
1.4. TREES WITH ABRASION OF THE BARK, SUN SCALDS, DISFIGURATION OR FRESH CUTS OF LIMBS OVER 1/2", WHICH HAVE NOT BEEN COMPLETELY CALLEDUS, SHALL BE REJECTED. BRANCHES SHALL NOT BE BOUND WITH WIRE OR ROPE AT ANY TIME SO AS TO DAMAGE THE BARK OR BREAK BRANCHES.  
1.5. ALL PLANTS SHALL BE TYPICAL OF THEIR SPECIES OR VARIETY AND SHALL HAVE A NORMAL HABIT OF GROWTH, WELL DEVELOPED BRANCHES, DENSELY FOLIATED, VIGOROUS ROOT SYSTEMS AND BE FREE OF DISEASE, INSECTS, PESTS, EGGS OR LARVAE.  
1.6. CALIPER MEASUREMENTS OF NURSERY GROWN TREES SHALL BE TAKEN AT A POINT ON THE TRUNK SIX INCHES (6") ABOVE THE NATURAL GRADE FOR TREES UP TO AND INCLUDING A FOUR INCH (4") CALIPER SIZE. IF THE CALIPER AT SIX INCHES (6") ABOVE THE NATURAL GRADE EXCEEDS FOUR INCHES (4") CALIPER, THE CALIPER SHOULD BE MEASURED AT A POINT 12" ABOVE THE NATURAL GRADE.  
1.7. SHRUBS SHALL BE MEASURED TO THE AVERAGE HEIGHT OR SPREAD OF THE SHRUB, AND NOT TO THE LONGEST BRANCH.  
1.8. TREES AND SHRUBS SHALL BE HANDLED WITH CARE BY THE ROOT BALL.

**3. GENERAL WORK PROCEDURES**  
A. CONTRACTOR TO UTILIZE WORKMANLIKE INDUSTRY STANDARDS IN PERFORMING ALL LANDSCAPE CONSTRUCTION. THE SITE IS TO BE LEFT IN A CLEAN STATE AT THE END OF EACH WORKDAY. ALL DEBRIS, MATERIALS AND TOOLS SHALL BE PROPERLY STORED, STOCKPILED OR DISPOSED OF.  
B. WASTE MATERIALS AND DEBRIS SHALL BE COMPLETELY DISPOSED OF AT THE CONTRACTOR'S EXPENSE. DEBRIS SHALL NOT BE BURIED, INCLUDING ORGANIC MATERIALS, BUT SHALL BE REMOVED COMPLETELY FROM THE SITE.  
**4. SITE PREPARATIONS**  
A. BEFORE AND DURING PRELIMINARY GRADING AND FINISHED GRADING, ALL WEEDS AND GRASSES SHALL BE DUG OUT BY THE ROOTS AND DISPOSED OF IN ACCORDANCE WITH GENERAL WORK PROCEDURES OUTLINED HEREIN.  
B. ALL EXISTING TREES TO REMAIN SHALL BE PRUNED TO REMOVE ANY DAMAGED BRANCHES. THE ENTIRE LIMB OF ANY DAMAGED BRANCH SHALL BE CUT OFF AT THE TRUNK. CONTRACTOR SHALL ENSURE THAT CUTS ARE SMOOTH AND STRAIGHT. ANY EXPOSED ROOTS SHALL BE CUT BACK WITH CLEAN, SHARP TOOLS AND TOPSOIL SHALL BE PLACED AROUND THE REMAINDER OF THE ROOTS. EXISTING TREES SHALL BE MONITORED ON A REGULAR BASIS FOR ADDITIONAL ROOT OR BRANCH DAMAGE AS A RESULT OF CONSTRUCTION. ROOTS SHALL NOT BE LEFT EXPOSED FOR MORE THAN ONE (1) DAY. CONTRACTOR SHALL WATER EXISTING TREES AS NEEDED TO PREVENT SHOCK OR DECLINE.  
C. CONTRACTOR SHALL ARRANGE TO HAVE A UTILITY STAKE-OUT TO LOCATE ALL UNDERGROUND UTILITIES PRIOR TO INSTALLATION OF ANY LANDSCAPE MATERIAL. UTILITY COMPANIES SHALL BE CONTACTED THREE (3) DAYS PRIOR TO THE BEGINNING OF WORK.  
**5. TREE PROTECTION**  
A. CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING TREES TO REMAIN. A TREE PROTECTION ZONE SHALL BE ESTABLISHED AT THE DRIP LINE OR 15 FEET FROM THE TRUNK OR AT THE LIMIT OF CONSTRUCTION DISTURBANCE, WHICHEVER IS GREATER. LOCAL STANDARDS THAT MAY REQUIRE A MORE STRICT TREE PROTECTION ZONE SHALL BE HONORED.  
B. A FORTY-EIGHT INCH (48") HIGH WOODEN SNOW FENCE OR ORANGE COLORED HIGH-DENSITY "VISH-FENCE", OR APPROVED EQUAL, MOUNTED ON STEEL POSTS SHALL BE PLACED ALONG THE BOUNDARY OF THE TREE PROTECTION ZONE. POSTS SHALL BE LOCATED AT A MAXIMUM OF EIGHT FEET (8') ON CENTER OR AS INDICATED WITHIN THE TREE PROTECTION DETAIL.  
C. WHEN THE TREE PROTECTION FENCING HAS BEEN INSTALLED, IT SHALL BE INSPECTED BY THE APPROVING AGENCY PRIOR TO DEMOLITION, GRADING, TREE CLEARING OR ANY OTHER CONSTRUCTION. THE FENCING ALONG THE TREE PROTECTION ZONE SHALL BE REGULARLY INSPECTED BY THE LANDSCAPE CONTRACTOR AND MAINTAINED UNTIL ALL CONSTRUCTION ACTIVITY HAS BEEN COMPLETED.  
D. AT NO TIME SHALL MACHINERY, DEBRIS, FALLEN TREES OR OTHER MATERIALS BE PLACED, STOCKPILED OR LEFT STANDING IN THE TREE PROTECTION ZONE.  
**6. SOIL MODIFICATIONS**  
A. CONTRACTOR SHALL OBTAIN A SOIL TEST FOR ALL AREAS OF THE SITE PRIOR TO CONDUCTING ANY PLANTING. SOIL TESTS SHALL BE PERFORMED BY A CERTIFIED SOIL LABORATORY.  
B. LANDSCAPE CONTRACTOR SHALL REPORT ANY SOIL OR DRAINAGE CONDITIONS CONSIDERED DETRIMENTAL TO THE GROWTH OF PLANT MATERIAL. SOIL MODIFICATIONS, AS SPECIFIED HEREIN, MAY NEED TO BE CONDUCTED BY THE LANDSCAPE CONTRACTOR DEPENDING ON SITE CONDITIONS.  
C. THE FOLLOWING AMENDMENTS AND QUANTITIES ARE APPROXIMATE AND ARE FOR BIDDING PURPOSES ONLY. COMPOSITION OF AMENDMENTS SHOULD BE REVISED DEPENDING ON THE OUTCOME OF A TOPSOIL ANALYSIS PERFORMED BY A CERTIFIED SOIL LABORATORY.  
1.1. TO INCREASE A SANDY SOIL'S ABILITY TO RETAIN WATER AND NUTRIENTS, THOROUGHLY TILL ORGANIC MATTER INTO THE TOP 6-12". USE COMPOSTED BARK, COMPOSTED LEAF MULCH OR PEAT MOSS. ALL PRODUCTS SHOULD BE COMPOSTED TO A DARK COLOR AND BE FREE OF PIECES WITH IDENTIFIABLE LEAF OR WOOD STRUCTURE. AVOID MATERIAL WITH A PH HIGHER THAN 7.5.  
1.2. TO INCREASE DRAINAGE, MODIFY HEAVY CLAY OR SILT (MORE THAN 40% CLAY OR SILT) BY ADDING COMPOSTED FINE BARK (UP TO 30% BY VOLUME) AND/OR AGRICULTURAL CYPRUS COARSE SAND MAY BE USED IF ENOUGH IS ADDED TO BRING THE SAND CONTENT TO MORE THAN 80% OF THE TOTAL MIX. SUBSURFACE DRAINAGE LINES MAY BE ADDED TO INCREASE DRAINAGE.  
1.3. MODIFY EXTREMELY SANDY SOILS (MORE THAN 85% BY ADDING ORGANIC MATTER AND/OR DRY, SHREDDED CLAY LOAM UP TO 3% OF THE TOTAL MIX.  
**7. FINISHED GRADING**  
A. UNLESS OTHERWISE CONTRACTED, THE LANDSCAPE CONTRACTOR SHALL BE RESPONSIBLE FOR THE INSTALLATION OF TOPSOIL AND THE ESTABLISHMENT OF FINE-GRADING WITHIN THE DISTURBANCE AREA OF THE SITE.  
B. LANDSCAPE CONTRACTOR SHALL VERIFY THAT SUBGRADE FOR INSTALLATION OF TOPSOIL HAS BEEN ESTABLISHED. THE SUBGRADE OF THE SITE MUST MEET THE FINISHED GRADE LESS THE REQUIRED SOIL THICKNESS (1").  
C. ALL LAWN AND PLANTING AREAS SHALL BE GRADED TO A SMOOTH, EVEN AND UNIFORM PLANE WITH MINOR SURFACE CHANGE OF SURFACE AS DEPICTED WITHIN THIS SET OF CONSTRUCTION PLANS, UNLESS OTHERWISE INDICATED BY THE PROJECT ENGINEER OR LANDSCAPE ARCHITECT.  
D. ALL PLANTING AREAS SHALL BE GRADED AND MAINTAINED TO ALLOW FREE FLOW OF SURFACE WATER IN AND AROUND THE PLANTING BEDS. STANDING WATER SHALL NOT BE PERMITTED IN PLANTING BEDS.


**8. TOPSOILING**  
A. CONTRACTOR SHALL PROVIDE A SIX INCH (6") THICK MINIMUM LAYER OF TOPSOIL, OR AS DIRECTED BY THE LOCAL ORDINANCE OR CLIENT, IN ALL PLANTING AREAS. TOPSOIL SHOULD BE SPREAD TO COVER A PREPARED SURFACE IN A UNIFORM LAYER TO ACHIEVE THE DESIRED COMPACTED THICKNESS.  
B. ON-SITE TOPSOIL MAY BE USED TO SUPPLEMENT THE TOTAL AMOUNT REQUIRED. TOPSOIL FROM THE SITE MAY BE REJECTED IF IT HAS NOT BEEN PROPERLY REMOVED, STORED AND PROTECTED PRIOR TO CONSTRUCTION.  
C. CONTRACTOR SHALL FURNISH TO THE APPROVING AGENCY AN ANALYSIS OF BOTH IMPORTED AND ON-SITE TOPSOIL TO BE UTILIZED IN ALL PLANTING AREAS. THE PH AND NUTRIENT LEVELS MAY NEED TO BE ADJUSTED THROUGH SOIL MODIFICATIONS AS NEEDED TO ACHIEVE THE REQUIRED LEVELS AS SPECIFIED IN THE MATERIALS SECTION ABOVE.  
D. ALL PLANTING AND LAWN AREAS ARE TO BE CULTIVATED TO A DEPTH OF SIX INCHES (6"). ALL DEBRIS EXPOSED FROM EXCAVATION AND CULTIVATION SHALL BE DISPOSED OF IN ACCORDANCE WITH GENERAL WORK PROCEDURES SECTION ABOVE. THE FOLLOWING SHALL BE FILLED INTO THE TOP FOUR INCHES (4") IN TWO DIRECTIONS (QUANTITIES BASED ON A 1,000 SQUARE FOOT AREA):  
1.1. 20 POUNDS GROW POWER OR APPROVED EQUAL  
1.2. 20 POUNDS NITRO-FORM (COURSE) 38-0-0 BLUE CHIP  
E. THE SPREADING OF TOPSOIL SHALL NOT BE CONDUCTED UNDER MUDDY OR FROZEN CONDITIONS.  
**9. PLANTING**  
A. INsofar THAT IT IS FEASIBLE, PLANT MATERIAL SHALL BE PLANTED ON THE DAY OF DELIVERY. IN THE EVENT THAT THIS IS NOT POSSIBLE, LANDSCAPE CONTRACTOR SHALL PROTECT UNINSTALLED PLANT MATERIAL. PLANTS SHALL NOT REMAIN UNPLANTED FOR LONGER THAN A THREE DAY PERIOD AFTER DELIVERY. PLANTS THAT WILL NOT BE PLANTED FOR A PERIOD OF TIME GREATER THAN THREE DAYS SHALL BE HEATED IN WITH TOPSOIL OR MULCH TO HELP PRESERVE ROOT MOISTURE.  
B. PLANTING OPERATIONS SHALL BE PERFORMED DURING PERIODS WITHIN THE PLANTING SEASON WHEN WEATHER AND SOIL CONDITIONS ARE SUITABLE AND IN ACCORDANCE WITH ACCEPTED LOCAL PRACTICE. PLANTS SHALL NOT BE INSTALLED IN TOPSOIL THAT IS IN A MUDDY OR FROZEN CONDITION.  
C. ANY INJURED ROOTS OR BRANCHES SHALL BE PRUNED TO MAKE CLEAN-CUT ENDS PRIOR TO PLANTING UTILIZING CLEAN, SHARP TOOLS. ONLY INJURED OR DISEASED BRANCHING SHALL BE REMOVED.  
D. ALL PLANTING CONTAINERS AND NON-BIODEGRADABLE MATERIALS SHALL BE REMOVED FROM ROOT BALLS DURING PLANTING. NATURAL FIBER BURLAP SHALL BE CUT FROM AROUND THE TRUNK OF THE TREE AND FOLDED DOWN AGAINST THE ROOT BALL PRIOR TO BACKFILLING.  
E. POSITION TREES AND SHRUBS AT THEIR INTENDED LOCATIONS AS PER THE PLANS AND SECURE THE APPROVAL OF THE LANDSCAPE ARCHITECT PRIOR TO EXCAVATING PITS, MARKING NECESSARY ADJUSTMENTS AS DIRECTED.  
F. PRIOR TO THE ISSUANCE OF ANY CERTIFICATE OF OCCUPANCY, THE PROPOSED LANDSCAPE, AS SHOWN ON THE APPROVED LANDSCAPE PLAN, MUST BE INSTALLED, INSPECTED AND APPROVED BY THE APPROVING AGENCY. THE APPROVING AGENCY SHALL TAKE INTO ACCOUNT SEASONAL CONSIDERATIONS IN THIS REGARD AS FOLLOWS: THE PLANTING OF TREES, SHRUBS, VINES OR GROUND COVER SHALL OCCUR ONLY DURING THE FOLLOWING PLANTING SEASONS:  
1.1. PLANTS: MARCH 15 TO DECEMBER 15  
1.2. LAWN: MARCH 15 TO JUNE 15 OR SEPT. 1 TO DECEMBER 1  
G. PLANTINGS REQUIRED FOR A CERTIFICATE OF OCCUPANCY SHALL BE PROVIDED DURING THE NEXT APPROPRIATE SEASON AT THE MUNICIPALITY'S DISCRETION. CONTRACTOR SHOULD CONTACT APPROVING AGENCY FOR POTENTIAL SUBSTITUTIONS.  
H. FURTHERMORE, THE FOLLOWING TREE VARIETIES ARE UNUSUALLY SUSCEPTIBLE TO WINTER DAMAGE, WITH TRANSPARENT SHOCK AND THE SEASONAL LACK OF NITROGEN AVAILABILITY. THE RISK OF PLANT DEATH IS GREATLY INCREASED. IT IS NOT RECOMMENDED THAT THESE SPECIES BE PLANTED DURING THE FALL PLANTING SEASON:  
ACER RUBRUM PLATANUS X ACERIFOLIA  
BETULA VARIETIES POPULUS VARIETIES  
CORNUS VARIETIES PRUNUS VARIETIES  
CRATAEGUS VARIETIES PYRUS VARIETIES  
KOEHLERIA QUERCUS VARIETIES  
LIQUIDAMBER STYRACIFLUA TILIA TOMENTOSA  
LIRIODENDRON TULIPIFERA ZELKOVA VARIETIES  
I. PLANTING PITS SHALL BE DUG WITH LEVEL BOTTOMS, WITH THE WIDTH TWICE THE DIAMETER OF ROOT BALL. THE ROOT BALL SHALL REST ON UNDISTURBED GRADE. EACH PLANT PIT SHALL BE BACKFILLED IN LAYERS WITH THE FOLLOWING PREPARED SOIL MIXED THOROUGHLY:  
1. 1 PART PEAT MOSS  
2. 2 PARTS TOPSOIL  
3. 3 PARTS TOPSOIL BY VOLUME  
4. 21 GRAMS AGRIFORM PLANTING TABLETS (OR APPROVED EQUAL) AS FOLLOWS:  
A) 2 TABLETS PER 1 GALLON PLANT  
B) 3 TABLETS PER 5 GALLON PLANT  
C) 4 TABLETS PER 15 GALLON PLANT  
D) LARGER PLANTS: 2 TABLETS PER 1/2" CALIPER OF TRUNK  
J. FILL PREPARED SOIL AROUND BALL OF PLANT HALF-WAY AND INSERT PLANT TABLETS. COMPLETE BACKFILL AND WATER THOROUGHLY.  
K. ALL PLANTS SHALL BE PLANTED SO THAT THE TOP OF THE ROOT BALL, THE POINT AT WHICH THE ROOT FLARE BEGINS, IS SET AT GROUND LEVEL AND IN THE CENTER OF THE PIT. NO SOIL IS TO BE PLACED DIRECTLY ON TOP OF THE ROOT BALL.  
L. ALL PROPOSED TREES DIRECTLY ADJACENT TO WALKWAYS OR DRIVEWAYS SHALL BE PRUNED AND MAINTAINED TO A MINIMUM BRANCHING HEIGHT OF 7' FROM GRADE.  
M. GROUND COVER AREAS SHALL RECEIVE A 1/2" LAYER OF HUMUS RAKED INTO THE TOP 1" OF PREPARED SOIL PRIOR TO PLANTING. ALL GROUND COVER AREAS SHALL BE WEEDED AND TREATED WITH A PRE-EMERGENT CHEMICAL AS PER MANUFACTURER'S RECOMMENDATION.  
N. NO PLANT, EXCEPT GROUND COVERS, GRASSES OR VINES, SHALL BE PLANTED LESS THAN TWO FEET (2') FROM EXISTING STRUCTURES AND SIDEWALKS.  
O. ALL PLANTING AREAS AND PLANTING PITS SHALL BE MULCHED AS SPECIFIED HEREIN TO FILL THE ENTIRE BED AREA OR SAUCER. NO MULCH IS TO TOUCH THE TRUNK OF THE TREE OR SHRUB.  
P. ALL PLANTING AREAS SHALL BE WATERED IMMEDIATELY UPON INSTALLATION IN ACCORDANCE WITH THE WATERING SPECIFICATIONS AS LISTED HEREIN.  
**10. TRANSPLANTING (WHEN REQUIRED)**  
A. ALL TRANSPLANTS SHALL BE DUG WITH INTACT ROOT BALLS CAPABLE OF SUSTAINING THE PLANT.  
B. IF PLANTS ARE TO BE STOCKPILED BEFORE REPLANTING, THEY SHALL BE HEATED IN WITH MULCH OR SOIL, ADEQUATELY WATERED AND PROTECTED FROM EXTREME HEAT, SUN OR WIND.  
C. PLANTS SHALL NOT BE DUG FOR TRANSPLANTING BETWEEN 10:00 AM AND 3:00 PM.  
D. UPON REPLANTING, BACKFILL SOIL SHALL BE AMENDED WITH FERTILIZER AND ROOT GROWTH HORMONE.  
E. TRANSPLANTS SHALL BE GUARANTEED FOR THE LENGTH OF THE GUARANTEE PERIOD SPECIFIED HEREIN.  
F. IF TRANSPLANTS DIE, SHED OR TREES SHALL BE REPLACED WITHIN 30 DAYS. TREES SHALL BE REPLACED IN KIND. TREES GREATER THAN SIX INCHES (6") CALIPER SHALL BE REPLACED IN ACCORDANCE WITH THE MUNICIPALITY'S TREE REPLACEMENT GUIDELINES.  
**11. WATERING**  
A. NEW PLANTINGS OR LAWNS SHALL BE ADEQUATELY IRRIGATED BEGINNING IMMEDIATELY AFTER PLANTING. WATER SHALL BE APPLIED TO EACH TREE AND SHRUB IN SUCH MANNER AS NOT TO DISTURB BACKFILL AND TO THE EXTENT THAT ALL MATERIALS IN THE PLANTING HOLE ARE THOROUGHLY SATURATED. WATERING SHALL CONTINUE AT LEAST UNTIL PLANTS ARE ESTABLISHED.  
B. SITE WATER SHALL PROVIDE WATER IF AVAILABLE ON SITE AT TIME OF PLANTING. IF WATER IS NOT AVAILABLE ON SITE, CONTRACTOR SHALL SUPPLY ALL NECESSARY WATER. THE USE OF WATERING BAGS IS RECOMMENDED FOR ALL UNPLANTED TREES.  
C. IF AN IRRIGATION SYSTEM HAS BEEN INSTALLED ON THE SITE, IT SHALL BE USED TO WATER PROPOSED PLANT MATERIAL. IN ANY FAILURE OF THE SYSTEM DOES NOT ELIMINATE THE CONTRACTOR'S RESPONSIBILITY OF MAINTAINING THE DESIRED MOISTURE LEVEL FOR VIGOROUS, HEALTHY GROWTH.  
**12. GUARANTEE**  
A. THE LANDSCAPE CONTRACTOR SHALL GUARANTEE ALL PLANTS FOR A PERIOD OF ONE (1) YEAR FROM APPROVAL OF LANDSCAPE INSTALLATION BY THE APPROVING AGENCY. CONTRACTOR SHALL SUPPLY THE OWNER WITH A MAINTENANCE BOND FOR TEN PERCENT (10%) OF THE VALUE OF THE LANDSCAPE INSTALLATION WHICH WILL BE RELEASED AT THE CONCLUSION OF THE GUARANTEE PERIOD AND WHEN A FINAL INSPECTION HAS BEEN COMPLETED AND APPROVED BY THE OWNER OR AUTHORIZED REPRESENTATIVE.  
B. ANY DEAD OR DYING PLANT MATERIAL SHALL BE REPLACED FOR THE LENGTH OF THE GUARANTEE PERIOD. REPLACEMENT OF PLANT MATERIAL SHALL BE CONDUCTED AT THE FIRST SUCCEEDING PLANTING SEASON. ANY DEBRIS SHALL BE DISPOSED OF OFF-SITE, WITHOUT EXCEPTION.  
C. TREES AND SHRUBS SHALL BE MAINTAINED BY THE CONTRACTOR DURING CONSTRUCTION AND THROUGHOUT THE 90 DAY MAINTENANCE PERIOD AS SPECIFIED HEREIN. CULTIVATION, WEEDING, WATERING AND THE PREVENTATIVE TREATMENTS SHALL BE PERFORMED AS NECESSARY TO KEEP PLANT MATERIAL IN GOOD CONDITION AND FREE OF INSECTS AND DISEASE.  
D. LAWNS SHALL BE MAINTAINED THROUGH WATERING, FERTILIZING, WEEDING, MOWING, TRIMMING AND OTHER OPERATIONS SUCH AS ROLLING, REGARDING AND REPLANTING AS REQUIRED TO ESTABLISH A SMOOTH, ACCEPTABLE LAWN, FREE OF ERODED OR BARE AREAS.  
**13. CLEANUP**  
A. UPON THE COMPLETION OF ALL LANDSCAPE INSTALLATION AND BEFORE THE FINAL ACCEPTANCE, THE CONTRACTOR SHALL REMOVE ALL UNUSED MATERIALS, EQUIPMENT AND DEBRIS FROM THE SITE. ALL PAVED AREAS ARE TO BE CLEANED.  
B. THE SITE SHALL BE CLEANED AND LEFT IN A NEAT AND ACCEPTABLE CONDITION AS APPROVED BY THE OWNER OR AUTHORIZED REPRESENTATIVE.

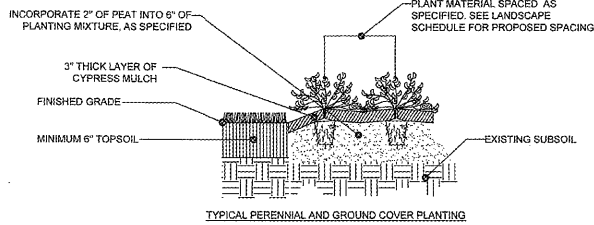


1  
L1.2

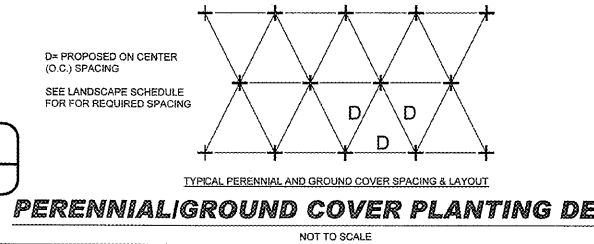


2  
L1.2

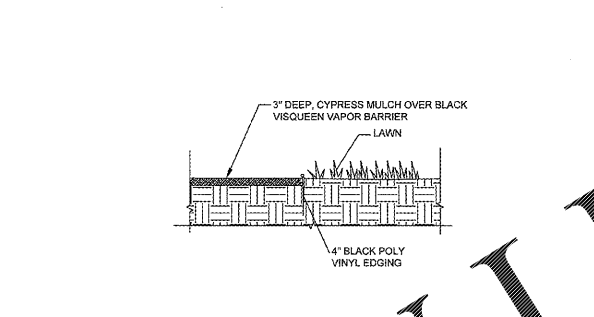


3  
L1.2

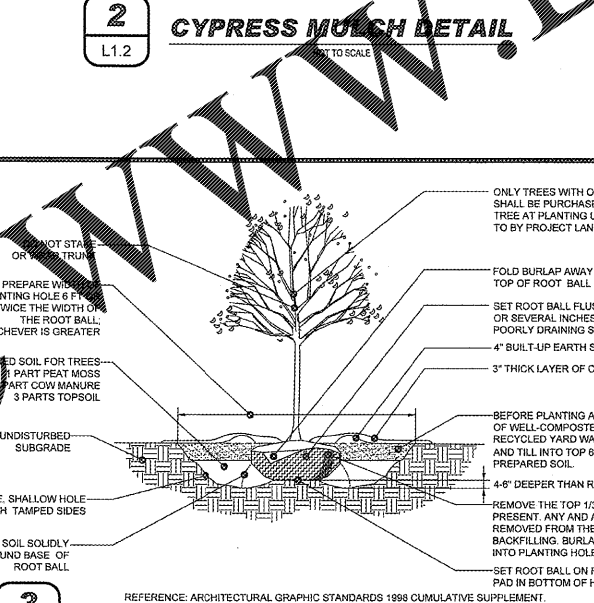

4  
L1.2

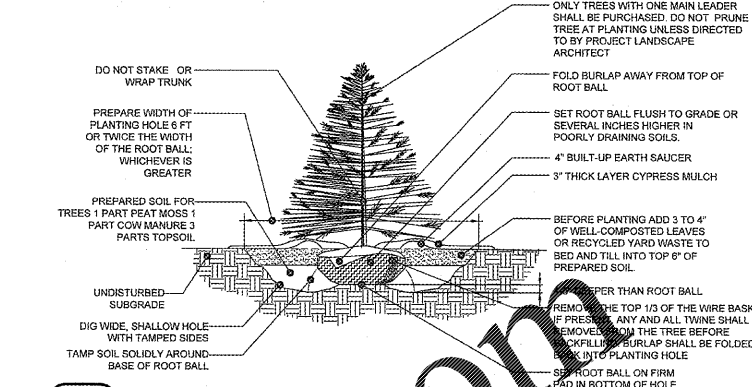

5  
L1.2

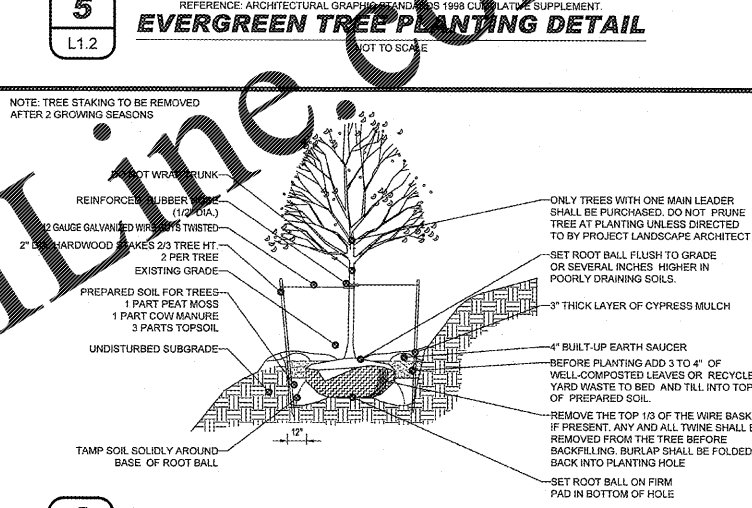

6  
L1.2

**SEEDING SPECIFICATIONS**

1. MATERIAL:

1.1. SEED MIXTURE MUST BE COMPRISED OF THE FOLLOWING VARIETIES AND AT THE SPECIFIED COMPOSITION:

1.1.1. 40% LITTLE BLUESTEM, CAMPER	SOCHACHRYM SCOPARIUM
1.1.2. 10% YARROW WHERVE, PA ECOTYPE	XYLIS WYVERN
1.1.3. 15% INDIANGRASS, PA ECOTYPE	SOCHACHRYM NUTANS
1.1.4. 10% BEAKED PANICGRASS, SC ECOTYPE	PANICUM ANCEPS
1.1.5. 5% BIG BLUES TERN, NUGAR	ANDROPOGON GERARDII
1.1.6. 5% PURPLETOP, SOUTHEASTERN VA ECOTYPE	TRIDENS FLAVUS
1.1.7. 5% SWITCHGRASS, CAVE-IN-ROCK	PANICUM VIRGATUM
1.1.8. 2% WINTER BENTGRASS, NC ECOTYPE	AGROSTIS HYEMALIS
1.1.9. 1% SLENDER WOODSTOCK, NC ECOTYPE	CHASMANTHIUM LAXUM

1.2. INSTALLATION RATES:

1.2.1. SEED: LAWN SEED SHOULD BE APPLIED AT A RATE OF 1 LBS/1,000 SF.

1.2.2. LIME: AGRICULTURAL OR PELLETIZED LIME SHOULD BE APPLIED AT SPECIFIED RATE ACCORDING TO SOIL ANALYSIS OR 2,000 LBS PER ACRE (46 LBS/1,000 SF) IF NO SOIL ANALYSIS IS PERFORMED.

1.2.3. FERTILIZER: COMMERCIAL GRADE 10-20-10 SHOULD BE APPLIED AT A RATE OF 250 LBS PER ACRE (5.4 LBS/1,000 SF).

1.2.4. LIQUID OR DRY LIME: LIQUID LIME SHOULD BE APPLIED AT A RATE OF 2.5 GALLONS PER ACRE OR NEUTRAL LIME APPLIED AT A RATE OF 80 LBS PER ACRE IN AREAS OF ACIDIC SOILS TO ASSURE GERMINATION AND INITIAL ESTABLISHMENT.

1.2.5. MULCH: STRAW, QAT, OR BARLEY STRAW MULCH SHALL BE APPLIED AT A RATE OF 80 LBS PER 1,000 SF. DO NOT INSTALL MULCH SO THICK THAT IT COMPLETELY COVERS THE GROUND. TOPSOIL SHOULD BE VISIBLE THROUGH THE STRAW LAYER.

2. EXECUTION AND PREPARATION:

2.1. A SOIL ANALYSIS SHOULD BE PERFORMED TO ASSESS THE FERTILITY NEEDS AND PH OF THE SOIL. ALL INSTALLATION AREAS SHOULD BE PREPARED TO AGRICULTURAL STANDARD RECOMMENDED BY THE DEPARTMENT OF AGRICULTURE WITHIN THE STATE WHERE THE WORK IS BEING PERFORMED. AGRICULTURAL LIME OR PELLETIZED LIME SHOULD BE ADDED DURING THE GROUND PREPARATION STAGE AT THE RATE RECOMMENDED ACCORDING TO SOIL ANALYSIS.

2.2. ALL WEEDS AND UNDESIRABLE PLANTS SHOULD BE REMOVED BEFORE PLANTING BY METHOD OF SPRAYING OR TILLAGE. A NON-SELECTIVE HERBICIDE CAN BE SPRAYED ONE MONTH PRIOR TO PLANTING TO KILL ALL WEEDS AND UNDESIRABLE PLANTS THAT MAY COMPETE WITH THE NEW SEEDLINGS. TILLAGE CAN BE PERFORMED AT LEAST 4 WEEKS PRIOR TO PLANTING AND AGAIN 2 WEEKS AFTER THE INITIAL TILLAGE. THE TILLAGE PROCEDURE CAN BE ADVANTAGEOUS IF LARGE AMOUNTS OF ORGANIC DEBRIS ARE PRESENT ON THE INSTALLATION AREAS.

2.3. PRIOR TO SEEDING, AREA IS TO BE TOPSOILED. FINE GRADED, AND RAKED OF ALL DEBRIS LARGER THAN 2" DIAMETER.

2.4. AREAS TO BE PLANTED SHOULD BE ROLLED WITH A CULT-PACKER, TIRE ROLLER, OR SIMILAR DEVICE TO FIRM THE SEEDBED. THIS PROCESS HELPS ACHIEVE THE DESIRED FIRMNESS. SOIL SHOULD BE FIRMED TO 85% OF COMPACTION.

3. INSTALLATION:

3.1. STRICTLY COMPLY WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS AND RECOMMENDATIONS.

3.2. EQUIPMENT USED TO SPREAD SEED SHOULD HAVE SUFFICIENT WEIGHT TO HOLD AND AGITATE SEED EVENLY IN A CYCLONE OR DROP PATTERN. HYDROSEEDING MAY ALSO BE PERFORMED WITH THE ENGINEER/ARCHITECT'S APPROVAL.

3.3. SEED MAY NEED TO BE APPLIED AT A HALF RATE IN ALTERNATING DIRECTIONS TO ENSURE AN EVEN COVERAGE OF SEED.

3.4. LIQUID LIME OR NEUTRAL LIME DRY SHOULD BE TOPICALLY APPLIED TO AREAS WITH ACIDIC SOILS TO KILL ALL WEEDS AND UNDESIRABLE PLANTS THAT MAY COMPETE WITH THE NEW SEEDLINGS. TILLAGE CAN BE PERFORMED AT LEAST 4 WEEKS PRIOR TO PLANTING AND AGAIN 2 WEEKS AFTER THE INITIAL TILLAGE. THE TILLAGE PROCEDURE CAN BE ADVANTAGEOUS IF LARGE AMOUNTS OF ORGANIC DEBRIS ARE PRESENT ON THE INSTALLATION AREAS.

3.5. FERTILIZER SHOULD BE SPREAD EVENLY OVER THE SEEDBED AREAS AT THE RECOMMENDED RATE DETERMINED BY THE INITIAL SOIL ANALYSIS. IF NO SOIL ANALYSIS IS AVAILABLE EVENLY APPLY 12-20-12 STARTER FERTILIZER AT A RATE OF 20 LBS PER ACRE (5.6 LBS/1,000 SQUARE FEET).

3.6. A EROSION PROTECTION CONTROL PRODUCT CAN BE APPLIED OVER THE TOP OF SEED IN STEEP SLOPE SITUATIONS TO HELP PREVENT SEED FROM WASHING AND REINFORCE VEGETATION THROUGH ESTABLISHMENT. (FOLLOW REC PRODUCT MANUFACTURER RECOMMENDATIONS.)

4. MAINTENANCE

4.1. FREQUENT LIGHT IRRIGATION WILL NEED TO BE APPLIED TO SEEDBED AREAS IF NO NATURAL RAIN EVENTS HAVE OCCURRED WITHIN 2 WEEKS OF SEEDING. AFTER SEED GERMINATION HAS OCCURRED AND PLANTS ARE VISIBLE THE FREQUENCY OF IRRIGATION CAN BE CUT BACK WITH HEAVIER APPLICATION RATES.

4.2. REPAIR ALL SEED WASHINGS AND EROSION.

**BOHLER ENGINEERING**  
28 BLACKWELL PARK LANE, SUITE 201 WARRENTON, VA 20196  
PHONE: (845) 349-6000 FAX: (845) 349-0821

PROJECT No.: V183201 SCALE: AS NOTED  
DRAWN BY / CHECKED BY: DSH/JDR / CAD LD.: SDO

COMMONWEALTH OF VIRGINIA  
**JOHNATHAN BICKLES**  
PROFESSIONAL ENGINEER  
Lic. No. 052544  
3/25/19

**CRAIG A. SCHNEIDER, AIA**  
ARCHITECT  
1736 East Sunshine, Suite 417  
Springfield, Missouri 65804  
417.862.6558  
417.862.3265  
e-mail: architect@astortyarchitect.com

PROJECT:  
**NEW O'REILLY AUTO PARTS STORE**  
290 DEACON ROAD  
FREDERICKSBURG, VA #4  
**LANDSCAPE DETAILS**

**O'Reilly AUTO PARTS**  
CORPORATE OFFICES  
233 SOUTH PATTERSON  
SPRINGFIELD, MISSOURI 65802  
(417) 862-2674 TELEPHONE

COMM # 4251  
DATE: 11-2-18  
REVISION  
DATE: 03-25-19

**L1.2**

11.10.18  
11.10.18  
11.10.18

KNOW WHAT'S BELOW  
ALWAYS CALL 811  
BEFORE YOU DIG  
It's fast. It's free. It's the law.