
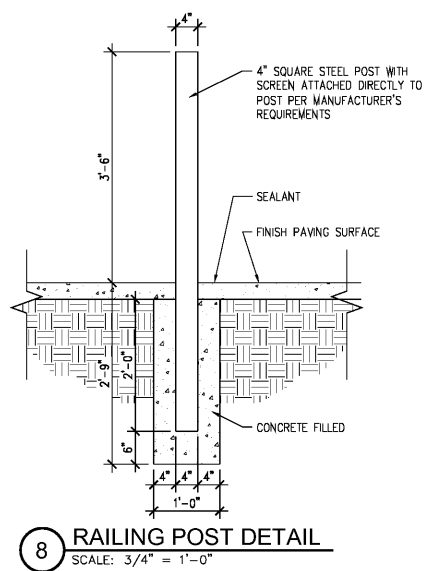
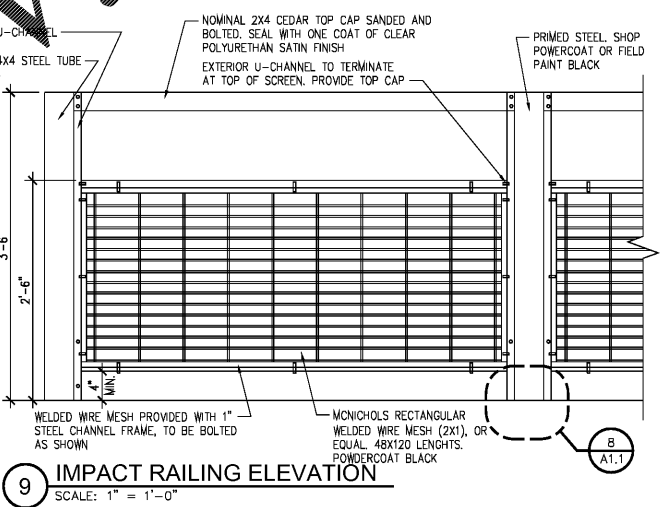
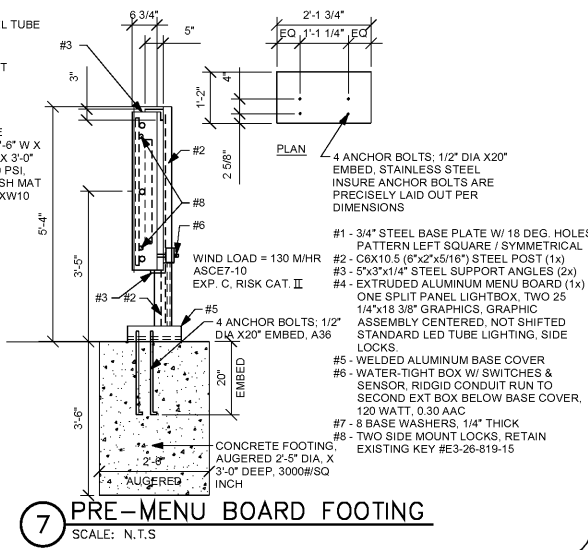
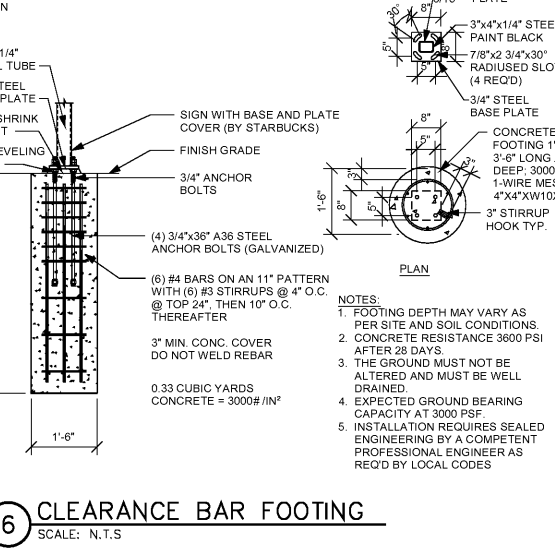
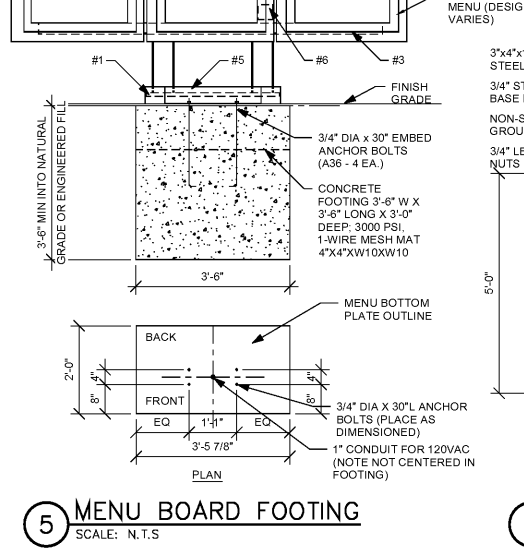
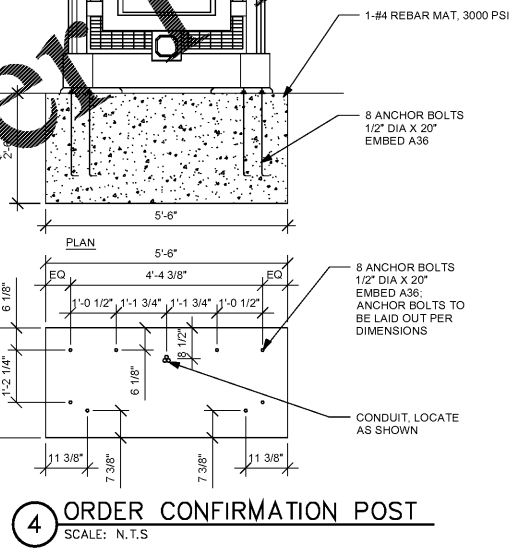
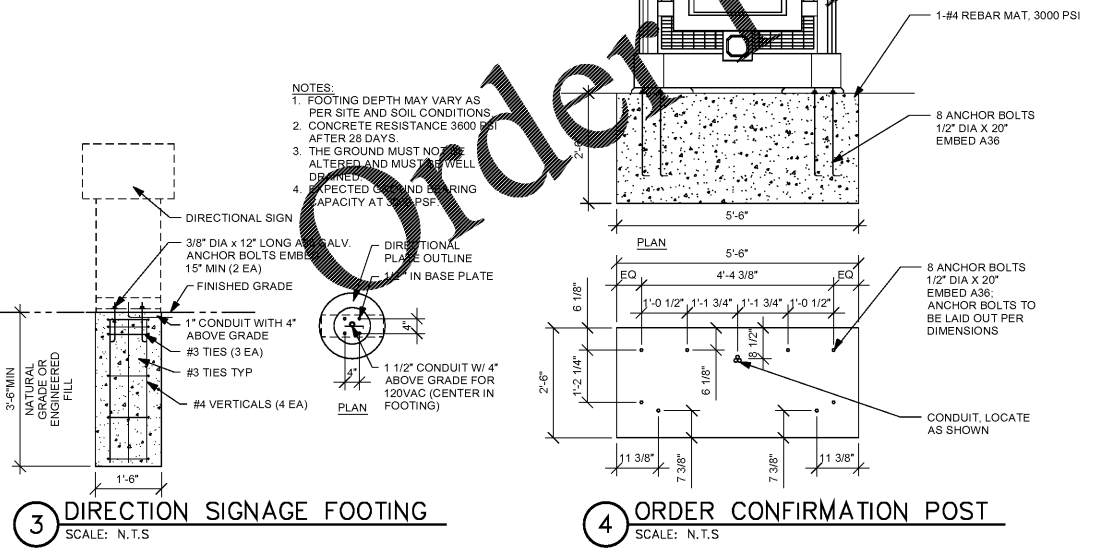
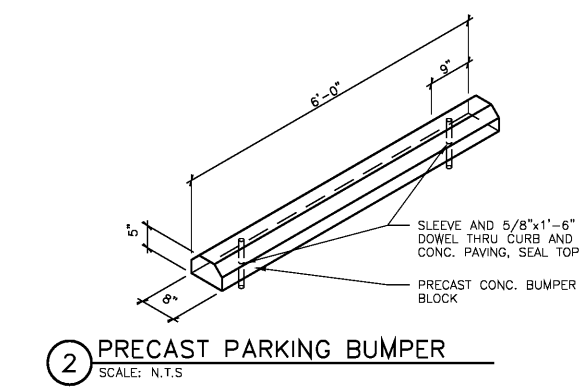


PARKING TABULATION	
REQUIRED PARKING = 1 PER 125 SQ. FT.	20
TOTAL REQUIRED PARKING	20
TOTAL PROVIDED PARKING	29
H/C ACCESSIBLE REQUIRED	2
H/C ACCESSIBLE PROVIDED	2

- SITE NOTES:**
- G.C. SHALL FOLLOW RECOMMENDATIONS OF GEOTECHNICAL ENGINEERING REPORT FOR PREPARATION OF SITE AND PARKING SUBGRADE.
  - REFER TO STRUCTURAL NOTES FOR BUILDING SLAB SITE PREPARATION.
  - G.C. SHALL HIRE A STATE LICENSED IRRIGATION CONTRACTOR FOR THE INSTALLATION OF IRRIGATION SYSTEM.
  - G.C. SHALL INSURE THAT THE WALK AT EXTERIOR DOORS IS A MAXIMUM OF 1:50 AT ACCESSIBLE APPROACHES AND 1:50 CROSS SLOPE.
  - G.C. SHALL INSURE THAT ALL ACCESSIBLE ROUTES ARE A MAXIMUM OF 1:20 SLOPE.
  - SLOPE AT ACCESSIBLE PARKING AND ACCESS AISLES SHALL NOT EXCEED 1:50 SLOPE AND CROSS SLOPE.
  - PROVIDE JUNCTION BOX AT DUMPER ENCLOSURE FOR IRRIGATION CONTRACTOR TO ADJUST SPRINKLER CONTROLLER.
  - THE SPRINKLER SYSTEM SHALL HAVE A FREEZE AND RAIN DETECTOR.
  - EXTERIOR CONDENS ARE TO BE RUN UNDER THE BUILDING.

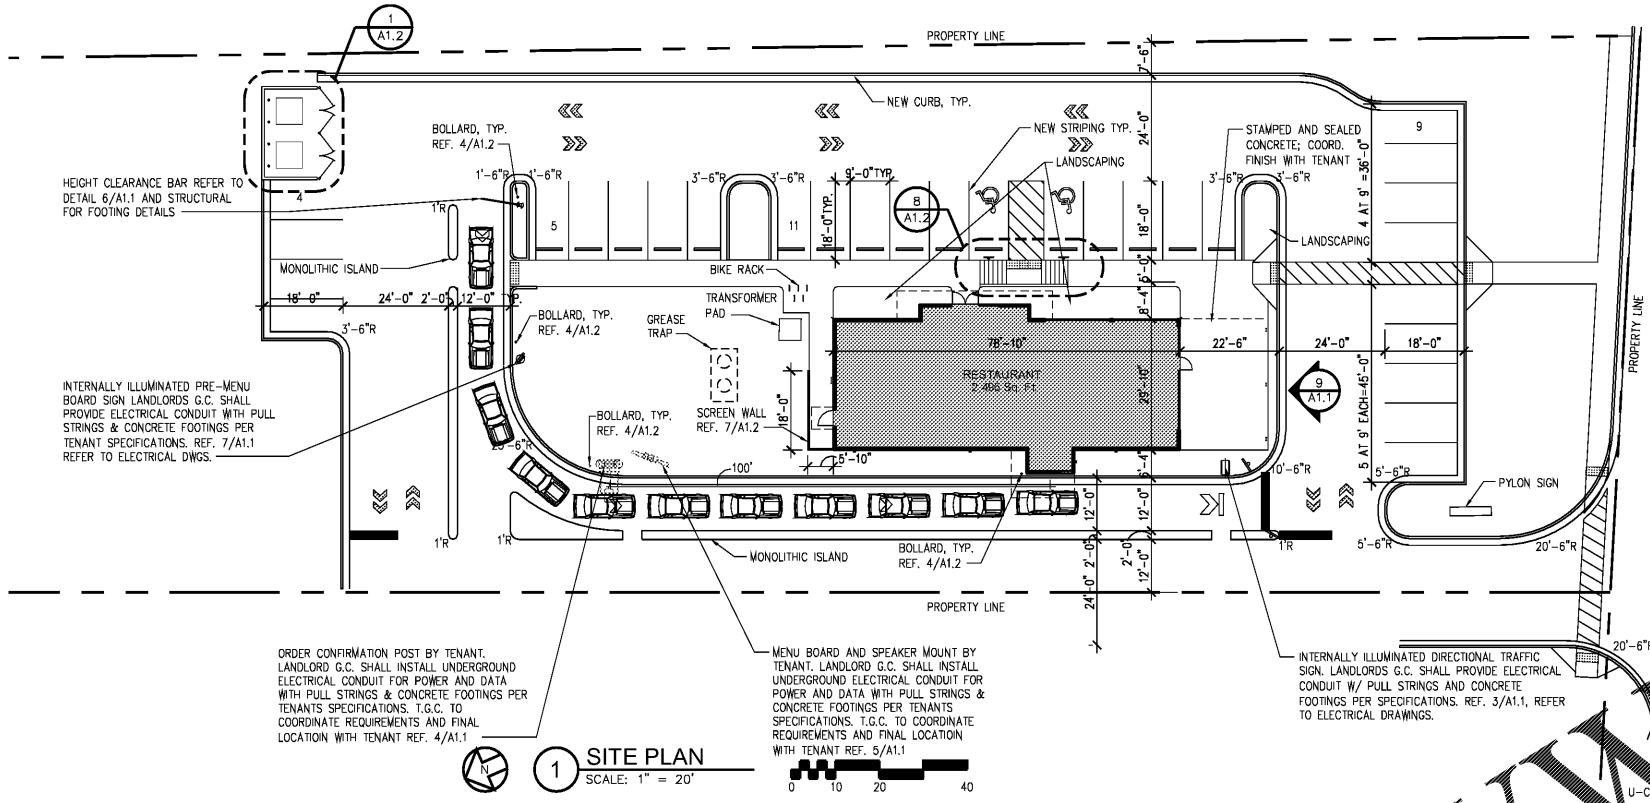

Order Plans @ WWW.LDILLING.COM