

ENGQUEST, LLC, has been awarded by act
 as the sole provider of design services for the
 project on which this drawing is based. The
 design, approval or construction of any
 structure shall be the responsibility of the
 contractor and not the responsibility of ENGQUEST, LLC.




HAI AN PAGODA
 6375 SANDERS ROAD,
 LAKE CITY, GA 30286

STRUCTURAL
 ELEVATION ALONG
 LINE "1.1" & "6.9"

REV	DATE	BY	DESCRIPTION
A	1/22/18	DT	PERMIT ISSUE

JOB NO. **1710037**
 DRAWN: **TB**
 CHECKED: **DT**
 SCALE: **AS NOTED**

S214
 DRAWING NO.

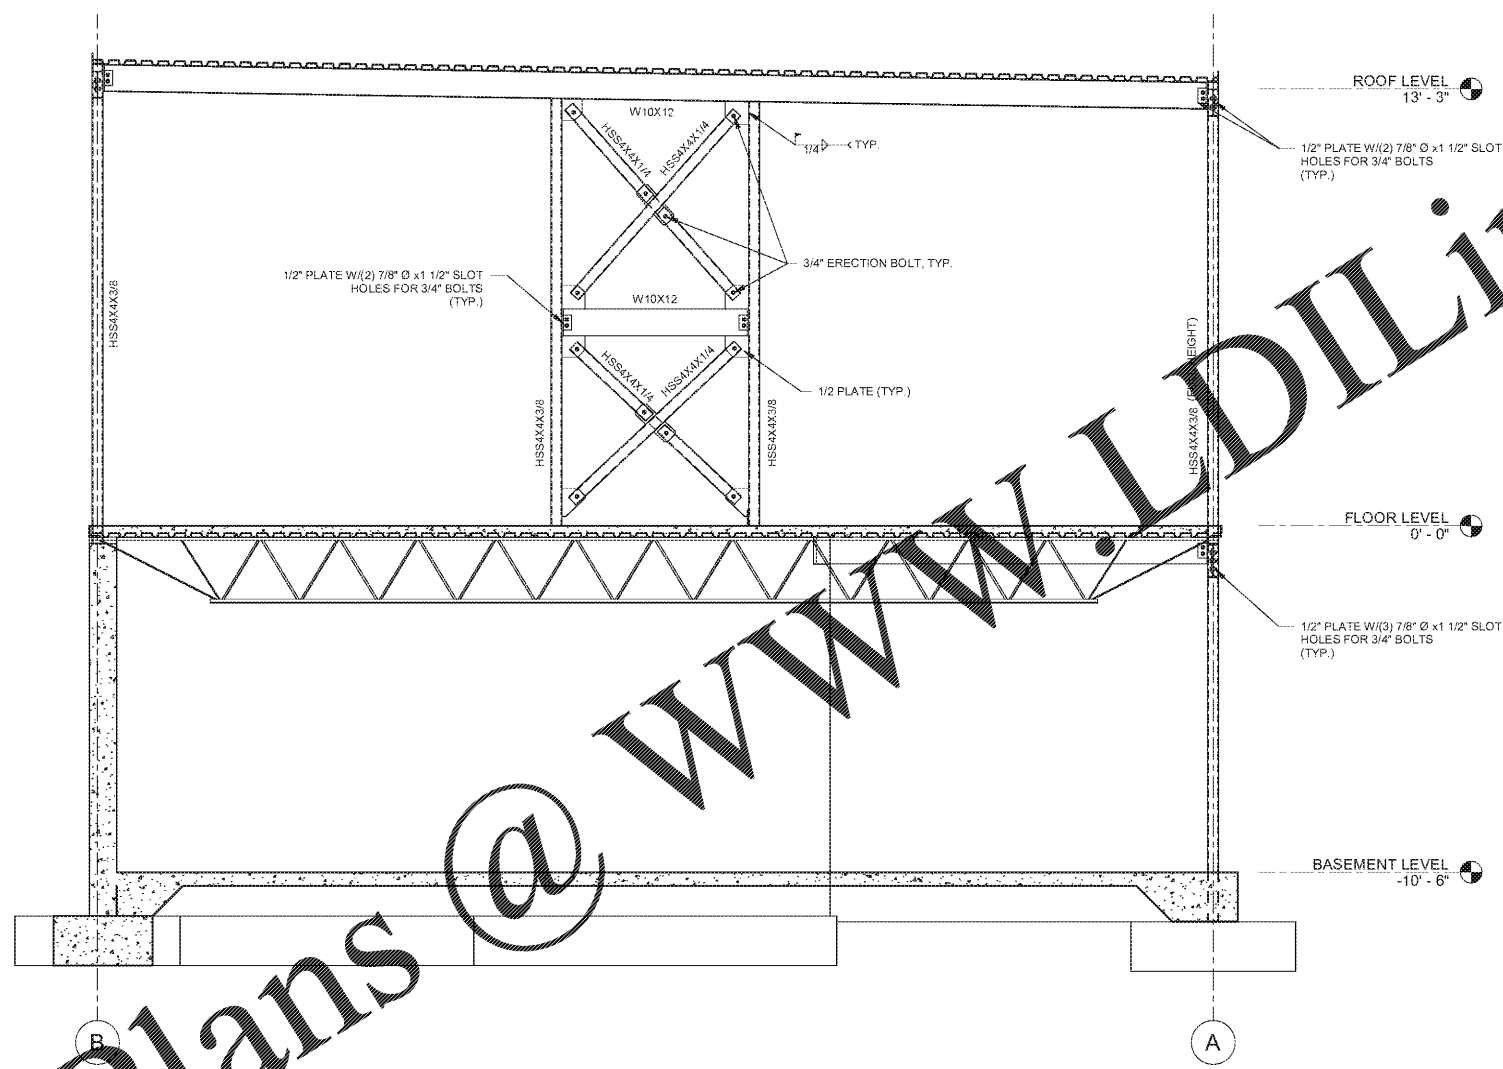

SERVICED HOUSE - ELEVATION STRUCTURAL FRAMING GRID 1.1 & 6.9
 SCALE: 3/8" = 1'-0"

- NOTES:
- SEE DWG S112, S113, S141, S142, S212 THROUGH S216 FOR STRUCTURAL STEEL DESIGN NOTES
 - SEE PLAN FOR TOP OF STEEL ELEVATION
 - ATTACH STEEL DECK TO STEEL WITH 3/8" X 3/8" PATTERN.
 SUPPORT FASTENERS: 5/8" PUDDLE WELDS
 SIDELAP FASTENERS: #10 TEK SCREWS
 - ATTACH DECK TO PERIMETER SUPPORTS WITH SAME FASTENER PATTERN AND TYPE SHOWN ABOVE, BUT SPACING NOT MORE THAN 6".
 - ALL STRUCTURAL STEEL, MISCELLANEOUS STEEL AND STEEL JOISTS U.N.O. SHALL BE GIVEN ONE SHOP COAT AND ONE FIELD TOUCH UP PAINT, GRAY COLOR
 - ALL STEEL EXPOSED TO WEATHER SHALL BE HOT DIPPED GALVANIZED AND ALL VENT HOLES SHALL BE PLUG OR SEAL WELDED PRIOR TO ERECTION.
 - 1 1/2", GALV. G60/PAINTE; TYPE B, 20 GA. METAL DECK FOR ROOF
 - BRIDGING - PROVIDE NUMBER OF ROWS HORIZONTAL ON DIAGONAL BRIDGING OF MATERIAL, SIZE AND TYPE REQUIRED BY SJI'S SPECIFICATIONS FOR TYPE OF JOIST, CHORD SIZE, SPACING AND SPAN. FURNISH ADDITIONAL ERECTION BRIDGING IF REQUIRED FOR STABILITY
 - FOR CONCRETE WALL SUPPORTING JOIST GIRDER, REF. DET. SHEET S501

Order Plans @ WWW.LDILine.com