


ENGQUEST, LLC, hereby certifies that the design shown on this drawing was prepared by a duly licensed Professional Engineer, State of Georgia, and that the design complies with all applicable codes and standards. The design is the property of ENGQUEST, LLC. No part of this drawing may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written consent of ENGQUEST, LLC.



**HAI AN PAGODA**  
 6375 SANDERS ROAD,  
 LAKE CITY, GA 30286

STRUCTURAL  
 ELEVATION ALONG  
 LINE "A"

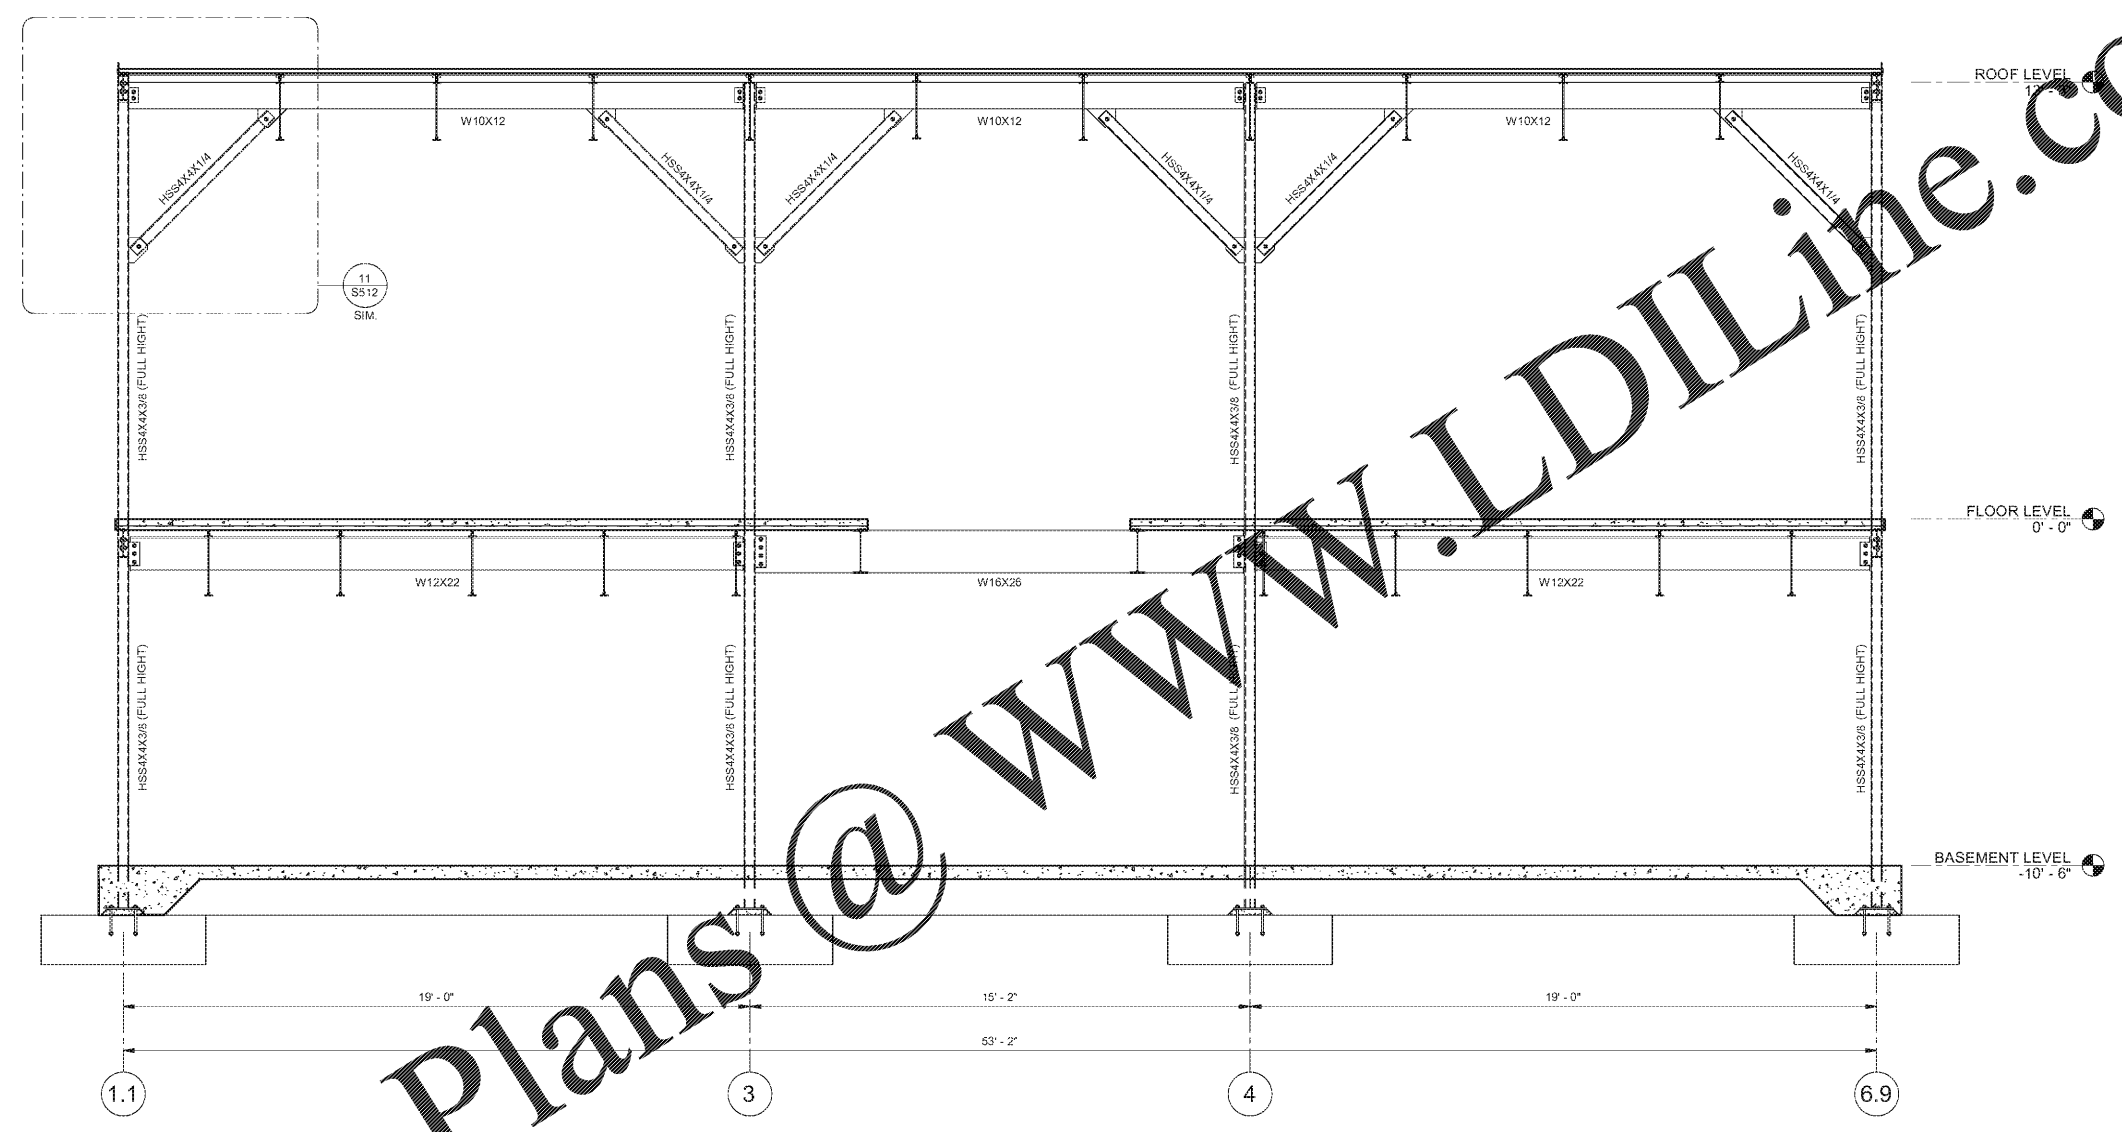

**SERVICED HOUSE - ELEVATION STRUCTURAL FRAMING GRID A**  
 SCALE: 3/8" = 1'-0"

- NOTES:
- SEE DWG S112, S113, S141, S142, S212 THROUGH S216 FOR STRUCTURAL STEEL DESIGN NOTES.
  - SEE PLAN FOR TOP OF STEEL ELEVATION.
  - ATTACH STEEL DECK TO STEEL WITH 36/43 PATTERN. SUPPORT FASTENERS: 5/8" PUDDLE WELDS SIDELAP FASTENERS: #10 TEK SCREWS
  - ATTACH DECK TO PERIMETER SUPPORTS WITH SAME FASTENER PATTERN AND TYPE SHOWN ABOVE, BUT SPACING NOT MORE THAN 6".
  - ALL STRUCTURAL STEEL, MISCELLANEOUS STEEL AND STEEL JOISTS U.N.O. SHALL BE GIVEN ONE SHOP COAT AND ONE FIELD TOUCH UP PAINT, GRAY COLOR.
  - ALL STEEL EXPOSED TO WEATHER SHALL BE HOT DIPPED GALVANIZED AND ALL VENT HOLES SHALL BE PLUG OR SEAL WELDED PRIOR TO ERECTION.
  - 1 1/2", [GALV. G60/PAINTED] TYPE B, 20 GA. METAL DECK FOR ROOF
  - BRIDGING - PROVIDE NUMBER OF ROWS HORIZONTAL ON DIAGONAL BRIDGING OF MATERIAL, SIZE AND TYPE REQUIRED BY SJS SPECIFICATIONS FOR TYPE OF JOIST, CHORD SIZE, SPACING AND SPAN. FURNISH ADDITIONAL ERECTION BRIDGING IF REQUIRED FOR STABILITY
  - FOR CONCRETE WALL SUPPORTING JOIST GIRDER, REF. DET. SHEET S501

Order Plans @ [www.LDILine.com](http://www.LDILine.com)

REV	DATE	BY	DESCRIPTION
A	1/22/18	DT	PERMIT ISSUE

JOB NO. **1710037**  
 DRAWN: **TB**  
 CHECKED: **DT**  
 SCALE: **AS NOTED**

**S215**  
 DRAWING NO.