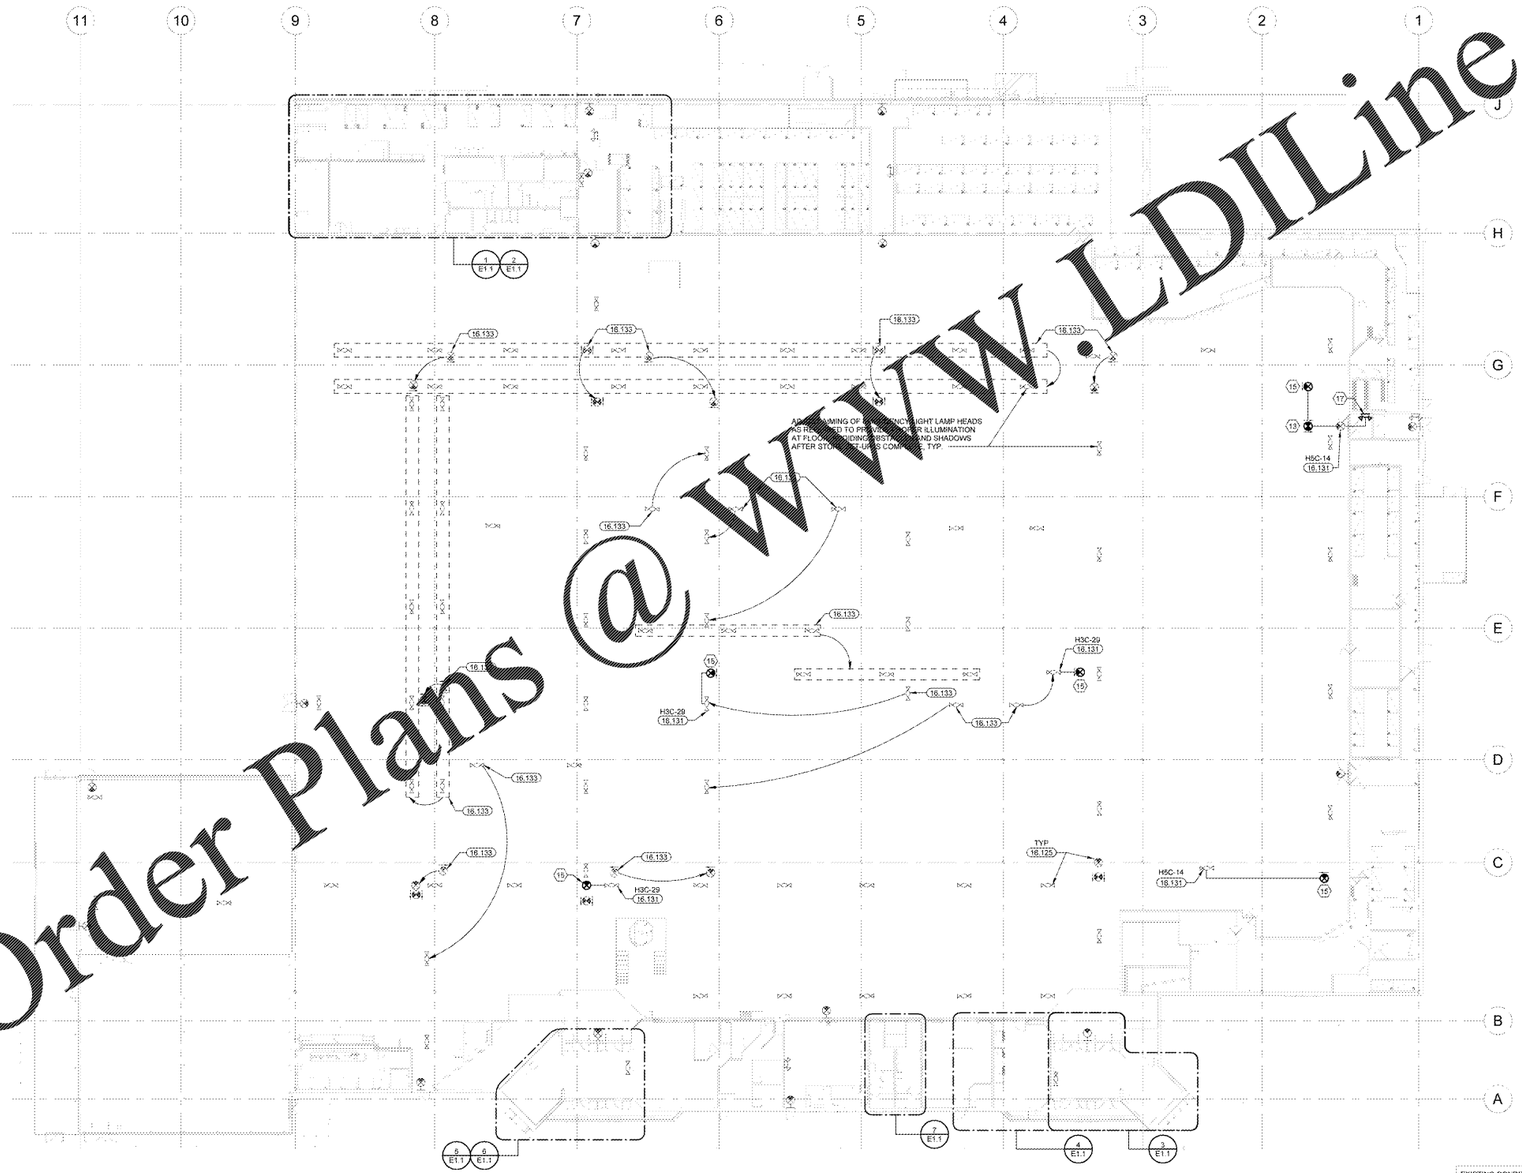

1 LIGHTING PLAN
1" = 20'-0"

GENERAL LIGHTING NOTES

02.26.14

1. EXIT SIGN MOUNTING
   A. WALL FIXTURE: CENTER 12" ABOVE DOOR OPENING.
   B. CEILING FIXTURE: ON CEILING OR AT HEIGHT SPECIFIED ON DRAWINGS.
   C. PENDANT FIXTURE: MATCH HEIGHT OF EXISTING PENDANT MOUNTED EXIT SIGNS. IF STORE DOES NOT HAVE PENDANT MOUNTED EXIT SIGNS, THEN PENDANT MOUNT SIGN 24" BELOW BOTTOM OF BAR JOIST.
   D. VERIFY MOUNTING HEIGHT WITH AHJ.
   E. COORDINATE LOCATIONS OF EXIT SIGNS TO ENSURE STORE SIGNAGE DOES NOT OBSTRUCT THEIR VIEW
   F. THE USE OF TRITIUM BASED RADIOACTIVE EXIT SIGNAGE IS PROHIBITED.
2. EMERGENCY LIGHT FIXTURE INSTALLATION
   A. WALL FIXTURE: 12" BELOW FINISHED CEILING OR +10'-0" IN AREAS OF EXPOSED STRUCTURE, UNLESS NOTED OTHERWISE.
   B. PENDANT FIXTURE: BOTTOM CHORD OF BAR JOIST OR AT HEIGHT SPECIFIED ON DRAWINGS.
   C. REMOTE HEAD FIXTURE: HEADS CENTERED ABOVE EACH OPENING +9'-0", UNLESS NOTED OTHERWISE. MOUNT BATTERY PACK MOUNTED ON INTERIOR SIDE OF WALL 12" BELOW FINISHED CEILING OR AT BAR JOIST IN AREAS OF EXPOSED STRUCTURE.
   D. REFER TO MANUFACTURER'S WRITTEN INSTRUCTIONS. CHARGE BATTERY TO CHARGE CONTINUOUSLY FOR A MINIMUM OF 24 HOURS BEFORE INITIAL TESTING.
   E. AFTER EMERGENCY LIGHT HAS BEEN POWERED UP, DO NOT TURN OFF FOR EXTENDED PERIODS OF TIME.
3. EXIT SIGNS, EMERGENCY LIGHTS AND NIGHT LIGHTS SHALL NOT BE SWITCHED.
4. IN AREAS OF OPEN STRUCTURE, MOUNT STRIP FIXTURE TO BOTTOM CHORD OF BAR JOIST, UNLESS NOTED OTHERWISE.
5. PROVIDE SEPARATE BOXES FOR GANGED SWITCHES ON SEPARATE BRANCH CIRCUITS.
6. FIXTURES DENOTED WITH "ABJ" ARE TO BE FASTENED ON UNISTRUT CHANNELS MOUNTED TO THE BOTTOM SIDE OF THE TOP CHORD OF BAR JOISTS. LOCATE THE FIXTURES RUNNING PERPENDICULAR TO BAR JOISTS WITHIN BAR JOISTS WEBBING SPACES. DO NOT FASTEN FIXTURE OR UNISTRUT CHANNELS TO ROOF DECK.
7. VERIFY THAT THE OPERATING MECHANISM OF LIGHT SWITCHES IN THE BUILDING ARE MOUNTED AT A HEIGHT THAT IS IN ACCORDANCE WITH ADA AND LOCAL ACCESSIBILITY REQUIREMENTS. ANY SWITCH NOT IN ACCORDANCE WITH ADA AND LOCAL ACCESSIBILITY REQUIREMENTS IS TO BE LOWERED TO THE APPROPRIATE HEIGHT. GENERAL CONTRACTOR SHALL REPAIR WALL AND FINISHES AS REQUIRED. EXISTING CONTROLS AND LIGHTING PATTERNS ARE TO BE MAINTAINED. EXTEND/REROUTE EXISTING BRANCH CIRCUITRY AS REQUIRED.

OCCUPANCY SENSOR NOTES

02.26.14

1. OCCUPANCY SENSORS IN RESTROOMS SHALL BE PROGRAMMED FOR AUTOMATIC ON AND MAXIMUM AVAILABLE TIME DELAY SETTINGS.
2. OCCUPANCY SENSORS IN DELI, PRODUCE, AND BAKERY PREP AREAS SHALL BE PROGRAMMED WITH MAXIMUM AVAILABLE TIME DELAY SETTINGS.
3. OCCUPANCY SENSORS IN WALK-IN COOLERS/FREEZERS SHALL BE LOW TEMPERATURE RATED, WALL MOUNTED IN WP BOX AND PROGRAMMED FOR AUTOMATIC ON AND 10 MINUTE TIME DELAY SETTING
4. ALL OTHER OCCUPANCY SENSORS SHALL BE PROGRAMMED WITH THE MINIMUM AVAILABLE TIME DELAY SETTING UNLESS NOTED OTHERWISE.
5. ALL SINGLE-POLE OCCUPANCY SENSORS SHALL BE PROGRAMMED FOR MANUAL ON LIGHTING CONTROL UNLESS NOTED OTHERWISE.
6. ALL BI-LEVEL OCCUPANCY SENSORS SHALL BE PROGRAMMED FOR AUTOMATIC ON LIGHTING CONTROL FOR 50% OF FIXTURES AND WITH MANUAL ON MODE FOR REMAINING FIXTURES.
7. WHERE TWO OCCUPANCY SENSORS ARE SHOWN IN THE SAME LOCATION WIRE FOR PARALLEL OPERATION.

KEYNOTES

16.125	EXISTING LIGHT FIXTURES TO REMAIN UNLESS NOTED OTHERWISE.
16.131	CONNECT TO EXISTING CIRCUIT.
16.133	EXISTING LIGHT FIXTURES TO BE RELOCATED TO NEW LOCATION AS SHOWN.

EXISTING LIGHTING FIXTURES NOT SHOWN ARE EXISTING TO REMAIN AND ARE NOT AFFECTED BY THE SCOPE OF WORK ON THIS PROJECT. THIS INCLUDES ALL GENERAL LIGHTING, EGRESS LIGHTING AND EXIT LIGHTING.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE

Order Plans @ WWW.LDILine.com

STIPULATION FOR REUSE:
THESE DRAWINGS AND SPECIFICATIONS ARE AND SHALL REMAIN THE PROPERTY OF HENDERSON ENGINEERS, INC. THEY ARE NOT TO BE USED ON ANY OTHER PROJECT OR EXTENSIONS TO THIS PROJECT EXCEPT BY AGREEMENT IN WRITING AND WITH APPROPRIATE COMPENSATION TO HENDERSON ENGINEERS, INC. THEY ARE NOT TO BE LOANED, COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT OF HENDERSON ENGINEERS, INC. VISUAL CONTACT WITH THESE DRAWINGS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS.

CONSULTANTS
HENDERSON ENGINEERS
8345 CLEVELAND AVE. STE 350
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001
WWW.HENDERSONENGINEERS.COM#
KC CORPORATE LIC. C-1662
EXPIRES 12/31/2020

Walmart
SYLVA, NC
STORE NO. 2440.237
2993012440 / PROTO:
DL
2020 SPRB
JOB NUMBER:

ISSUE BLOCK

CHECKED BY:	ES
DRAWN BY	ZM
PROTO CYCLE.	12/20/19
DOCUMENT DATE:	02/24/20

NOT FOR CONSTRUCTION

LIGHTING PLAN

SHEET: E1

VINCENT G. MASILIONIS