## LIGHT FIXTURE SCHEDULE

"OW" FIXTURES AND LAMPS ARE FURNISHED BY THE OWNER FOR INSTALLATION BY THE CONTRACTOR. "GC" FIXTURES AND LAMPS ARE FURNISHED AND INSTALLED BY THE CONTRACTOR.

| TYPE | SUPPLIED BY | DESCRIPTION | VENDOR/MFR | MODEL | VOLTAGE | INPUT VA | COLOR TEMP | LIGHT SOURCE | LAMP QTY | MOUNTING | COUNT |
|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | OW | 8' STRIP (WIRELESS DIM) | ACUITY BRANDS LIGHTING INC | CLX L86 10000LM HEF RDL MVOLT EOHN 40K 80CRI PLR1G AE1CD WH | 120/277 | 67 VA | 4000K | INTEGRAL LED | - | SURFACE | 4 |
| 2 | OW | 4' STRIP (WIRELESS DIM) | ACUITY BRANDS LIGHTING INC | CLX L46 4000LM HEF RDL MVOLT EOHN 40K 80CRI PLR1G AE1CD WH | 120/277 | 28 VA | 4000K | INTEGRAL LED | - | SURFACE | 1 |
| 9 | OW | 2' x 2' VOLUMETRIC TROFFER | CREE INC | ZR22C-4GL-40K-10V-FD | 120/277 | 32 VA | 4000K | INTEGRAL LED | - | RECESSED | 4 |
| 10 | OW | 2' x 4' VOLUMETRIC TROFFER | CREE INC | ZR24M-4GL-40K-10V-FD | 120/277 | 30 VA | 4000K | INTEGRAL LED | - | RECESSED | 26 |
| 11 | GC | LOW-POWERED BUILDING MOUNTED EXTERIOR | LITHONIA LIGHTING GE LIGHTING SOLUTIONS, LLC | WST LED P2 50K VF MVOLT DDBXD EWS3 0 A7 D1 50K 1 DKBZ | 120/277 | 25 VA | 5000K | INTEGRAL LED | - | WALL | 1 |
| 13 | OW | EXIT SIGN (DOUBLE FACE) | ACUITY BRANDS LIGHTING INC | RED: LQM S W 2 R 120/277 EL N SD90 M6 GREEN: LQM S W 2 G 120/277 EL N SD90 M6 | 120/277 | 4 VA | 4000K | INTEGRAL LED | - | STEM / CEILING | 1 |
| 14 | OW | 2' x 4' FLAT PANEL | REXEL INC | P2T44E | 120/277 | 72 VA | 4000K | INTEGRAL LED | - | RECESSED | 20 |
| 15 | OW | EXIT SIGN (SINGLE FACE) | ACUITY BRANDS LIGHTING INC | RED: LQM S W 1 R 120/277 EL N SD90 M6 GREEN: LQM S W 1 G 120/277 EL N SD90 M6 | 120/277 | 4 VA | - | INTEGRAL LED | - | STEM / CEILING | 5 |
| 16 | OW | EXIT SIGN (SINGLE FACE) | ACUITY BRANDS LIGHTING INC | RED: LQM S W 1 R 120/277 EL N SD90 M6 GREEN: LQM S W 1 G 120/277 EL N SD90 M6 | 120/277 | 4 VA | - | INTEGRAL LED | - | WALL | 3 |
| 17 | OW | EMERGENCY LIGHT | REXEL INC | EVHO6IDP-WM | 120/277 | 3 VA | - | INTEGRAL LED | - | WALL | 1 |
| 18 | OW | EMERGENCY LIGHT | REXEL INC | EVHO6IDP-WM | 120/277 | 3 VA | - | INTEGRAL LED | - | WALL / CEILING | 1 |
| 27 | OW | EMERGENCY LIGHT - REMOTE HEADS | REXEL INC | EVHC6IDP-0-WM W EVODW | 120/277 | 3 VA | - | INTEGRAL LED | - | WALL | 1 |
| 65 | OW | 2' VANITY LIGHT | REXEL INC | LLMS-2-L17/835-S-SG-UNV | 120/277 | 21 VA | 3500K | INTEGRAL LED | - | WALL | 15 |

## KEYNOTES

16.125 EXISTING LIGHT FIXTURES TO REMAIN UNLESS NOTED OTHERWISE

16.126 EXISTING LIGHT FIXTURE TO BE DEMOLISHED.

16.129 CONNECT TO EXISTING CIRCUIT PREVIOUSLY SERVING AREA LIGHTING THAT WAS REMOVED. MAINTAIN EXISTING CIRCUIT CONTROL UNLESS NOTED OTHERWISE. PROVIDE CONSTANT HOT FOR EMERGENCY EXIT AND LOCALLY CONTROLLED LIGHT FIXTURES

16.131 CONNECT TO EXISTING CIRCUIT.

16.133 EXISTING LIGHT FIXTURES TO BE RELOCATED TO NEW LOCATION AS SHOWN.

16.492 E.C. SHALL COORDINATE WITH GENERAL CONTRACTOR AND ARCHITECTURAL DEMOLITION PLANS THE EXTENT OF ELECTRICAL DEMOLITION. REMOVE UNUSED DEVICES, BOXES, CONDUITS, AND WIRING BACK TO ORIGINATING JUNCTION BOXES OR PANELBOARDS. REFERENCE POWER PLANS FOR CIRCUITRY TO BE REUSED. DEMOLITION SHALL NOT AFFECT ACTIVE CIRCUITS. IF CIRCUIT IS DEMOLISHED ALL THE WAY TO PANELBOARD, REMOVE CIRCUIT BREAKER AND REPLACE WITH FILLER. UPDATE TYPEWRITTEN CIRCUIT DIRECTION IDENTIFYING CIRCUIT AS "SPACE". COORDINATE EXACT REQUIREMENTS WITH EXISTING CONDITIONS PRIOR TO BID.




FRONT RESTROOM LIGHTING PLAN
1/8" = 1'-0"

CONTRACTOR IS RESPONSIBLE FOR COMPLETE INSTALLATION OF THE LIGHTING SYSTEM AS INDICATED ON PLANS AND/OR AS MODIFIED TO ACCOMMODATE EXISTING OBSTRUCTIONS. IDENTIFY CONFLICTS PRIOR TO ROUGH-IN. WHERE CONFLICTS WITH EXISTING UTILITIES OCCUR, ADJUST FIXTURE LOCATION AS REQUIRED. FIXTURES SHALL BE INSTALLED AS NEAR AS POSSIBLE TO LOCATIONS INDICATED ON PLANS.




6 GM VESTIBULE LIGHTING PLAN
1/8" = 1'-0"

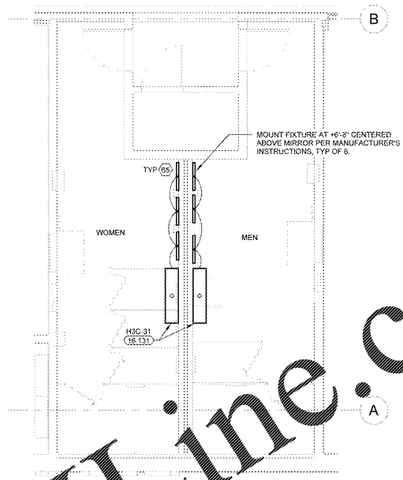


5 GM VESTIBULE LIGHTING DEMO PLAN
1/8" = 1'-0"

CONTRACTOR IS RESPONSIBLE FOR COMPLETE INSTALLATION OF THE LIGHTING SYSTEM AS INDICATED ON PLANS AND/OR AS MODIFIED TO ACCOMMODATE EXISTING OBSTRUCTIONS. IDENTIFY CONFLICTS PRIOR TO ROUGH-IN. WHERE CONFLICTS WITH EXISTING UTILITIES OCCUR, ADJUST FIXTURE LOCATION AS REQUIRED. FIXTURES SHALL BE INSTALLED AS NEAR AS POSSIBLE TO LOCATIONS INDICATED ON PLANS.

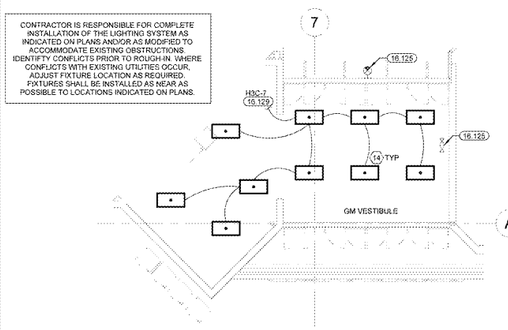


4 GR VESTIBULE LIGHTING PLAN
1/8" = 1'-0"

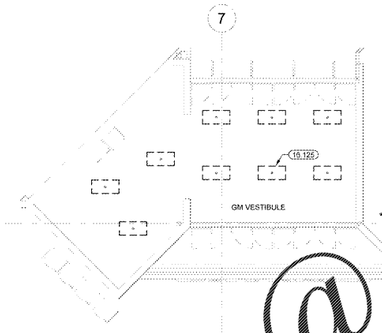


3 GR VESTIBULE LIGHTING DEMO PLAN
1/8" = 1'-0"

CONTRACTOR IS RESPONSIBLE FOR THE COMPLETE INSTALATION OF THE LIGHTING SYSTEM AS INDICATED ON PLANS AND/OR AS MODIFIED TO ACCOMMODATE EXISTING OBSTRUCTIONS. IDENTIFY CONFLICTS PRIOR TO ROUGH-IN. WHERE CONFLICTS WITH EXISTING UTILITIES OCCUR ADJUST FIXTURE LOCATIONS AS REQUIRED. FIXTURES SHALL BE INSTALLED AS NEAR AS POSSIBLE TO LOCATIONS INDICATED ON PLANS WITH EVEN SPACING MAINTAINED.

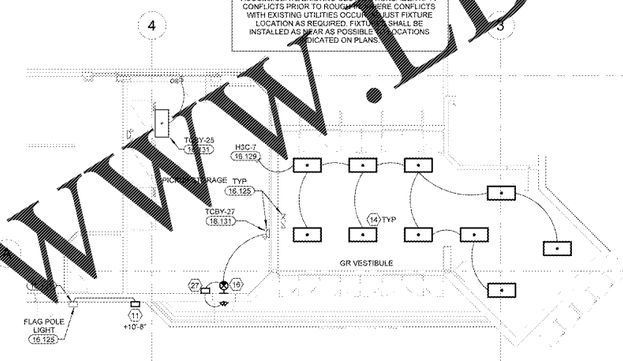


2 REAR AREA LIGHTING PLAN
1/8" = 1'-0"

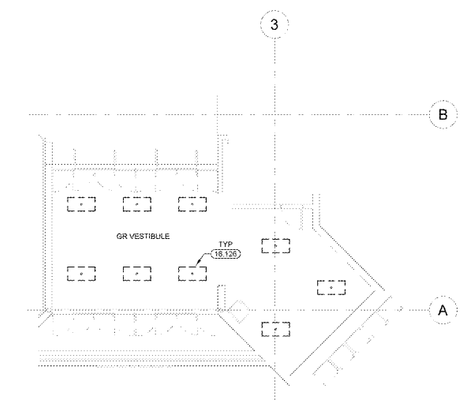


1 REAR AREA LIGHTING DEMO PLAN
1/8" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

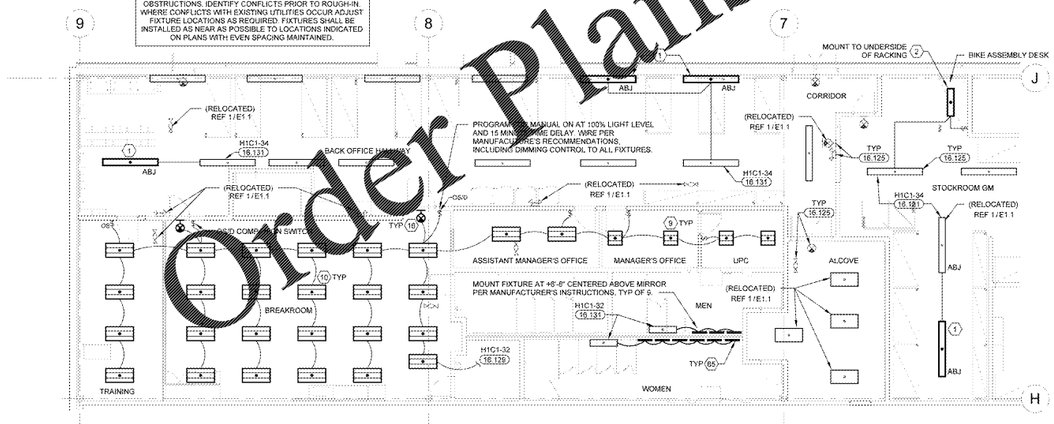EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

Order Plans @ WWW.LDIline.com

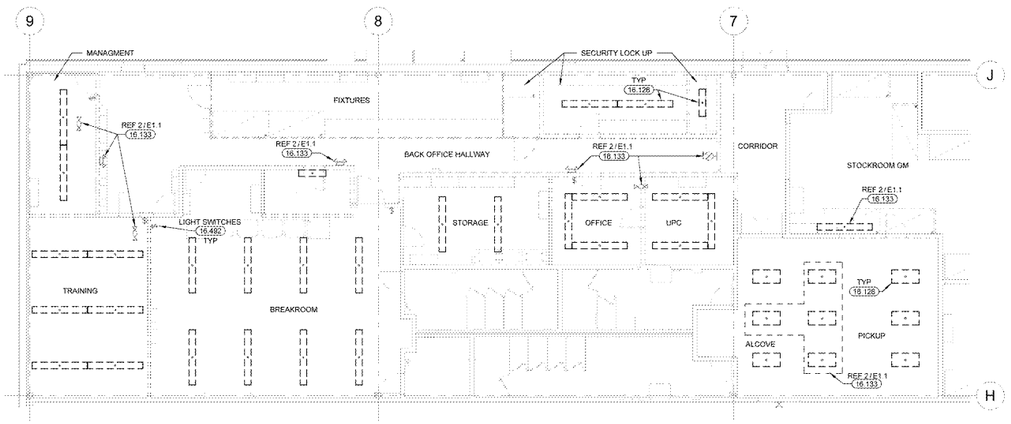STIPULATION FOR REUSE

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHTED WORK OF HENDERSON ENGINEERS AND ARE NOT TO BE USED IN WHOLE OR IN PART FOR ANY PROJECT OTHER THAN THE ONE FOR WHICH THEY HAVE BEEN PREPARED AND DEVELOPED UNLESS PERMISSION IS GRANTED BY HENDERSON ENGINEERS. ANY REUSE WITHOUT WRITTEN PERMISSION AND ADAPTATION BY HENDERSON ENGINEERS FOR THE SPECIFIC PURPOSE INTENDED WILL BE AT USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO HENDERSON ENGINEERS. ALL PROVISIONS OF THIS NOTICE SHALL BE BINDING ON CONTRACTORS, SUBCONTRACTORS AND SUPPLIERS.

CONSULTANTS

HENDERSON ENGINEERS
8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001
WWW.HENDERSONENGINEERS.COM
KS: 2005010480
MO: CORPORATE E-NO. C-1482
EXPIRES 2020

Wal-mart
SYLVA, NC
STORE NO. 2440.237
2993012440 / PROTO:
2020 SPRB
JOB NUMBER: DL

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ES |
| DRAWN BY: | BOE |
| PROTO CYCLE: | 12/20/19 |
| DOCUMENT DATE: | 02/24/20 |

NOT FOR CONSTRUCTION

ENLARGED LIGHTING PLANS

SHEET: E1.1

VINCENT G. MASILIONIS