ARC FLASH

ARC FLASH HAZARD WARNING LABELING REQUIREMENTS PER NEC ARE PROVIDED BY OWNER UNDER SEPARATE CONTRACT

POWER INTERRUPTION NOTE

17.06.18

COORDINATE ALL WORK THAT REQUIRES POWER INTERRUPTIONS TO THE STORE WITH THE STORE MANAGER AND THE WALMART CONSTRUCTION MANAGER A MINIMUM OF 48 HOURS IN ADVANCE OF ALL STORE POWER INTERRUPTIONS. IN ADDITION, IF THE MAIN ELECTRICAL SWITCHGEAR REQUIRES WORK AND DOES NOT HAVE A MAIN SERVICE DISCONNECTING MEANS, COORDINATE WITH THE UTILITY COMPANY A MINIMUM OF TWO WEEKS IN ADVANCE OF THE STORE POWER INTERRUPTION. IF STORE IS NOT OPEN 24 HOURS PER DAY, ALL STORE POWER INTERRUPTIONS ARE TO BE ACCOMPLISHED AFTER NORMAL STORE BUSINESS HOURS. PROVIDE TEMPORARY POWER AS REQUIRED PER SPECIFICATIONS. INSTALLATION OF NEW EQUIPMENT SHALL BE COMPLETED AND THE POWER SYSTEM TESTED AND RE-ENERGIZED PRIOR TO THE TIME ESTABLISHED BY THE STORE MANAGER AND THE WALMART CONSTRUCTION MANAGER.

ONE-LINE DIAGRAM LEGEND

17.09.19

- NEW EQUIPMENT
- EXISTING EQUIPMENT
- EQUIPMENT TO BE DEMOLISHED

NOTE:
ALL OF THE ELECTRICAL DEVICES SHOWN ON THIS DIAGRAM ARE EXISTING AND ARE BASED UPON AS-BUILT DRAWINGS. E.C. SHALL VERIFY THE EXACT EXISTING CONDITIONS, SIZES AND LOCATIONS OF EQUIPMENT PRIOR TO ROUGH-IN. THIS RISER DIAGRAM IS FOR INFORMATIONAL PURPOSES ONLY AND ANY NEW DEVICES ARE SHOWN IN BOLD AND ARE NOTED AS NEW CONSTRUCTION. THE STORE SHALL STAY OPEN FOR BUSINESS. ANY NECESSARY POWER DOWNTIME SHALL BE SCHEDULED AND APPROVED BY WALMART CONSTRUCTION MANAGER.

GENERAL POWER NOTES

02.28.14

1. TELEPOWER POLE(S): MOUNT JUNCTION BOX(ES) TO TOP SIDE OF BOTTOM CHORD OF BAR JOIST. INSTALL FURNISHED POWER POLE AND TERMINATE WIRING TO JUNCTION BOX. PROVIDE UNISTRUT SUPPORTS AND HARDWARE TO SECURE TELEPOWER POLE PLUMB TO BUILDING STRUCTURE. REF POWER POLE CONNECTION DETAIL.
2. PROVIDE LIQUID-TIGHT FLEXIBLE METAL CONDUIT AND WIRING FROM DISCONNECT SWITCH OR JUNCTION BOX TO EQUIPMENT KNOCKOUT OR ELECTRICAL CONNECTION POINT.
3. WHERE EQUIPMENT NAMEPLATE PROTECTIVE DEVICE RATING DIFFERS FROM SIZE PROVIDED, NOTIFY WALMART CONSTRUCTION MANAGER IMMEDIATELY TO COORDINATE RESOLUTION.
4. ELECTRONIC FIRE PROTECTION/SECURITY ALARM BOXES AND CONDUITS SHOWN ON POWER PLANS SHALL BE PROVIDED UNDER THIS CONTRACT. IN ADDITION, UNLESS NOTED OTHERWISE, THE FOLLOWING GENERAL NOTES APPLY:
   A. ALL ALARM JUNCTION BOXES SHALL BE 4"X4"X2-1/8" MINIMUM.
   B. ALARM CONDUITS SHALL BE 3/4" MINIMUM WITH PULL WIRE AND INSULATING BUSHINGS AT END VERTICAL FLOORWAY RUN.
   C. VERTICAL RACEWAYS FROM ALARM BOXES SHALL BE EITHER CONCEALED INSIDE WALL OR SURFACE MOUNTED (TO MATCH JUNCTION BOX MOUNTING). ALL VERTICAL RUNS SHALL BE TURNED 90 DEGREES AT TOP SIDE OF BOTTOM CHORD OF BAR JOIST AND EXTENDED HORIZONTALLY TO A LOCATION ACCESSIBLE BY VERTICAL FLOOR TYPE LIFT.
5. UPON COMPLETION OF ELECTRICAL INSTALLATION AND PRIOR TO ENERGIZING CIRCUIT:
   A. INSPECT WIRE AND CABLE FOR PHYSICAL DAMAGE.
   B. PERFORM CONTINUITY TEST.
   C. VERIFY PROPER PHASING CONNECTION TO ALL THREE PHASE MOTOR LOADS.

KEYNOTES

16.201 EXTERIOR SIGN POWER. WHERE ELECTRICAL CONNECTIONS FOR SIGNAGE OCCUR BELOW ROOF LINE, MOUNT JUNCTION BOX(ES) TO WALL AT SIGN CONNECTION POINT AND PROVIDE 3/4" CONDUIT TO CONTROL BOX FOR LOW VOLTAGE WIRING (INSTALLED BY OTHERS). REFER TO ARCHITECTURAL DRAWINGS FOR EXACT SIGN LOCATION(S) PRIOR TO INSTALLATION. WHERE ELECTRICAL CONNECTIONS FOR SIGNAGE OCCUR ABOVE ROOF LINE, PROVIDE UNISTRUT TO MOUNT JUNCTION BOXES TO BACK SIDE OF PARAPET AND PROVIDE 3/4" CONDUIT TO CONTROL BOX FOR LOW VOLTAGE WIRING (INSTALLED BY OTHERS). PROVIDE ONLY ONE PENETRATION THROUGH THE ROOF. REF ARCHITECTURAL EXTERIOR WALL SECTIONS AND SIGN ATTACHMENT FOR ROOF AND PARAPET PENETRATION REQUIREMENTS.

16.489 RELOCATE, EXTEND, AND RECONNECT CIRCUITRY AND ELECTRICAL DEVICES FOR RELOCATED AND/OR NEW EQUIPMENT. VERIFY CONDITION OF BRANCH CIRCUITRY, CONDUIT AND WIRE TO ENSURE THEY MEET ALL U.L. RATINGS AND REPLACE AS REQUIRED. VERIFY FINAL LOCATION OF RELOCATED/NEW EQUIPMENT WITH WALMART CONSTRUCTION MANAGER PRIOR TO ROUGH-IN.

16.492 E.C. SHALL COORDINATE WITH GENERAL CONTRACTOR AND ARCHITECTURAL DEMOLITION PLANS THE EXTENT OF ELECTRICAL DEMOLITION. REMOVE UNUSED DEVICES, BOXES, CONDUITS, AND WIRING BACK TO ORIGINATING JUNCTION BOXES OR PANELBOARDS. REFERENCE POWER PLANS FOR CIRCUITRY TO BE RELISED. DEMOLITION SHALL NOT AFFECT ACTIVE CIRCUITS. IF CIRCUIT IS DEMOLISHED ALL THE WAY TO PANELBOARD, REMOVE CIRCUIT BREAKER AND REPLACE WITH FILLER PLATE. UPDATE TYPEWRITTEN CIRCUIT DIRECTORY IDENTIFYING CIRCUIT AS "SPACE". COORDINATE EXACT REQUIREMENTS WITH EXISTING CONDITIONS PRIOR TO BID.

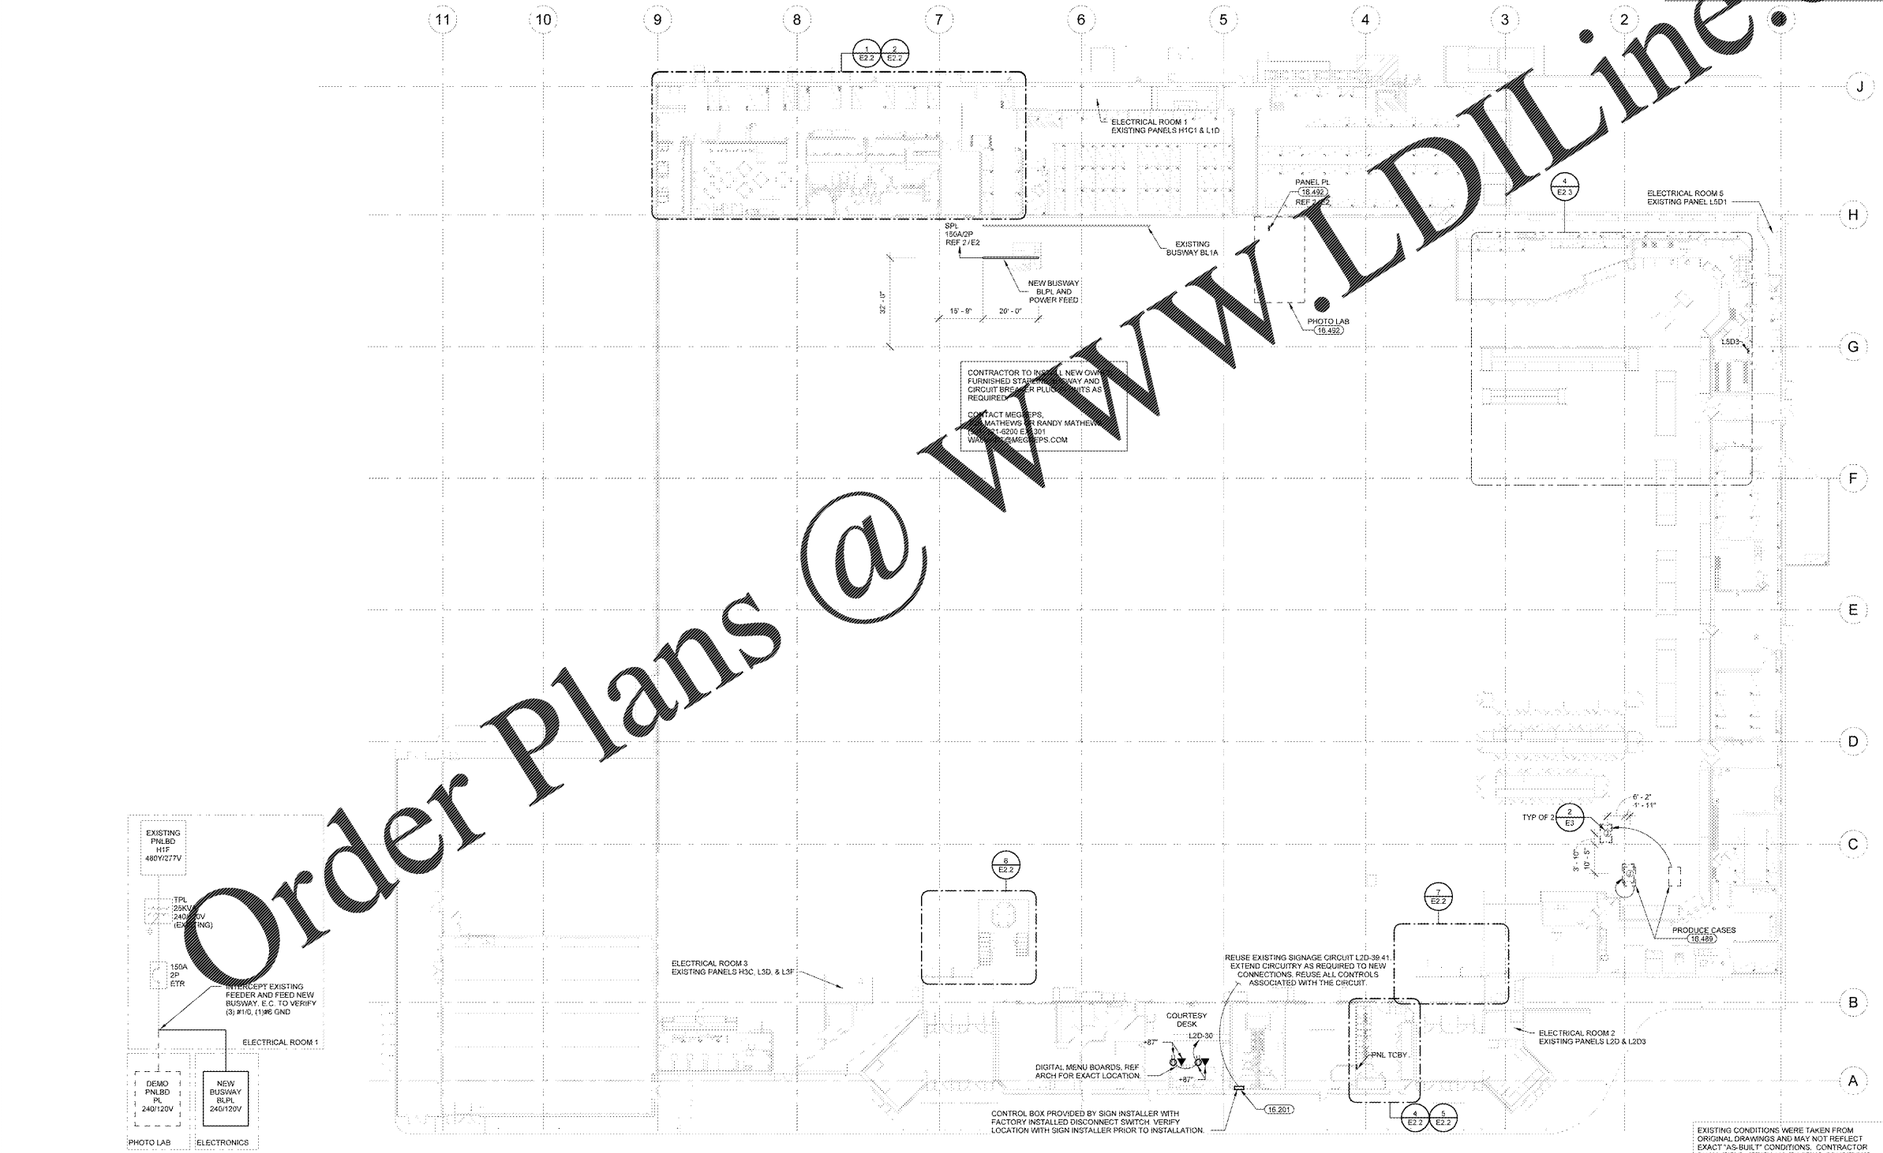

2 PARTIAL ONE-LINE DIAGRAM
NTS

1 POWER PLAN
1" = 20'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE

Order Plans @ WWW.LDILine.com

STIPULATION FOR REUSE:
THESE DRAWINGS AND SPECIFICATIONS ARE AND SHALL REMAIN THE PROPERTY OF HENDERSON ENGINEERS WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT. THEY ARE NOT TO BE USED ON ANY OTHER WORK EXCEPT BY AGREEMENT WITH HENDERSON ENGINEERS. THEY ARE NOT TO BE LOANED, COPIED OR OTHERWISE DISPOSED OF WITHOUT WRITTEN PERMISSION OF HENDERSON ENGINEERS. ALL COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS, INCLUDING COPYRIGHT, ARE HEREBY RESERVED.

CONSULTANTS
HENDERSON ENGINEERS
3300 GILCHRIST RD. STE 330
LENEXA, KS 66214
TEL 913.782.5000 FAX 913.782.5001
WWW.HENDERSONENGINEERS.COM
KC CORPORATION NO. C-1662
EXPIRES: 12/31/2020

Walmart
SYLVA, NC
STORE NO. 2440.237
2993012440 / PROTO:
DL
2020 SPRB
JOB NUMBER:

ISSUE BLOCK

CHECKED BY:	ES
DRAWN BY:	BOE
PROTO CYCLE:	12/20/19
DOCUMENT DATE:	02/24/20

NOT FOR CONSTRUCTION

POWER PLAN

SHEET:
E2

VINCENT G. MASILIONIS