

GENERAL REFRIGERATION ELECTRICAL NOTES

- COORDINATE ALL WORK WITH REFRIGERATION CONTRACTOR (R.C.) PRIOR TO INSTALLATION.
- REFRIGERATED CASES, E.C. SHALL PROVIDE CONDUIT AND WIRE FOR REFRIGERATED CASE FANS, LIGHTS AND ANTI-SWEAT HEATERS (AND IF APPLICABLE) ELECTRICAL DEFROST. PROVIDE ADEQUATE CONDUIT LENGTH TO ALLOW TERMINATION. NEATLY BUNDLE CIRCUITS AND CLEARLY TAG AND LABEL EACH CIRCUIT WITH BRANCH CIRCUIT DESIGNATION AND REFRIGERATION SYSTEM NUMBER FOR FINAL TERMINATION AT CASE BY R.C. REF CASE CONNECTION WIRING DETAIL.
- NEW CASES ARE PROVIDED WITH A FACTORY INSTALLED TERMINAL STRIP AND JUMPERS FOR CONNECTION TO A SINGLE CIRCUIT FOR 120V CASE LOADS. R.C. SHALL REMOVE FACTORY INSTALLED JUMPERS AS REQUIRED TO UTILIZE EXISTING SEPARATE 120V FAN/LIGHT/ANTI-SWEAT CIRCUITS AS INDICATED ON PLANS AND/OR PANELBOARD SCHEDULES. ANY EXISTING ANTI-SWEAT CONTROL DEVICES SHALL BE BY-PASSED. CASES UTILIZING ELECTRICAL DEFROST WILL BE PROVIDED WITH SEPARATE TERMINATIONS AT THE TERMINAL STRIP FOR CONNECTION TO THE 208V ELECTRICAL SYSTEM. R.C. SHALL MAKE FINAL CONNECTIONS OF 120V AND 208V POWER CIRCUITS AT CASE TERMINAL STRIP. REFER TO CASE CONNECTION SCHEMATIC ON REFRIGERATION SHEETS.
- IF AN UNDERSLAB CIRCUIT IS PROVIDED FOR REFRIGERATED CASE FANS (CF) AND (IF APPLICABLE) ELECTRICAL DEFROST (ED), PROVIDE ADEQUATE CONDUIT LENGTH TO ALLOW TERMINATION. NEATLY BUNDLE CIRCUITS AND CLEARLY TAG AND LABEL EACH CIRCUIT WITH BRANCH CIRCUIT DESIGNATION AND REFRIGERATION SYSTEM NUMBER FOR FINAL TERMINATION AT COIL BY R.C. REF EVAPORATOR COIL WIRING DETAIL.
- ROUTE REFRIGERATED CASE AND WALK-IN UNIT COIL FAN, LIGHTS, ANTI-SWEAT AND DEFROST BRANCH CIRCUITS TO WIRERAYS PROVIDED AT REFRIGERATION EQUIPMENT AND/OR PANELBOARDS AS REQUIRED.
- REFRIGERATED CASE WIRING COMPARTMENT REPRESENTED ON DRAWING BY JUNCTION BOX.
- KEEP PENETRATIONS THROUGH WALK-IN UNITS TO A MINIMUM. ROUTE ALL CONDUITS SERVING FREEZERS AND COOLERS ON INSIDE OF BOX.
- ALL CONDUITS INSTALLED ON TOP OF WALK-IN UNITS SHALL BE A MINIMUM OF 6" FROM ANY EDGE TO ALLOW SPACE FOR EDGE PROTECTION NETTING. DO NOT ROUTE CONDUITS ABOVE THE CEILING GRID ACCESS UNLESS CONDUITS ARE INSTALLED IN JOIST SPACE. REF ARCH.
- UNDERSLAB CIRCUITS SHALL NOT BE ROUTED UNDER WALK-IN FREEZERS AND SHALL BE ROUTED ABOVE REFRIGERANT LINES WHERE THEY CROSS.
- CIRCUITS FOR REFRIGERATED CASES SERVED BY UNDERSLAB REFRIGERATION PIPING ARE TO BE ROUTED UNDERSLAB AND EXTENDED TO THE FIRST CASE IN EACH SYSTEM. WIRING AND CONDUIT FOR SLAVE WIRING BETWEEN CASES SHALL BE PROVIDED BY R.C. REFER TO UNDERSLAB CASE CONNECTION WIRING DETAIL.
- ALL UNDERSLAB CONDUITS SHALL BE 3/4" MIN.
- CIRCUITS FOR REFRIGERATED CASES SERVED BY OVERHEAD REFRIGERATION PIPING ARE TO BE ROUTED DOWN FROM STRUCTURE AT THE SAME LOCATION AS THE REFRIGERATION PIPING AND EXTENDED TO THE FIRST CASE IN EACH SYSTEM. WIRE AND CONDUIT FOR SLAVE WIRING BETWEEN CASES SHALL BE PROVIDED BY THE R.C. REFER TO OVERHEAD CASE CONNECTION WIRING DETAIL.
- ON GROUPS OF THREE OR MORE REFRIGERATED CASES WITH ELECTRIC DEFROST, R.C. SHALL CONNECT CASES TO CREATE A THREE-PHASE HEATER CIRCUIT. HEATER LOADS SHALL BE BALANCED BETWEEN PHASES AS EVENLY AS POSSIBLE. REF CASE DEFROST WIRING DETAIL.
- PROVIDE A SEPARATE NEUTRAL FOR EACH BRANCH CIRCUIT SERVING REFRIGERATED CASES OR WALK-IN UNITS AS INDICATED ON PLANS.
- PROVIDE CIRCUIT BREAKER LOCKING DEVICE (LOCK-OFF FOR MAINTENANCE) ON NEW AND/OR EXISTING CIRCUIT BREAKERS SERVING REFRIGERATED CASE ANTI-SWEAT HEATERS OR DRAIN HEATERS.
- REFERENCE ARCHITECTURAL DEMOLITION PLANS FOR FULL EXTENT OF DEMOLITION WORK REQUIRED.

KEYNOTES

- 18.710 BUILDING AUTOMATION CONDUITS: PROVIDE 1" (UNLESS NOTED OTHERWISE) CONDUIT (WITH FULL WIRE ROUTED FROM 8" ABOVE BOTTOM OF BAR JOIST IN SALES FLOOR ACCESSIBLE CEILING SPACE THROUGH PVC CHASE).
- 18.711 POINT OF TRANSITION FROM EMT TO FLEX: PROVIDE CONDUIT AND BRANCH CIRCUITS FOR REFRIGERATED CASE FANS, LIGHTS, ANTI-SWEAT HEATERS, AND ELECTRICAL DEFROST (IF REQUIRED). TERMINATION TO REFRIGERATED CASE ELECTRICAL CONNECTION POINT BY R.C. REFER TO CASE CONNECTION WIRING DETAIL.

STIPULATION FOR REUSE
 THIS DRAWING AND ANY INFORMATION CONTAINED HEREIN IS THE PROPERTY OF HENDERSON ENGINEERS. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREON. IT IS NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF HENDERSON ENGINEERS. THIS DRAWING IS NOT VALID FOR CONSTRUCTION UNLESS IT IS USED IN CONJUNCTION WITH THE CONTRACT AND SPECIFICATIONS FOR THE PROJECT IDENTIFIED HEREON.

CONSULTANTS
HENDERSON ENGINEERS
 2005 LENOX DRIVE SUITE 200
 SYLVANA, NC 27578
 TEL 919 322 2466 FAX 919 322 2001
 WWW.HENDERSONENGINEERS.COM
 HENDERSON ENGINEERS, INC. C-1482
 N.C. CONTRACTOR LICENSE NO. 05-1002-0000-0000
 N.C. CONTRACTOR LICENSE NO. 05-1002-0000-0000

Walmart
 SYLVANA, NC
 STORE NO. 2440 237
 2866374440 | PHOTO:
 JOB NUMBER: 2866374440

ISSUE BLOCK


NO.	DESCRIPTION	DATE

CHECKED BY: ES
 DRAWN BY: BOE
 PHOTO CYCLE: 12/26/19
 DOCUMENT DATE: 02/24/20


NOT FOR CONSTRUCTION

REFRIGERATION ELECTRICAL PLAN

SHEET: RE1

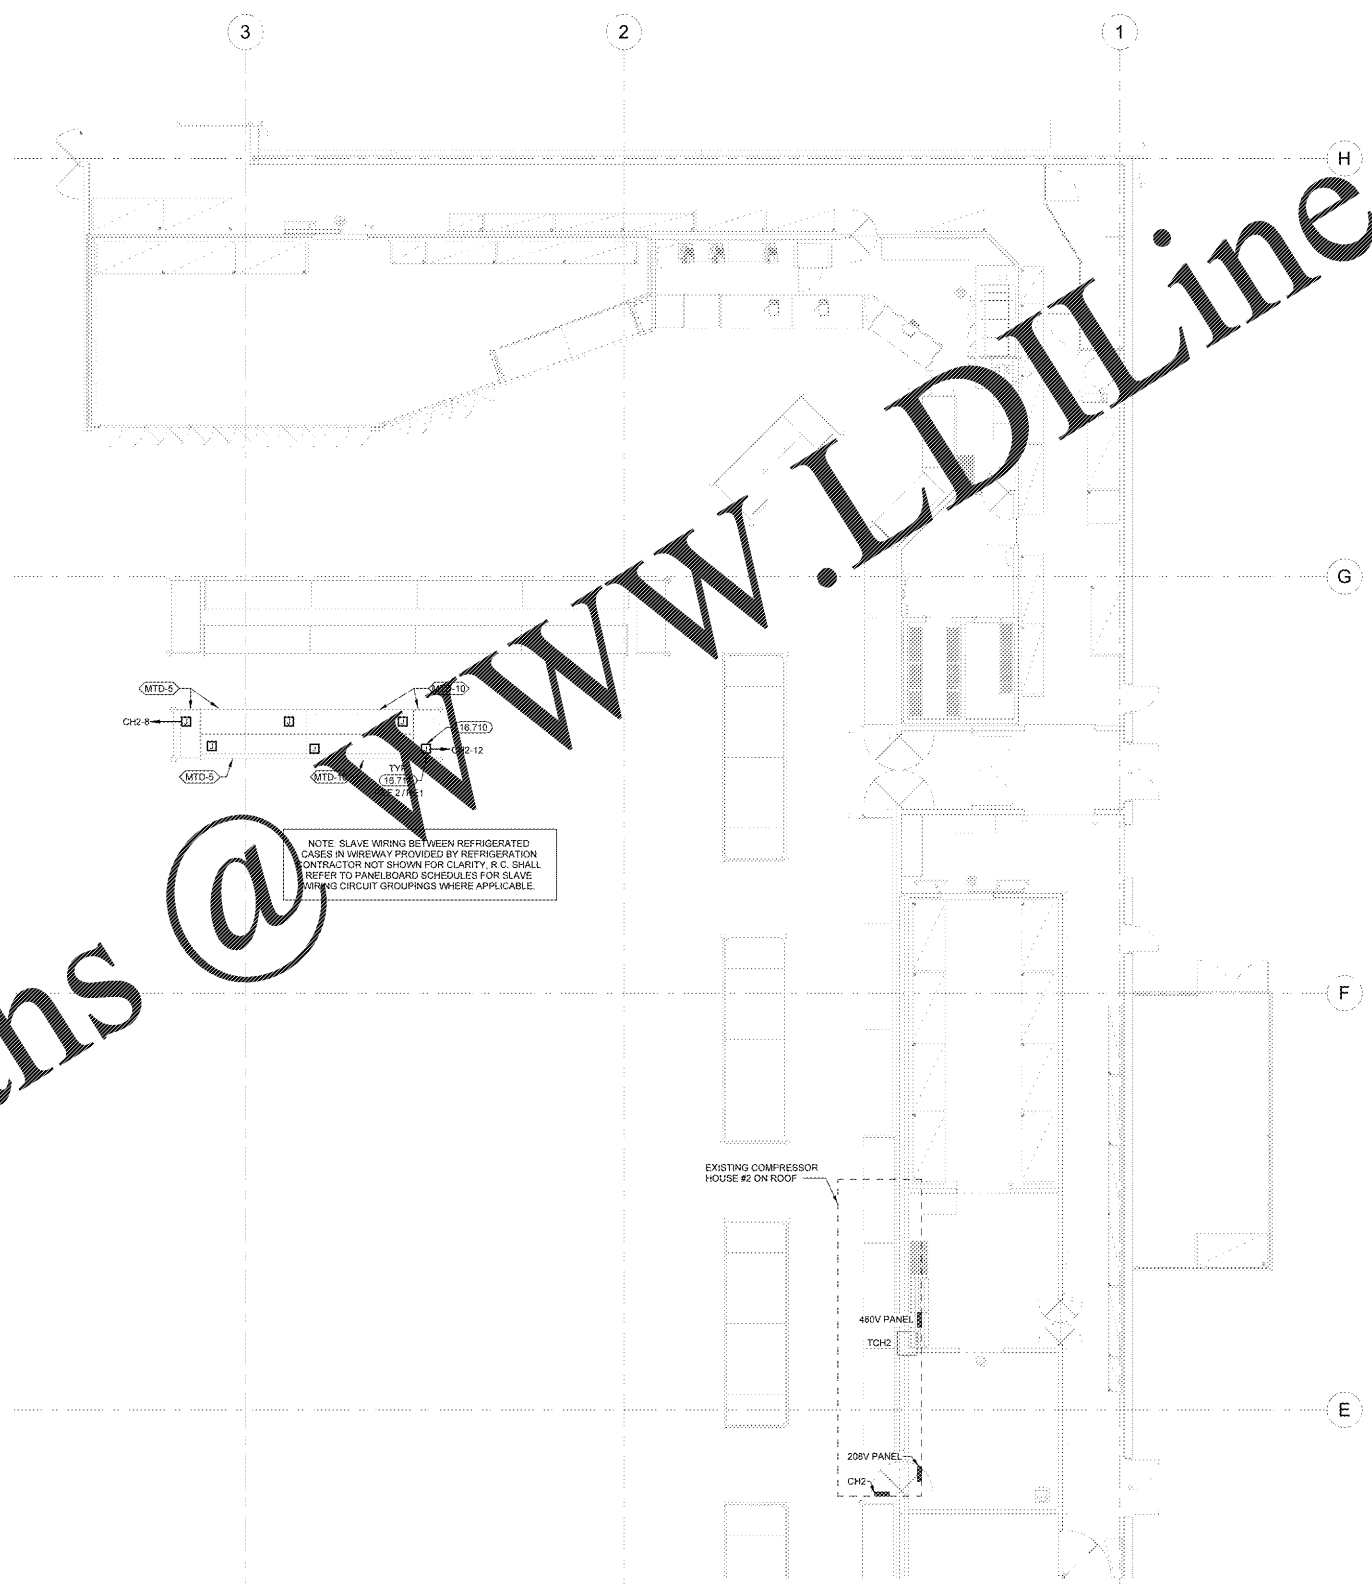

NOTE: SLAVE WIRING BETWEEN REFRIGERATED CASES IN WIRERAY PROVIDED BY REFRIGERATION CONTRACTOR NOT SHOWN FOR CLARITY. R.C. SHALL REFER TO PANELBOARD SCHEDULES FOR SLAVE WIRING CIRCUIT GROUPINGS WHERE APPLICABLE.

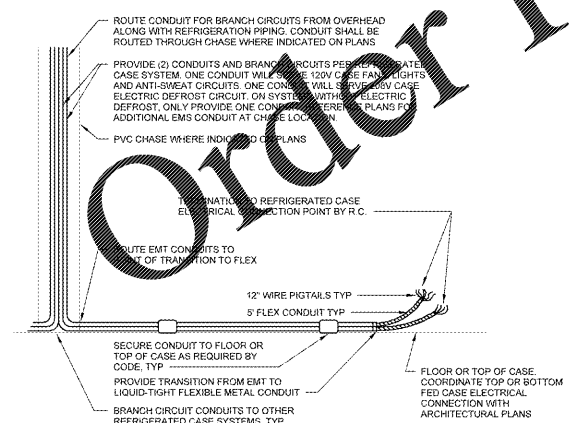

2 OVERHEAD CASE CONNECTION WIRING
 1/2" = 1'-0"

1 REFRIGERATION ELECTRICAL PLAN
 1/8" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELVES WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.