



ELECTRICAL CONTRACTOR NOTES:

1. TO MICROSWITCH LOCATED IN FRYER/GRIDDLE HOOD. CONTACT TO BE NORMALLY CLOSED IN THE COCKED POSITION. (120VAC WIRING, USE #14 AWG)
2. TO MICROSWITCH LOCATED IN CHAIN BROILER HOOD. CONTACT TO BE NORMALLY CLOSED IN THE COCKED POSITION. (120VAC WIRING, USE #14 AWG)
3. TO MICROSWITCH LOCATED IN OVEN HOOD. CONTACT TO BE NORMALLY CLOSED IN THE COCKED POSITION. (120VAC WIRING, USE #14 AWG)

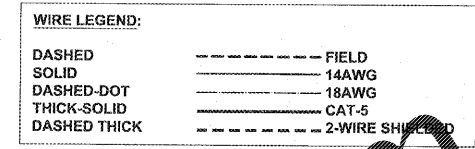

VERY IMPORTANT NOTE:
 THE GENERAL CONTRACTOR IS RESPONSIBLE FOR ALL FIELD WIRING SHOWN ON THIS DRAWING.

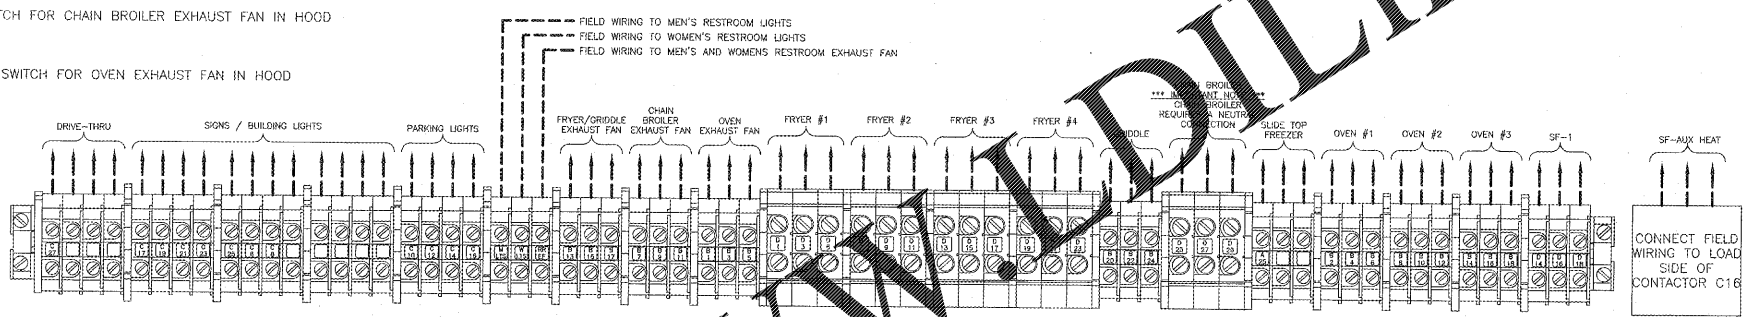

WWW.DILine.com

CAROLINA PRODUCTS, INC.
 1132 PRO AM DR.
 CHARLOTTE, NC 28211
 PH.(704)364-9029 , FX.(704)367-1215

CPI
 CAROLINA PRODUCTS, INC.
 CONTROL AND POWER INTEGRATION

FOR REFERENCE ONLY



THIS DRAWING IS THE PROPERTY OF CAROLINA PRODUCTS, INC. AND MAY NOT BE USED OR REPRODUCED WITHOUT THE WRITTEN PERMISSION OF CAROLINA PRODUCTS, INC.



1 FIELD CONNECTIONS: HIGH VOLTAGE WIRING - 120VAC OR 208VAC BY GENERAL CONTRACTOR

CPI-TERMINAL BLOCK LABELING

TERMINAL NAME	DESTINATION AT RTU
RC	24V AC FROM RTU
W1	STD: HTG STAGE 1; HP: AUX HEAT
W2	STD: HTG STAGE 2; HP: REVERSING VALVE
Y1	STD: CLG STAGE 1; HP: COMPRESSOR #1
Y2	STD: CLG STAGE 2; HP: COMPRESSOR #2
G	RTU FAN

MECHANICAL CONTRACTOR NOTES:

4. TO NORMALLY CLOSED CONTACT IN SMOKE DETECTOR FOR RTU-1 LOCATED IN THE RETURN AIR DUCT. (24VAC WIRING)
5. TO NORMALLY CLOSED CONTACT IN SMOKE DETECTOR FOR RTU-2 LOCATED IN THE RETURN AIR DUCT. (24VAC WIRING)
6. TO NORMALLY CLOSED CONTACT IN SMOKE DETECTOR FOR RTU-3 LOCATED IN THE RETURN AIR DUCT. (24VAC WIRING)

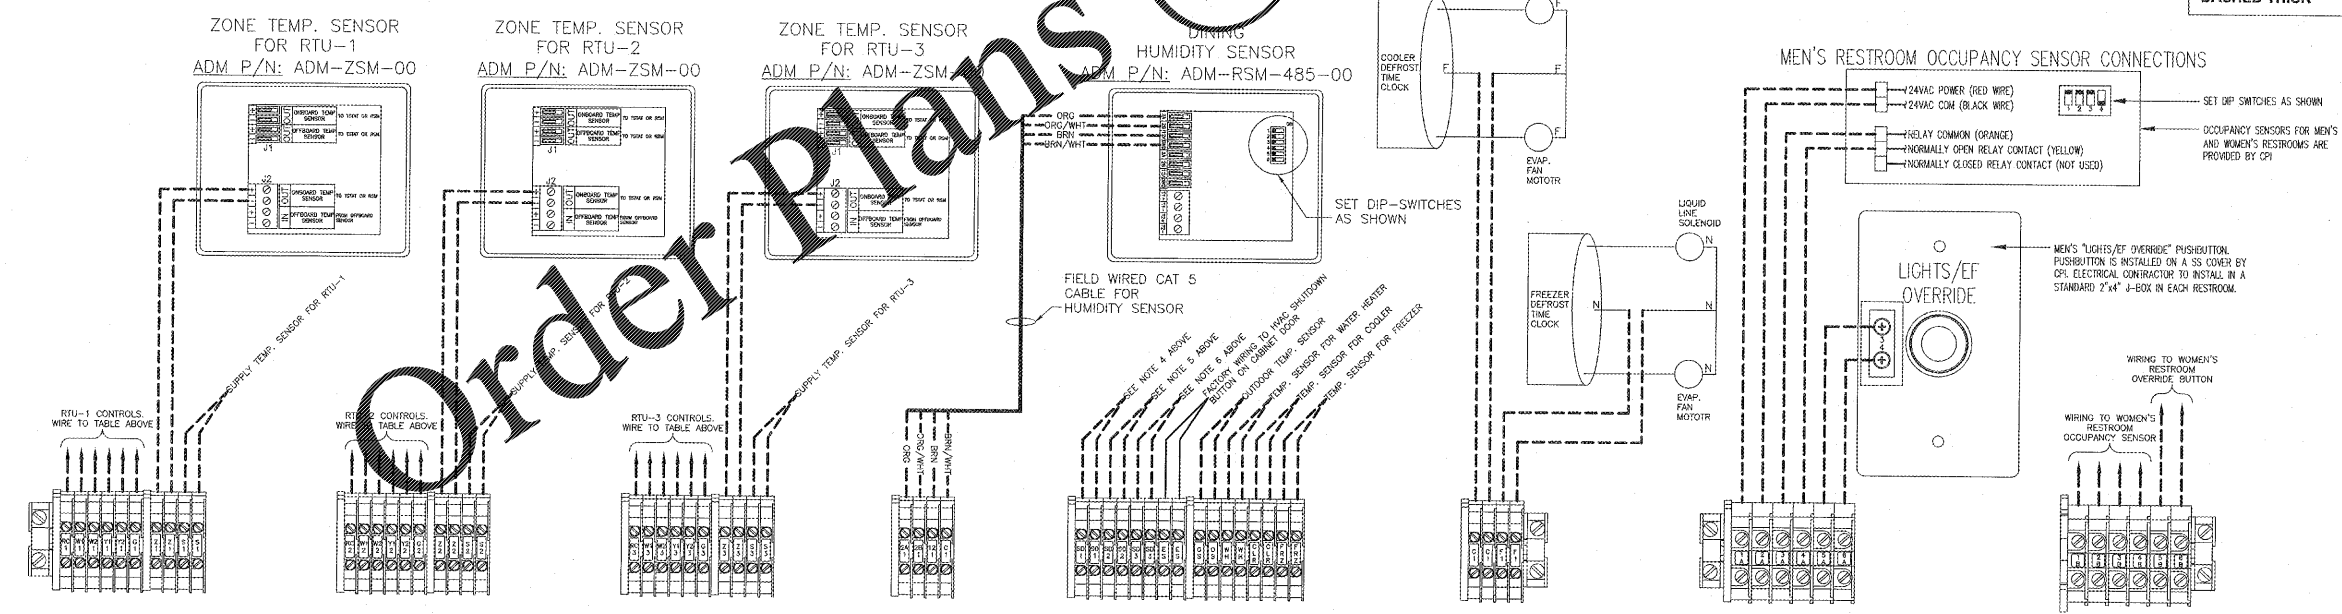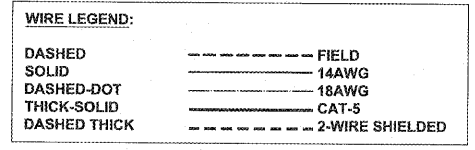

2 FIELD CONNECTIONS: LOW VOLTAGE WIRING - 24VAC OR SENSORS BY GENERAL CONTRACTOR

3 120VAC COOLER & FREEZER WIRING BY GENERAL CONTRACTOR

4 24VAC OCCUPANCY SENSOR WIRING BY GENERAL CONTRACTOR

HARDEE'S: BODDIE NOELL ENTERPRISES
 DISPUTANTA, VA (PRINCE GEORGE)
 FIELD CONNECTIONS TO TERMINAL BLOCKS

BODDIE-NOELL ENTERPRISES, INC.
 P.O. BOX 808
 ROCKY MOUNT, NC
 27802-8008
 (252) 807-2800



REVISIONS

NO.	DATE	DESCRIPTION

DRAWN BY: _____ CHECKED BY: _____

FIELD CONN. TO TERMINAL BLOCKS

CPI PROJECT # 24588A
 CPI DRAWING # BNE-24588A
 SHEET: 1.1
 DATE: 8/19/19
 DRAWN BY: AJW

DATE: 9-4-2019
 SHEET NUMBER: CPI-1.1

12252_CPI-1.1.dwg 8/19/19 10:13:43 AM