


Sheet Template ID: CFE-F-07-B
 File: Z:\Projects\4802_South Charlotte Hyundai Redesign\480206 PARTIAL FIRST FLOOR WATER PIPING PLAN SALES; Plotted: 3/1/2020 4:29 PM by ALEX E. LEIKEN; Saved: 3/1/2020 4:12 PM by DPAYNE

in+EGRA
 an Integra Architecture, PLLC DBA
 110 East Kingston Avenue, Ste. 20
 Charlotte, NC 28203
 704.372.0001
 www.in+egra.com

THE DRAWINGS & WRITTEN MATERIAL HEREIN CONSTITUTE ORIGINAL WORK OF THE ARCHITECT, & AS SUCH, ARE SUBJECT TO COPYRIGHT & MAY NOT BE REPRODUCED, TRANSMITTED, STORED IN RETRIEVAL SYSTEMS OR USED IN ANY WAY WITHOUT EXPRESS WRITTEN CONSENT OF THE ARCHITECT
 © 2020



Seals: _____

VP ENGINEERING
 Mechanical Electrical Plumbing
 VRETOS PAPPAS
 CONSULTING ENGINEERS, P.A.
 PO Box 23847, Charlotte, NC 28221
 2015 Coliseum Road, Suite 180
 Charlotte, NC 28227
 704.372.1785
 www.vpsa.com
 CORPORATE NC LICENSE #C-2409

Revisions:

Number	Date	Description


Project Title:
SOUTH CHARLOTTE HYUNDAI

Project No.: **4802.00**

Drawing Title:
PARTIAL FIRST FLOOR WATER PIPING PLAN - SALES

SET ISSUE DATE
 ▶ MAR 4, 2020 ◀


Sheet:
P6

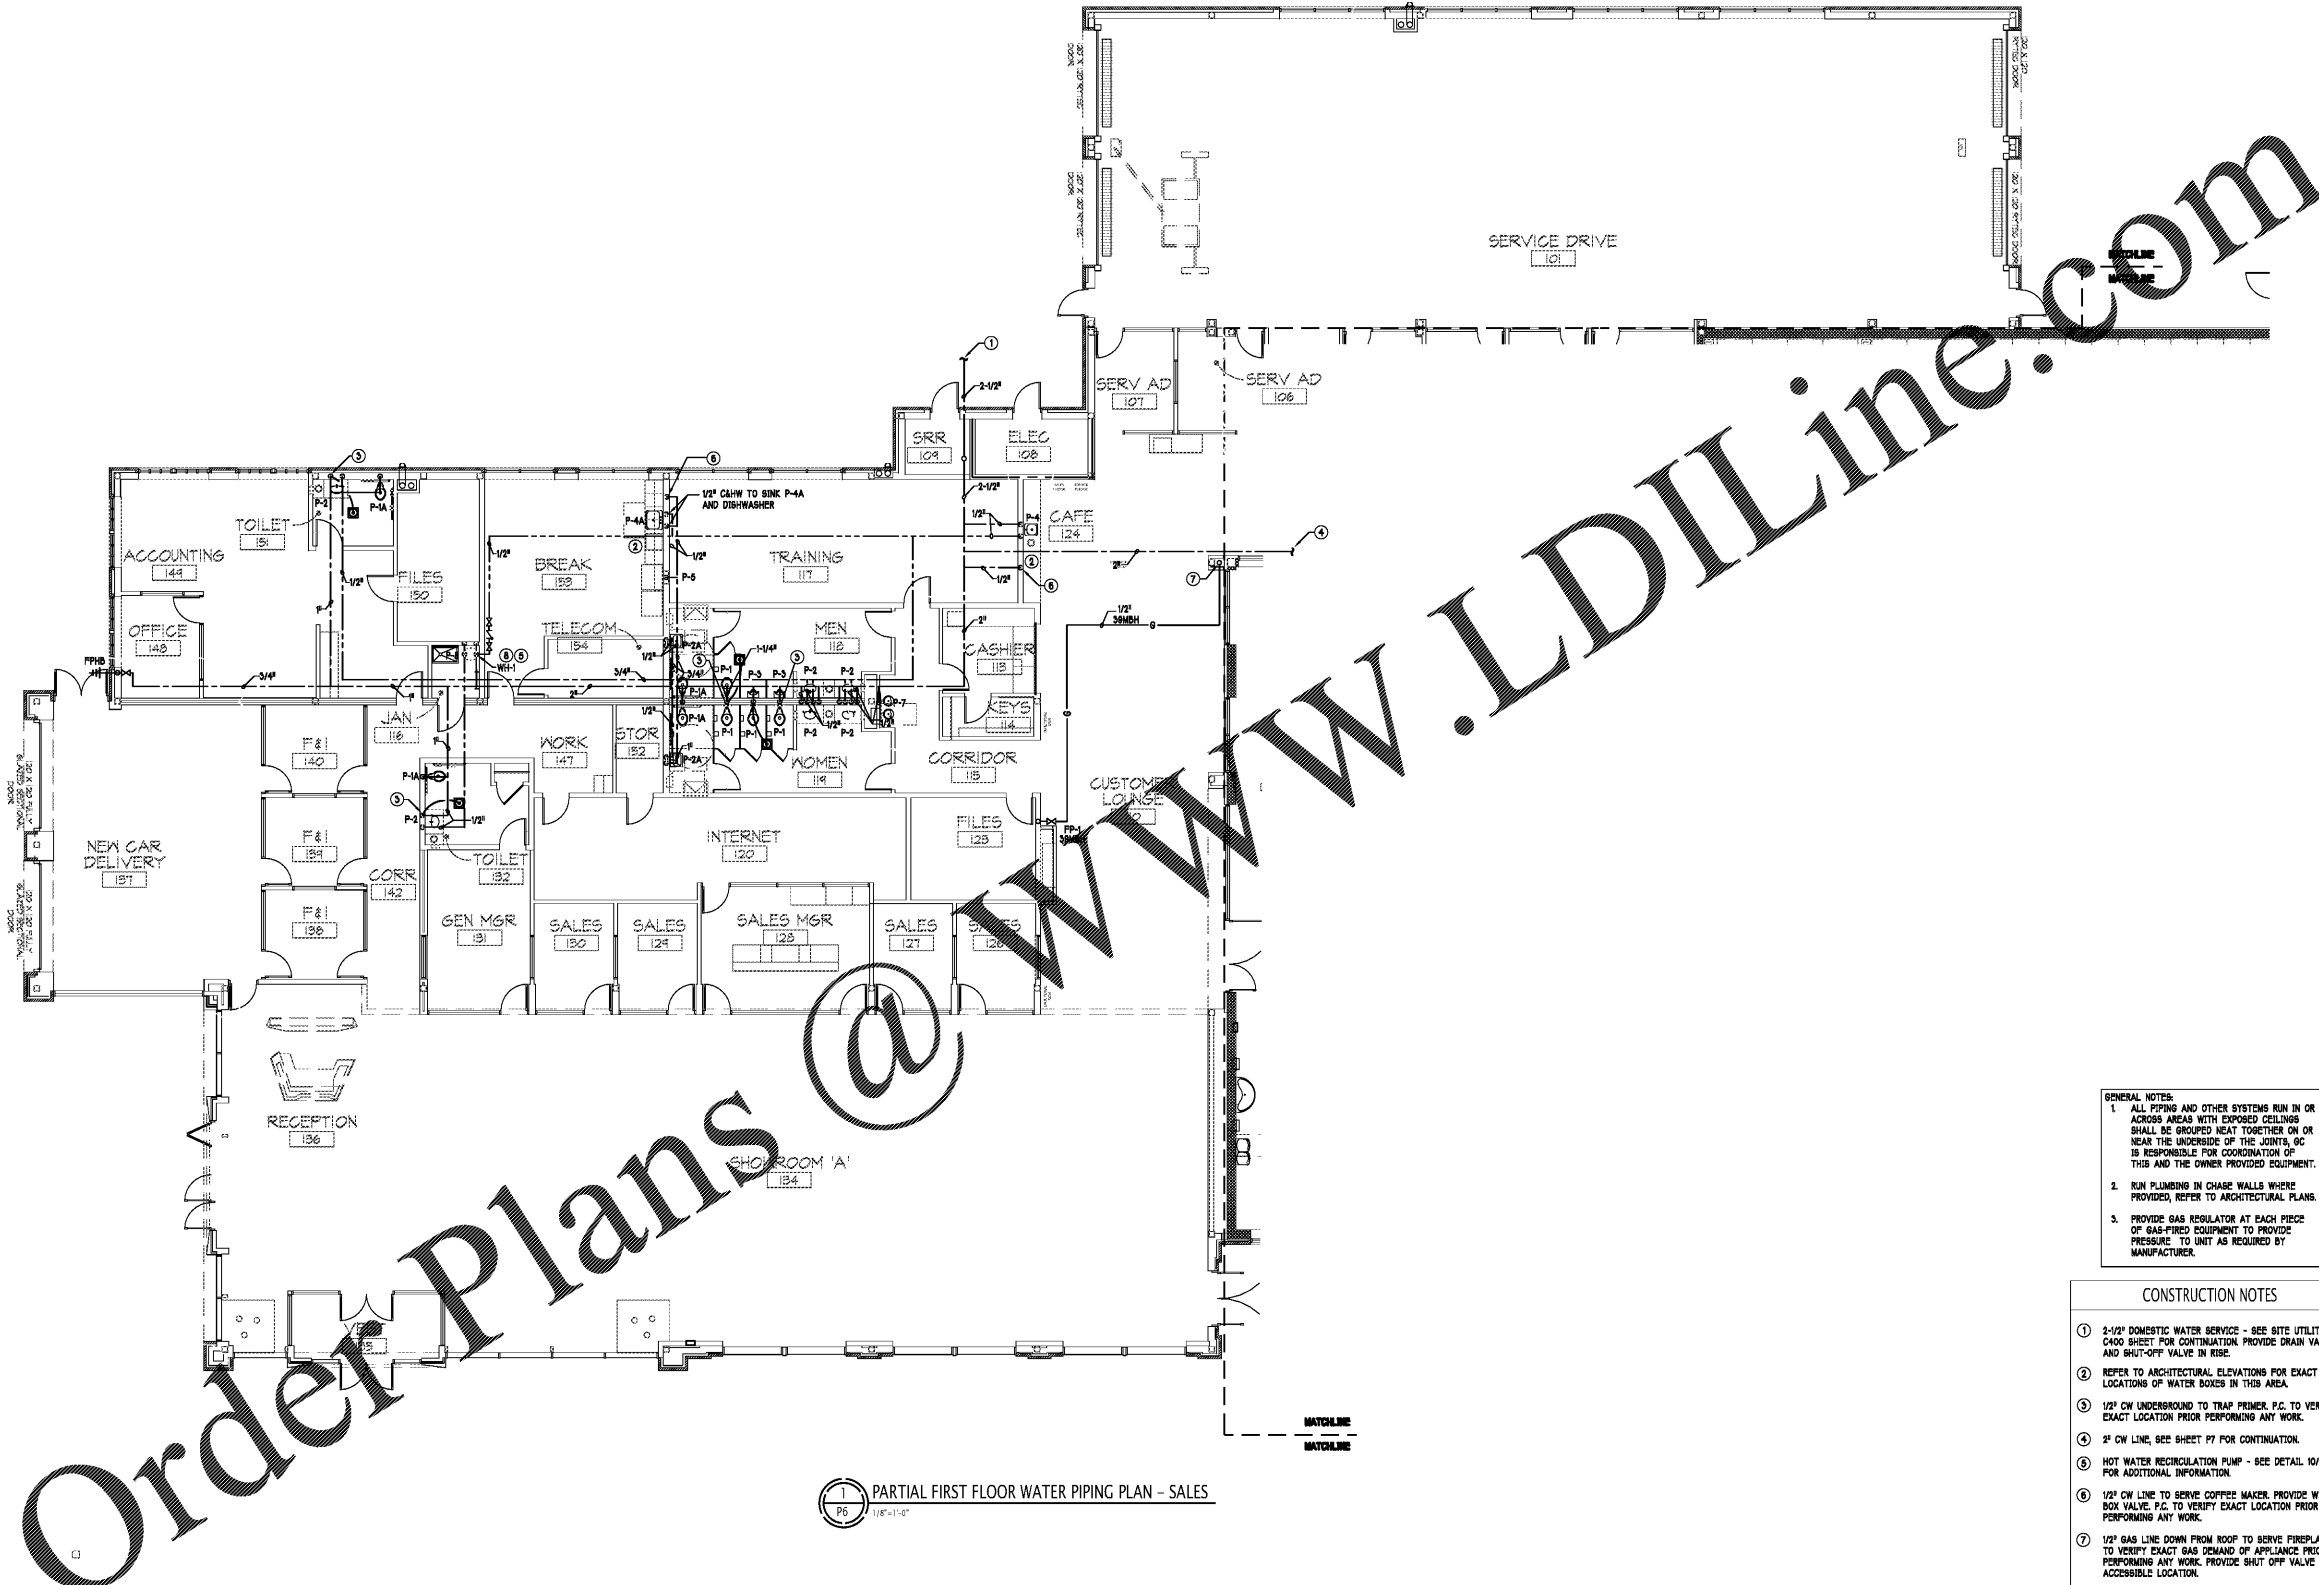

1
 P6
 PARTIAL FIRST FLOOR WATER PIPING PLAN - SALES
 1/8"=1'-0"

- GENERAL NOTES:
- ALL PIPING AND OTHER SYSTEMS RUN IN OR ACROSS AREAS WITH EXPOSED CEILING SHALL BE GROUPED NEAT TOGETHER ON OR NEAR THE UNDERSIDE OF THE JOINTS, GC IS RESPONSIBLE FOR COORDINATION OF THIS AND THE OWNER PROVIDED EQUIPMENT.
 - RUN PLUMBING IN CHASE WALLS WHERE PROVIDED, REFER TO ARCHITECTURAL PLANS.
 - PROVIDE GAS REGULATOR AT EACH PIECE OF GAS-FIRED EQUIPMENT TO PROVIDE PRESSURE TO UNIT AS REQUIRED BY MANUFACTURER.

- CONSTRUCTION NOTES
- 1/2" DOMESTIC WATER SERVICE - SEE SITE UTILITY PLAN C400 SHEET FOR CONTINUATION. PROVIDE DRAIN VALVE AND SHUT-OFF VALVE IN RISE.
 - REFER TO ARCHITECTURAL ELEVATIONS FOR EXACT LOCATIONS OF WATER BOXES IN THIS AREA.
 - 1/2" CW UNDERGROUND TO TRAP PRIMER, P.C. TO VERIFY EXACT LOCATION PRIOR PERFORMING ANY WORK.
 - 2" CW LINE, SEE SHEET P7 FOR CONTINUATION.
 - HOT WATER RECIRCULATION PUMP - SEE DETAIL 10/PM FOR ADDITIONAL INFORMATION.
 - 1/2" CW LINE TO SERVE COFFEE MAKER. PROVIDE WITH BOX VALVE, P.C. TO VERIFY EXACT LOCATION PRIOR TO PERFORMING ANY WORK.
 - 1/2" GAS LINE DOWN FROM ROOF TO SERVE FIREPLACE, P.C. TO VERIFY EXACT GAS DEMAND OF APPLIANCE PRIOR TO PERFORMING ANY WORK. PROVIDE SHUT OFF VALVE IN ACCESSIBLE LOCATION.
 - 3/4" HW & CW LINES FROM AND TO WH-1, WH-1 TO BE MOUNTED ON A PLATFORM IN JANITORS CLOSET ABOVE HOP SINK.



Order Plans @ www.LDILine.com