



**GENERAL LIGHTING NOTES:**

- L1: SEE ARCHITECTURAL PLANS AND COORDINATE WITH OWNER FOR THE EXACT LOCATION OF ALL LIGHTING FIXTURES.
- L2: LIGHTING DESIGN FOR THIS PROJECT ASSUMES 80% REFLECTANCE ON THE CEILING, 90% REFLECTANCE ON THE WALLS AND 20% REFLECTANCE ON THE FLOORS.
- L3: EXIT LIGHTS SHALL NOT BE SWITCHED.
- L4: IN INDOOR LOCATIONS OTHER THAN DWELLING AND ASSOCIATED STRUCTURES, ALL FLUORESCENT LIGHT FIXTURES THAT UTILIZE DOUBLE ENDED LAMPS AND CONTAIN BALLASTS THAT CAN BE SERVICED IN PLACE SHALL HAVE A DISCONNECTING MEANS EITHER INTERNAL OR EXTERNAL TO EACH LUMINAIRE. THE LINE SIDE TERMINALS OF THE DISCONNECTING MEANS SHALL BE GUARDED.
- L5: EXIT, EMERGENCY AND NIGHT LIGHTS SHALL BE CONNECTED TO AN UNSWITCHED LEG OF THE LOCAL LIGHTING BRANCH CIRCUIT. ASSOCIATED BOXES & CONDUIT EVERY FIVE FEET MINIMUM SHALL BE PAINTED RED.
- L6: EXACT LOCATIONS OF LIGHTING FIXTURES IN MECHANICAL SPACES SHALL BE DETERMINED IN THE FIELD. FIXTURES SHALL NOT BE SUPPORTED FROM DUCT OR PIPING. PROVIDE CHAIN HANGERS WHERE FIXTURES CAN NOT BE MOUNTED DIRECTLY TO CEILING OR STRUCTURE.
- L7: WHERE LIGHT SWITCH AND ABOVE COUNTER RECEPTACLES ARE INDICATED TO BE MOUNTED ADJACENT TO EACH OTHER, THE DEVICES SHALL BE MOUNTED AT THE SAME HEIGHT UNDER A COMMON DEVICE PLATE. EXCEPT IN THE CASE WHERE THE VOLTAGES ARE DIFFERENT, THEY SHALL BE MOUNTED IN DIFFERENT OUTLET BOXES.
- L8: MOUNT SURFACE MOUNTED FIXTURES & UNDER CABINET FIXTURES TO UNDERSIDE OF SURFACE USING SPACERS TO PROVIDE 1/4" AIR GAP. HOLD FIXTURE 1/8" OFF WALL. FOR FIXTURES BELOW CABINETS, MAKE FLEXIBLE FINAL CONNECTIONS FROM JUNCTION BOX IN CEILING CAVITY ABOVE FIXTURES. DO NOT INSTALL OUTLET AT FIXTURE. ALL WIRING SHALL BE CONCEALED.
- L9: PROVIDE INBOARD/OUTBOARD SWITCHING EVERYWHERE TWO SWITCHES ARE INDICATED FOR ONE SET OF FLUORESCENT FIXTURES. OUTBOARD LAMPS SHALL BE KEYED FROM ONE SWITCH AND INBOARD LAMPS SHALL BE KEYED FROM THE SECOND. THE SWITCH NEAREST THE DOOR SHALL BE ARRANGED TO KEY THE OUTBOARD LAMPS.
- L10: ALL ELECTRICAL CONDUIT BOXES, SUPPORTS, ETC. IN EXPOSED CEILING AREAS SHALL BE PAINTED, REFER TO ARCHITECTURAL FINISH SCHEDULE.

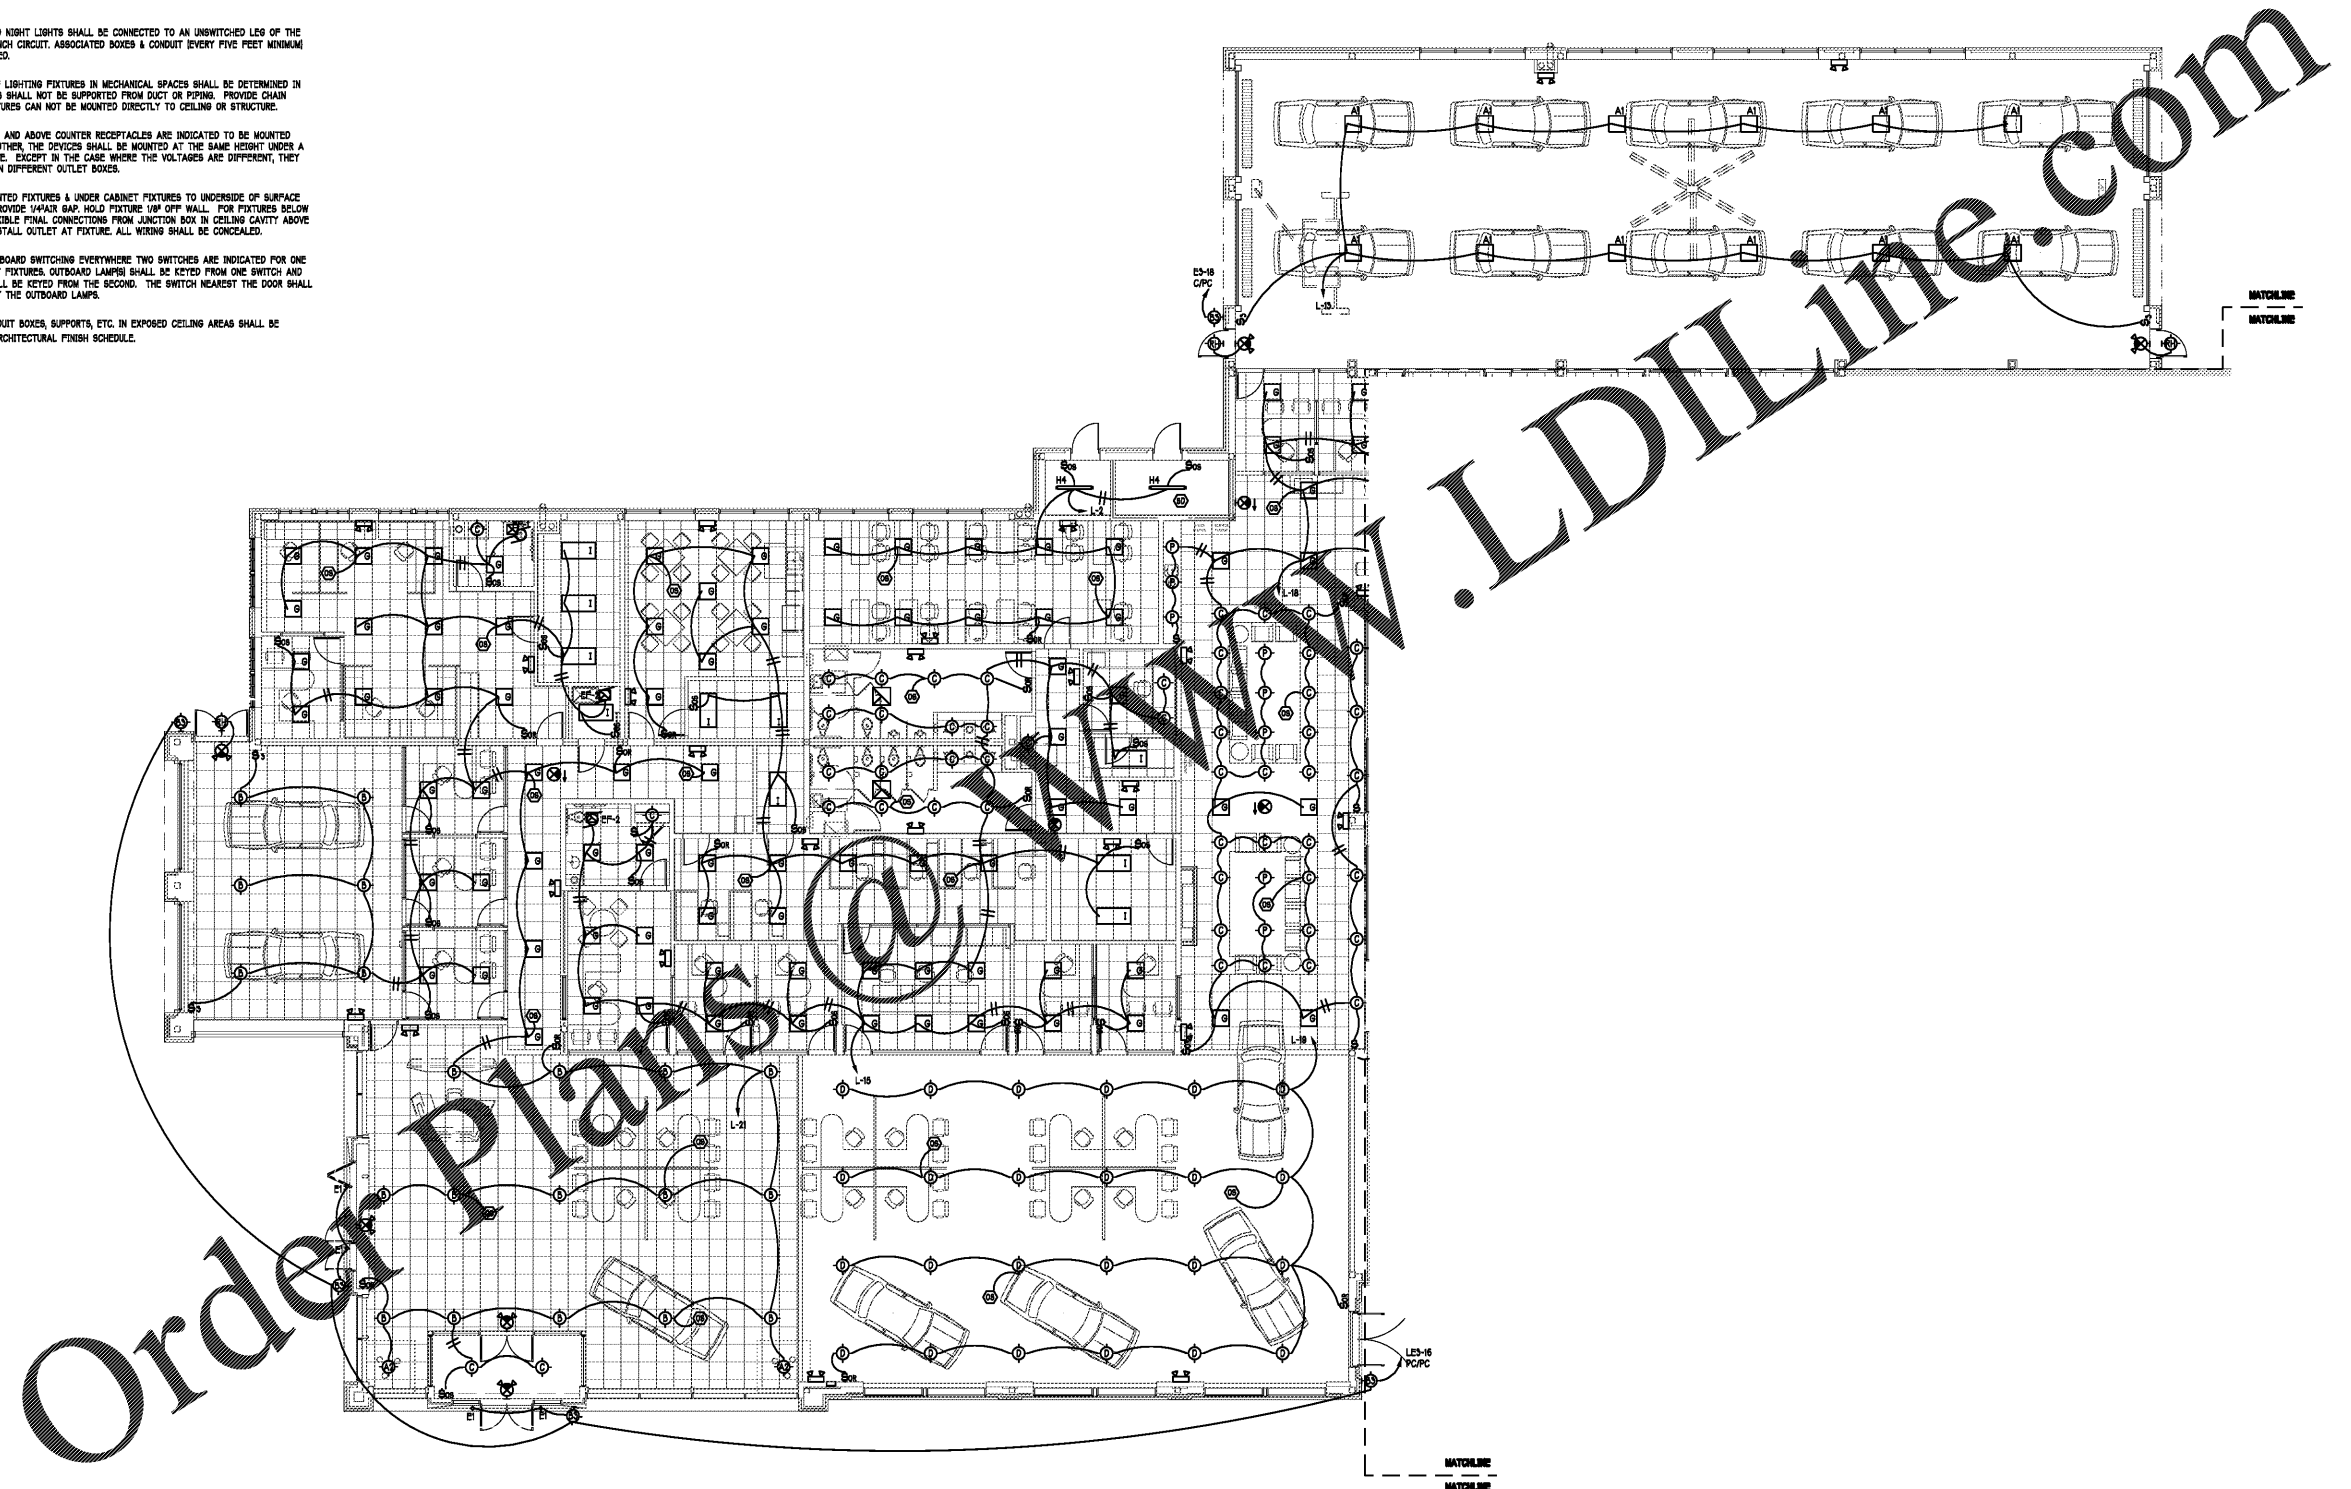

Order Plans @ WWW.LDILine.com

PARTIAL FIRST FLOOR LIGHTING PLAN - SERVICE  
1/8"=1'-0"

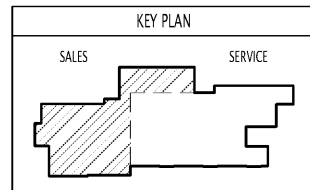

**in+EGRA**  
an Intra Architecture, PLLC DBA  
110 East Kingston Avenue, Ste. 20  
Charlotte, NC 28203  
704.372.0001  
www.in+egra.com

THE DRAWING & WRITTEN MATERIAL HEREIN CONSTITUTE ORIGINAL WORK OF THE ARCHITECT, & AS SUCH, IS THE PROPERTY OF THE ARCHITECT. NO PART OF THIS DRAWING OR WRITTEN MATERIAL IS TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT THE EXPRESS WRITTEN CONSENT OF THE ARCHITECT.  
© 2020 in+EGRA



Seals: 

**VP ENGINEERING**  
VRETTOS PAPPAS  
CONSULTING ENGINEERS, P.A.  
PO Box 21847, Charlotte, NC 28221  
2015 Clarkson Road, Suite 180  
Charlotte, NC 28227  
704.372.1785  
www.vpe.com  
CORPORATE NC LICENSE #C-2409

Revisions	Number	Date	Description

Project Title:  
**SOUTH CHARLOTTE HYUNDAI**

Project No: **4802.00**

Drawing Title:  
**PARTIAL FIRST FLOOR LIGHTING PLAN - SALES**

SET ISSUE DATE  
▶ MAR 4, 2020 ◀

Sheet:  
**E6**