



- NOTES:**
- ELECTRICAL PANELS SHALL BE PROTECTED WITH BOLLARDS (SEE ARCHITECTURAL) AND SHALL BE GROUNDED PER NEC 250.32 (A) AND (B).
 - E.G. TO COORDINATE LOCATION WITH OVERHEAD PRESSURE WASHER (FURNISHED BY OWNER)
 - ALL ELECTRICAL DEVICES IN WASH BAY SHALL BE NEMA-3R.

- NOTES:**
- G.C. TO PROVIDE ALL ELECTRICAL TO LOCATIONS SPECIFIED BY VENDOR.
 - G.C. TO INSTALL ALL LOW VOLTAGE WIRING.
 - G.C. TO COORDINATE WITH VENDOR PRIOR TO CONSTRUCTION.
- COORDINATE MOUNTING HEIGHTS OF ALL PENDANT FIXTURES WITH ARCHITECT AND OWNER BEFORE INSTALLATION. ALL LIGHTING FIXTURES SHALL BE INSTALLED NO LESS THAN 8" FROM CEILING.

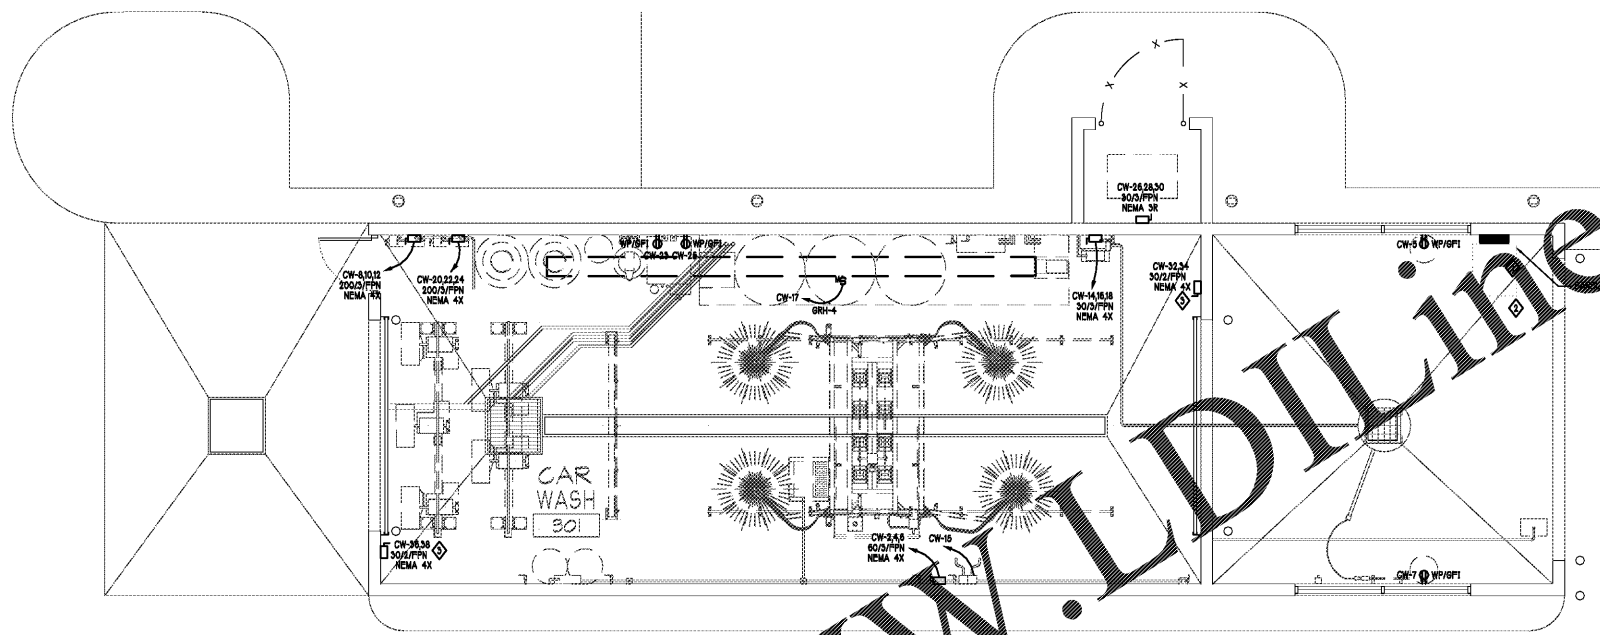

1 CARWASH POWER PLAN
1/4"=1'-0"

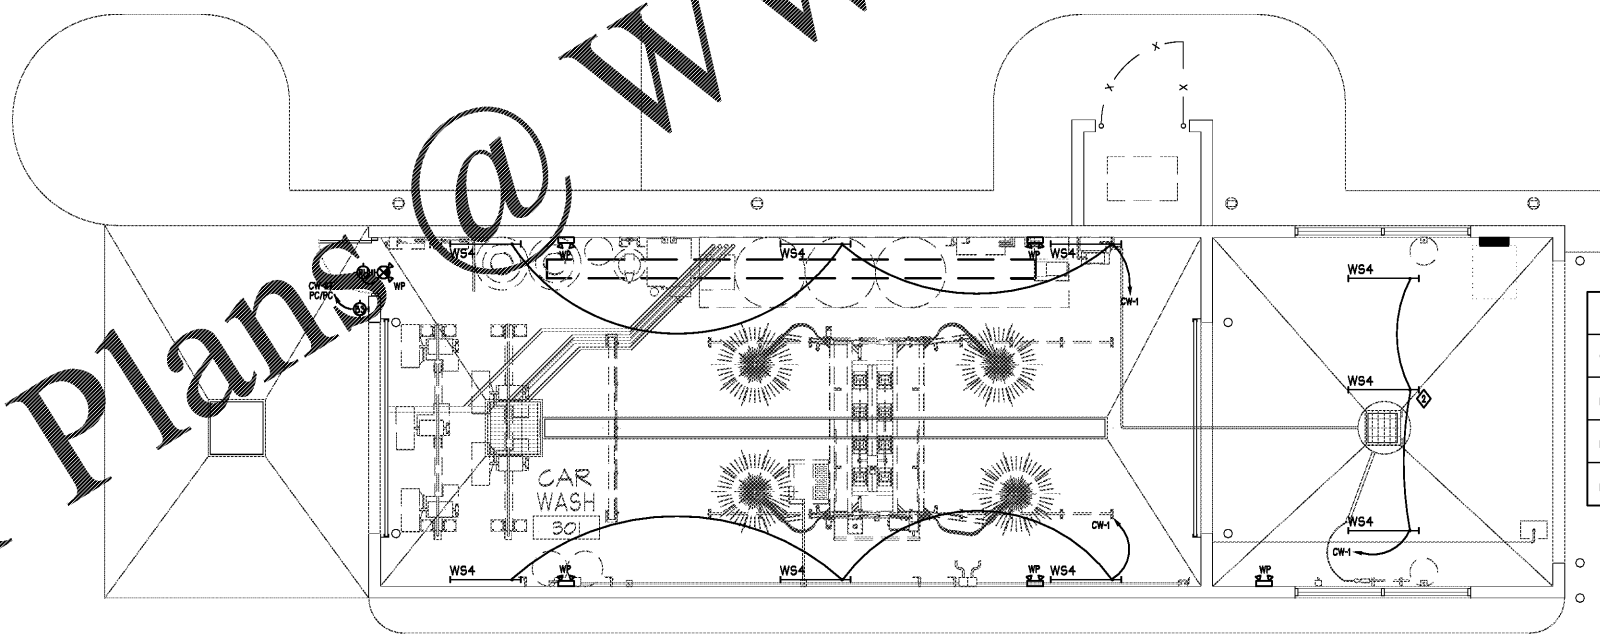

2 CARWASH LIGHTING PLAN
1/4"=1'-0"

NAMEPLATE DATA FOR CARWASH

VACUUM	120V, 1PH, 30AMP
PRESSURE WASHER	108V, 3PH, 20AMP
BLOWER	108V, 3PH, 150AMP
EQUIPMENT	108V, 3PH, 60AMP

- NOTES:**
- ELECTRICAL PANELS SHALL BE PROTECTED WITH BOLLARDS (SEE ARCHITECTURAL) AND SHALL BE GROUNDED PER NEC 250.32(A) AND (B).
 - REFER TO ARCHITECTURAL PLANS.
 - DISCONNECT PROVIDED FOR THE CARWASH OVERHEAD DOOR. E.G. TO COORDINATE THE EXACT LOCATION AND REQUIREMENT WITH DOOR MANUFACTURER PRIOR TO INSTALLATION.

Revisions:

Number	Date	Description

Project Title:
SOUTH CHARLOTTE HYUNDAI

Project No: **4802.00**
Drawing Title:
CARWASH ELECTRICAL PLANS

SET ISSUE DATE
MAR 4, 2020

Order Plans @ WWW.LDILine.com