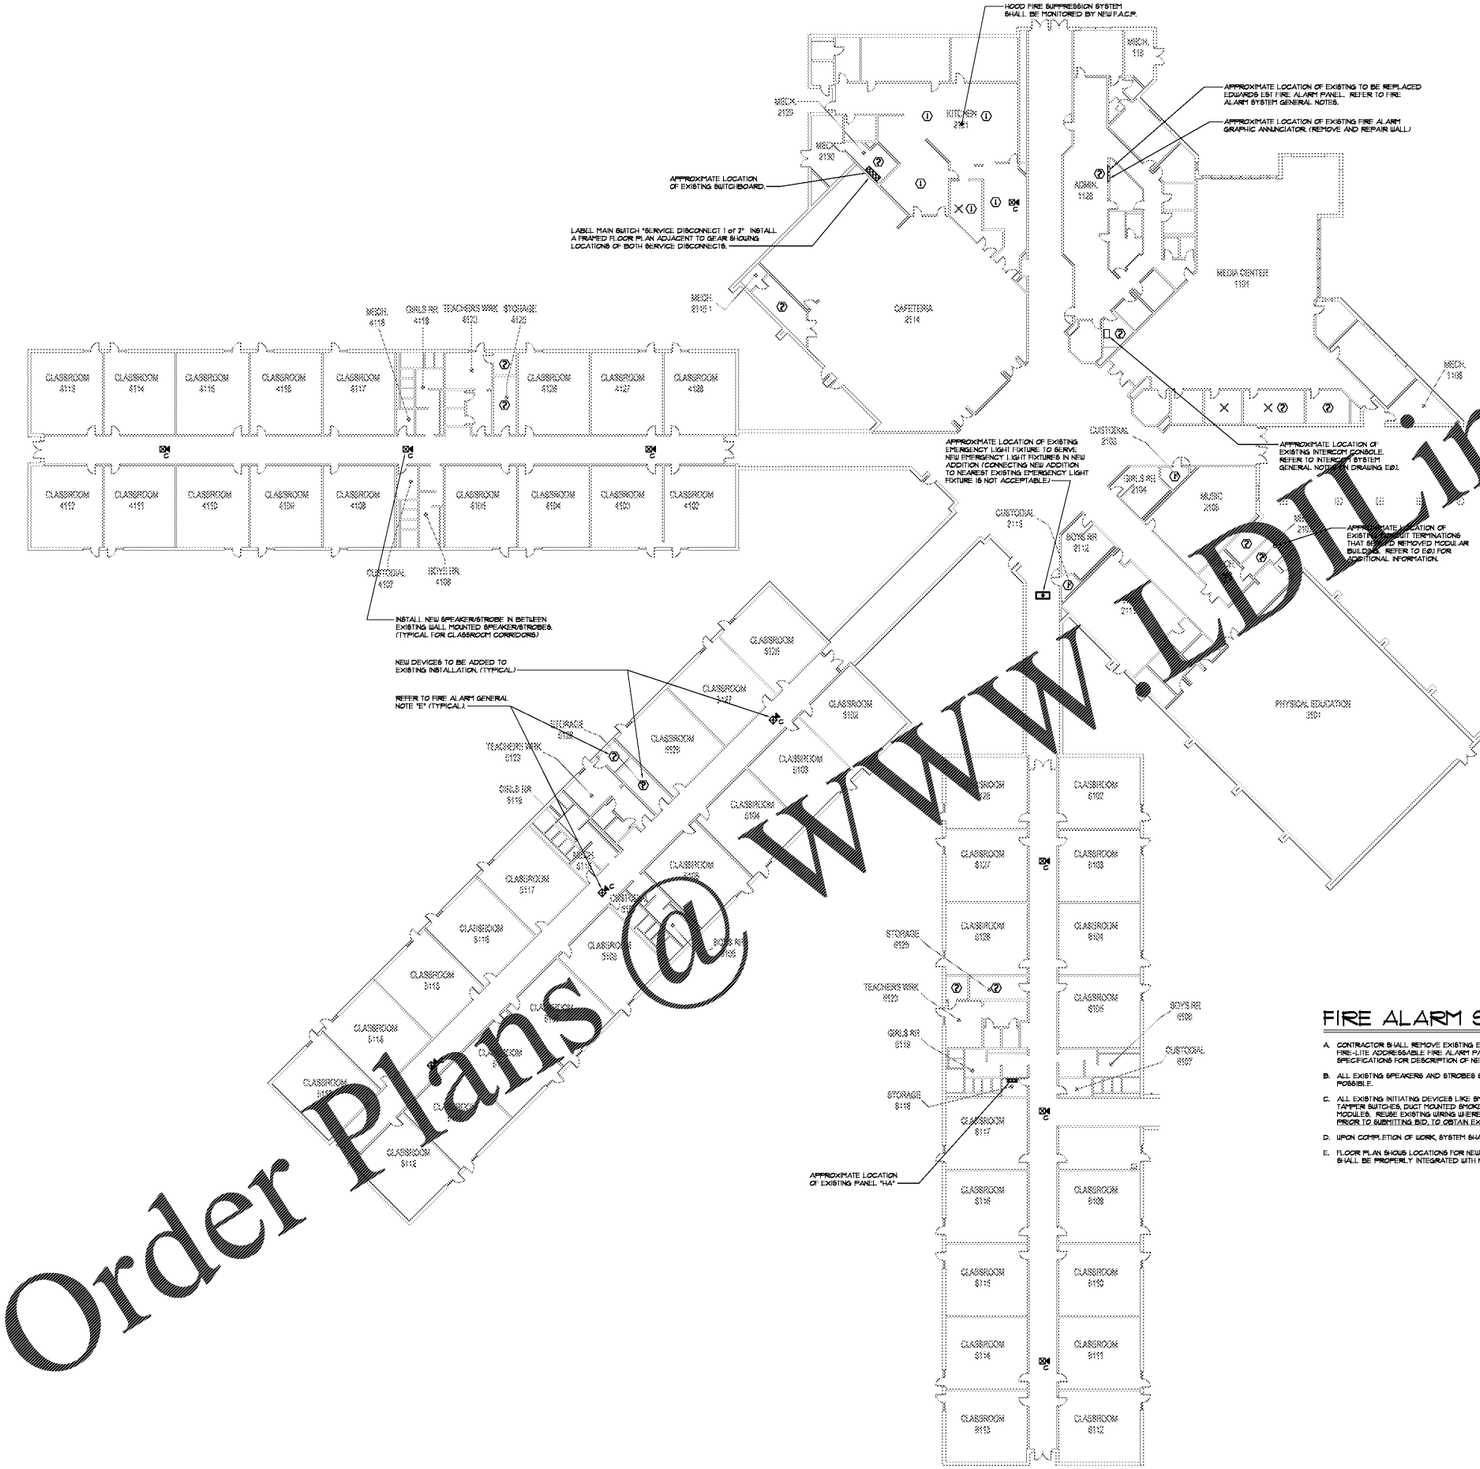

FIRE ALARM SYSTEM GENERAL NOTES

A. CONTRACTOR SHALL REMOVE EXISTING EDWARDS ADDRESSABLE FIRE ALARM PANEL AND INSTALL A NEW FIRE-LITE ADDRESSABLE FIRE ALARM PANEL WITH VOICE EVACUATION AND MICROPHONE. REFER TO SPECIFICATIONS FOR DESCRIPTION OF NEW PANEL.

B. ALL EXISTING SPEAKERS AND STROBES SHALL BE RECONNECTED TO NEW FACP USING EXISTING WIRING WHERE POSSIBLE.

C. ALL EXISTING INITIATING DEVICES LIKE SMOKE DETECTORS, PULL STATIONS, HEAT DETECTORS, FLOW SWITCHES, TAMPER SWITCHES, DUCT MOUNTED SMOKE DETECTORS, ETC. SHALL BE REPLACED WITH NEW DEVICES AND NEW MODULES. REUSE EXISTING WIRING WHERE POSSIBLE. THE CONTRACTOR IS RESPONSIBLE FOR VISITING SITE PRIOR TO SUBMITTING BID, TO OBTAIN EXACT LOCATIONS AND QUANTITIES OF ALL EXISTING INITIATING DEVICES.

D. UPON COMPLETION OF WORK, SYSTEM SHALL FUNCTION PROPERLY AND MEET ALL UL LISTINGS.

E. FLOOR PLAN SHOWS LOCATIONS FOR NEW DEVICES TO BE ADDED TO THE EXISTING CAMPUS. NEW DEVICES SHALL BE PROPERLY INTEGRATED WITH NEW FIRE ALARM CONTROL PANEL.

1 / E3.2 EXISTING FLOOR PLAN - SYSTEMS

SCALE: 1" = 20'-0"

KEY PLAN



Order Plans @ WWW.LDline.com

BXA
Breaux & Associates
ARCHITECTS
5965 Shiloh Road East, Suite 200
Alpharetta, Georgia 30005 | (678) 585-4508

No. PE029910
PROFESSIONAL ENGINEER
J. KEITH MATHIS
03-06-2020

MATHIS & ROBERDS
CONSULTING ENGINEERS
GRIFFIN, GEORGIA 30224
TELEPHONE 770-228-4160

JKM
2020-020

NO	DESCRIPTION	DATE

RUSSOM ELEMENTARY SCHOOL ADDITION
44 RUSSOM ELEMENTARY SCHOOL LANE
DALLAS, GA 30132
(FACILITY CODE: 710-0204)

PAULDING COUNTY SCHOOLS

EXISTING FLOOR PLAN - SYSTEMS

DATE 03/06/2020
PROJECT NO. 19117

E3.2

Russom Elem. School Addition