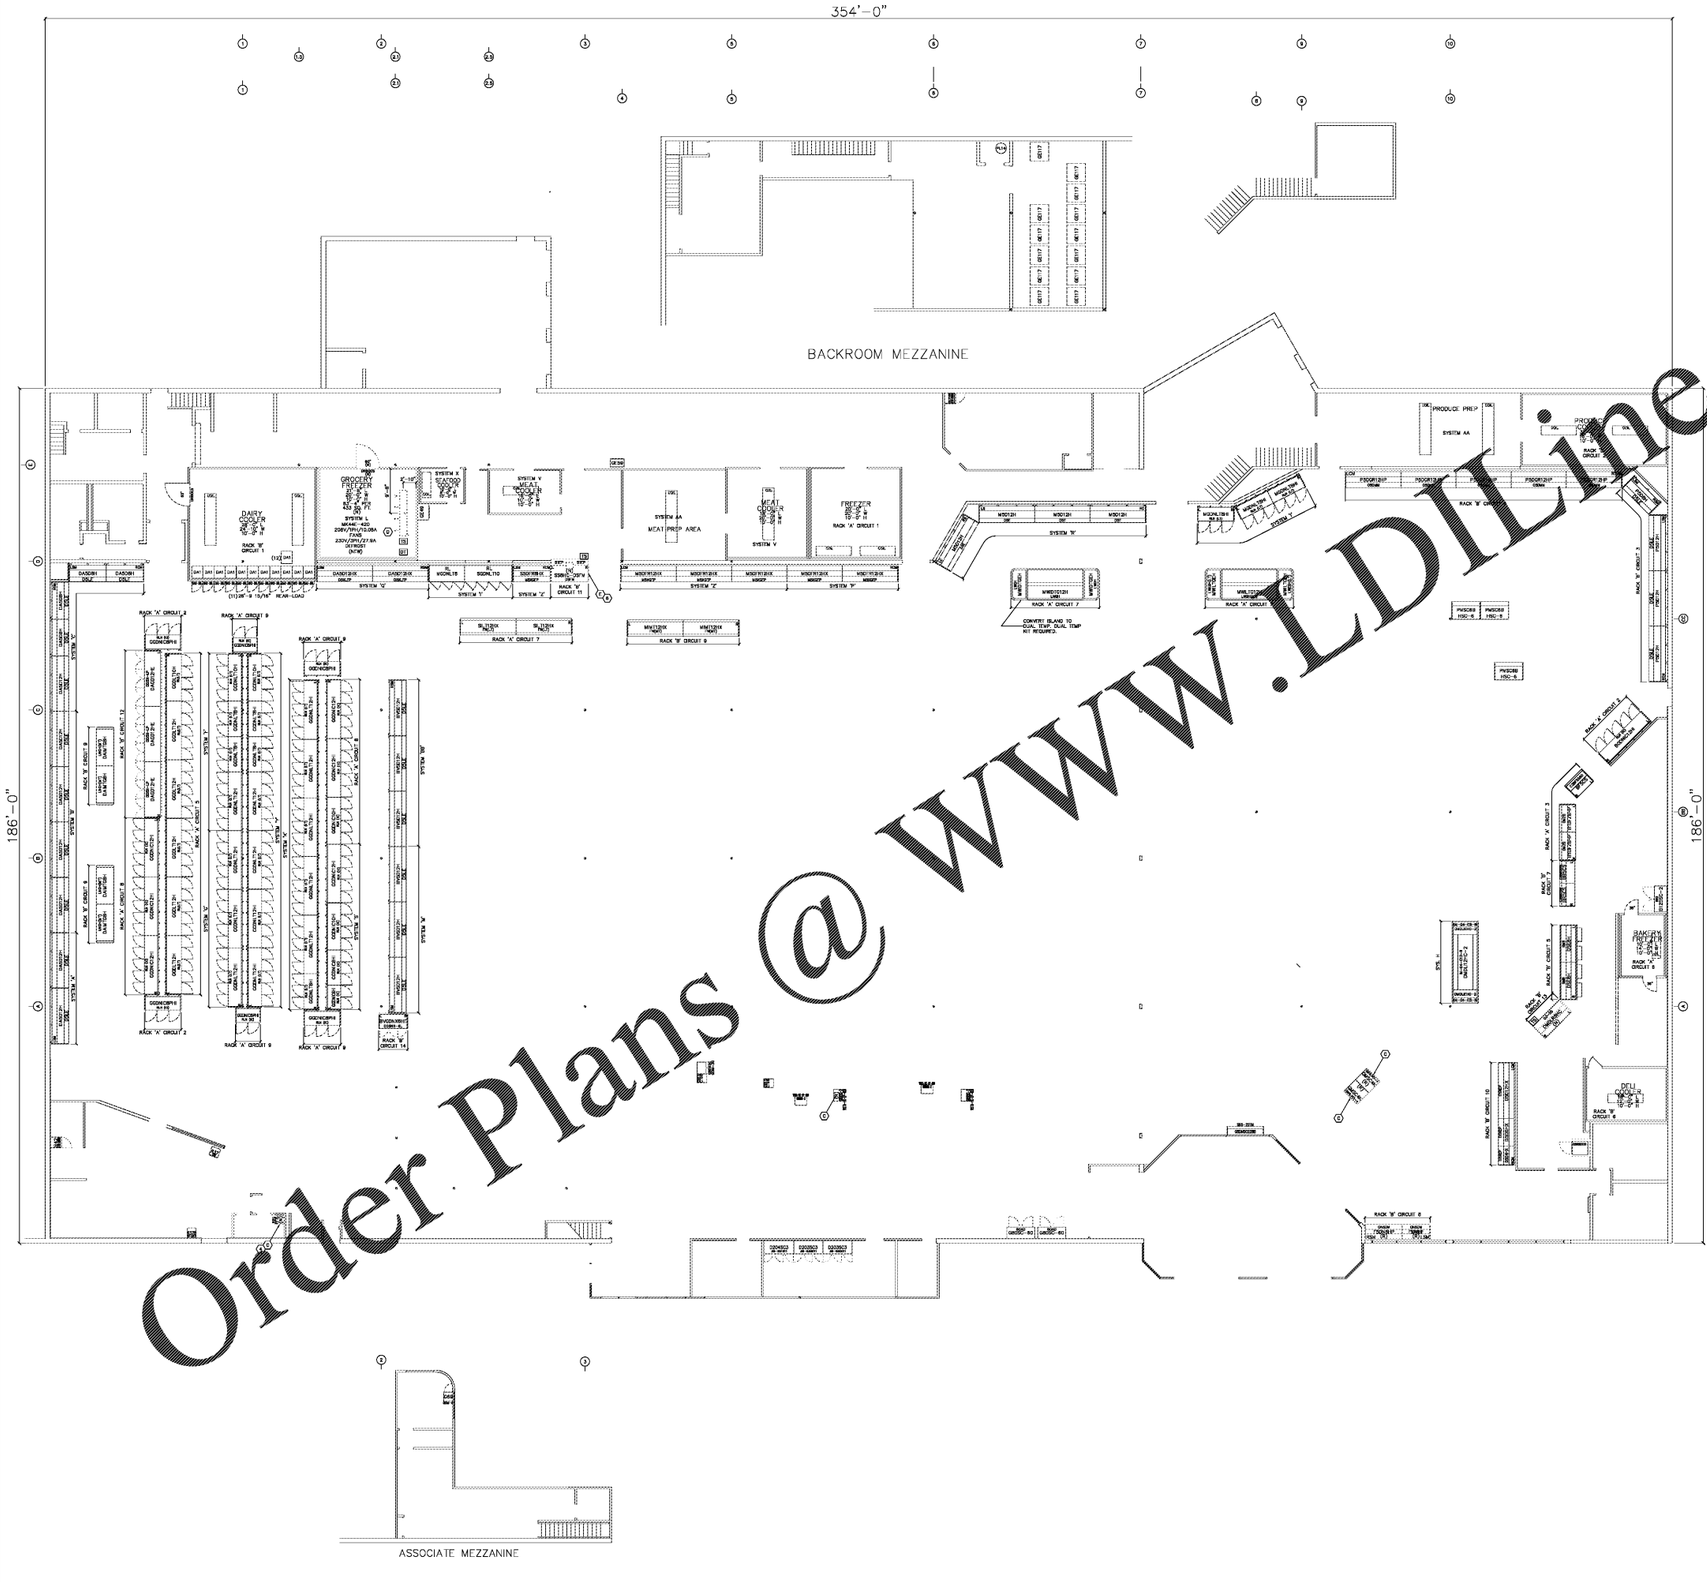

Order Plans @ WWW.LDLine.com

GENERAL NOTES :

ALL EQUIPMENT IS TO BE CONSIDERED EXISTING UNLESS NOTED OTHERWISE. THE EXTENT OF EXISTING PIPING AND/OR REDUCED CAPACITY DUE TO EXISTING CONDITIONS SHALL BE THE RESPONSIBILITY OF THE KROGER DIVISION.

INFORMATION FOR THIS PLAN WAS TAKEN FROM ARCHITECTURAL PLANS AND/OR FIELD MEASUREMENTS. ALL DIMENSIONS AND CONDITIONS MUST BE FIELD VERIFIED FOR ACTUAL CONDITIONS. CONTACT THE KROGER DESIGN ENGINEER IF ANY DISCREPANCIES ARE FOUND.

NOTE:
"C.O." DRAWING IS INTENDED ONLY TO SHOW THE ADJACENCIES OF THE KROGER CO. EQUIPMENT TO THE CONSTRUCTION. ALL CONSTRUCTION SHALL COMPLY WITH ALL REGULATIONS, ORDINANCES AND APPROVAL OF THE INSPECTION AUTHORITIES HAVING JURISDICTION. ALL CONSTRUCTION SHALL BE PERFORMED BY A LICENSED CONTRACTOR ASSOCIATED BY THE KROGER CO. & SUPERVISED BY THE KROGER CO. REPRESENTATIVE.

VENDOR BID GENERAL NOTES:

- ALL COOLERS, RETAINERS, FREEZERS AND COILS SUPPLIED BY KROGER.
- VENDOR SHALL REVIEW COMPRESSOR SELECTIONS STATED ON BID MILS REFRIGERATION DRAWING. ANY DEVIATION FROM THIS DATA MUST BE APPROVED BY THE KROGER CO. VENDOR SHALL PROVIDE LINE SIZING TABLE (MATRIX) WITH APPLICABLE DRY KROGER EQUIPMENT SPECIFICATION).

VENDOR BID KEYNOTES:

1. NOT USED
2. NOT USED
3. NOT USED
4. FIXTURE(S) SHALL BE ORDERED AND PURCHASED SEPARATELY BY THE KROGER PROJECT MANAGER
5. NOT USED
6. CASE END GUARDS SUPPLIED BY MANUFACTURER

INSTALLER GENERAL NOTES:

- LOCATIONS OF PVC RISERS FOR THE ROUTING OF REFRIGERATION LINES SHOWN ON PLAN, ALTERNATE ROUTING MAY BE REQUIRED. FIELD CONDITIONS TO BE VERIFIED FOR CONFLICTS. CARE SHOULD BE TAKEN IN ROUTING OF LINES TO MINIMIZE INTERFERENCE WITH DAYLIGHT OPENINGS. REFRIGERATION LINES SHALL BE ROUTED AS HIGH AS PRACTICAL.
- EXISTING REFRIGERATION PIPING TO BE REVAMPED WHERE PRACTICAL. IT'S THE INSTALLER'S RESPONSIBILITY TO REPLACE EXISTING PIPING AND INSULATION AS REQUIRED TO CONFORM TO THE REFRIGERATION CONDENSING EQUIPMENT MANUFACTURER'S RECOMMENDATIONS FOR THE REFRIGERATION LOAD SERVED.

INSTALLER KEYNOTES:

1. NOT USED
2. NOT USED
3. INSTALL SELF-CONTAINED EQUIPMENT
4. INSTALL COIL AND ROUTE CONDENSATE PIPING TO NEAREST DRAIN
5. INSTALL CASE END GUARDS SUPPLIED BY MANUFACTURER

GENERAL NOTES:

- PROVIDE A SINGLE 120V RECEPTACLE MOUNTED ON WALL BELOW EACH FIXTURE WITH A NONDEDICATED BRANCH CIRCUIT. EACH RECEPTACLE TO BE EQUIPPED WITH A CONTINUOUS OPERATION WEATHERPROOF COVER & TIED TO A 30A S.P.S. BREAKER.

CONTROL NOTE:

- ANY N.W. CIRCUIT CONTROLS REQUIRED TO ACCOMPLISH REVERSE, TO BY PASS, OR TO SHUT DOWN THE REFRIGERATION INSTALLED, ESSENTIALLY OFF RETAINING EXISTING CONTROLS FOR MODIFIED SYSTEMS TO BE CONFIRMED BY REFRIGERATION INSTALLER. MONEY VALUE PRESSURE DROPS AND OPERATION WHICH MAY LOCK OUT SYSTEM FROM EXISTING CONTROLS TO BE INSTALLED IN ADDESSIBLE LOCATIONS PROTECTED FROM DAMAGE.

SHEET INDEX:

R1.1 (THIS SHEET) REFRIGERATION EQUIPMENT PLAN
R5.1 REFRIGERATION STANDARD DETAILS
R6.1 REFRIGERATION EQUIPMENT SCHEDULE

LEGEND:

- (TS) TEMPERATURE SENSOR
- (DT) DEFROST TERMINATION THERMOSTAT

Kroger
GENERAL OFFICE
FACILITY ENGINEERING
1014 VINE ST, CINCINNATI, OHIO 45202
PH (513) 762-1401 FAX (513) 762-1402
PO BOX 1150

ATLANTA
(NEW) URBANMIX
2175 Park Lane Drive
Atlanta, GA.
PHONE: (770) 496-7570
FAX: (770) 496-7569

MINOR WITHIN THE WALLS

GA-291
6199 HWY 92 STE 176
ACWROTH,GA

CURRENT PLAN DATE:	12/19/2019
ORIGINAL PLAN DATE:	12/9/2019
DRAWN:	J. TRAINOR
CHECKED:	E. RUME
REVISIONS:	
STANDARD FLOYTRON SCALE:	3/32"=1'-0"

BUILDING STATS

TOTAL SHELVING	3,109 LF
SALES AREA (I.N.W. WORK BUILDING)	51,073 SF
BASE STORE	67,416 SF
MEZZANINE	
DOCK / UTILITY	1,850 SF
GROSS BUILDING	72,339 SF

REFRIGERATION EQUIPMENT LAYOUT

STORE PACKAGE ID: Not Applicable

GA-291

R1.1

CAD FILE: GA291R1.1.DWG