


Order Plans @

WWW.LDLINE.COM

WWW.LDLINE.COM

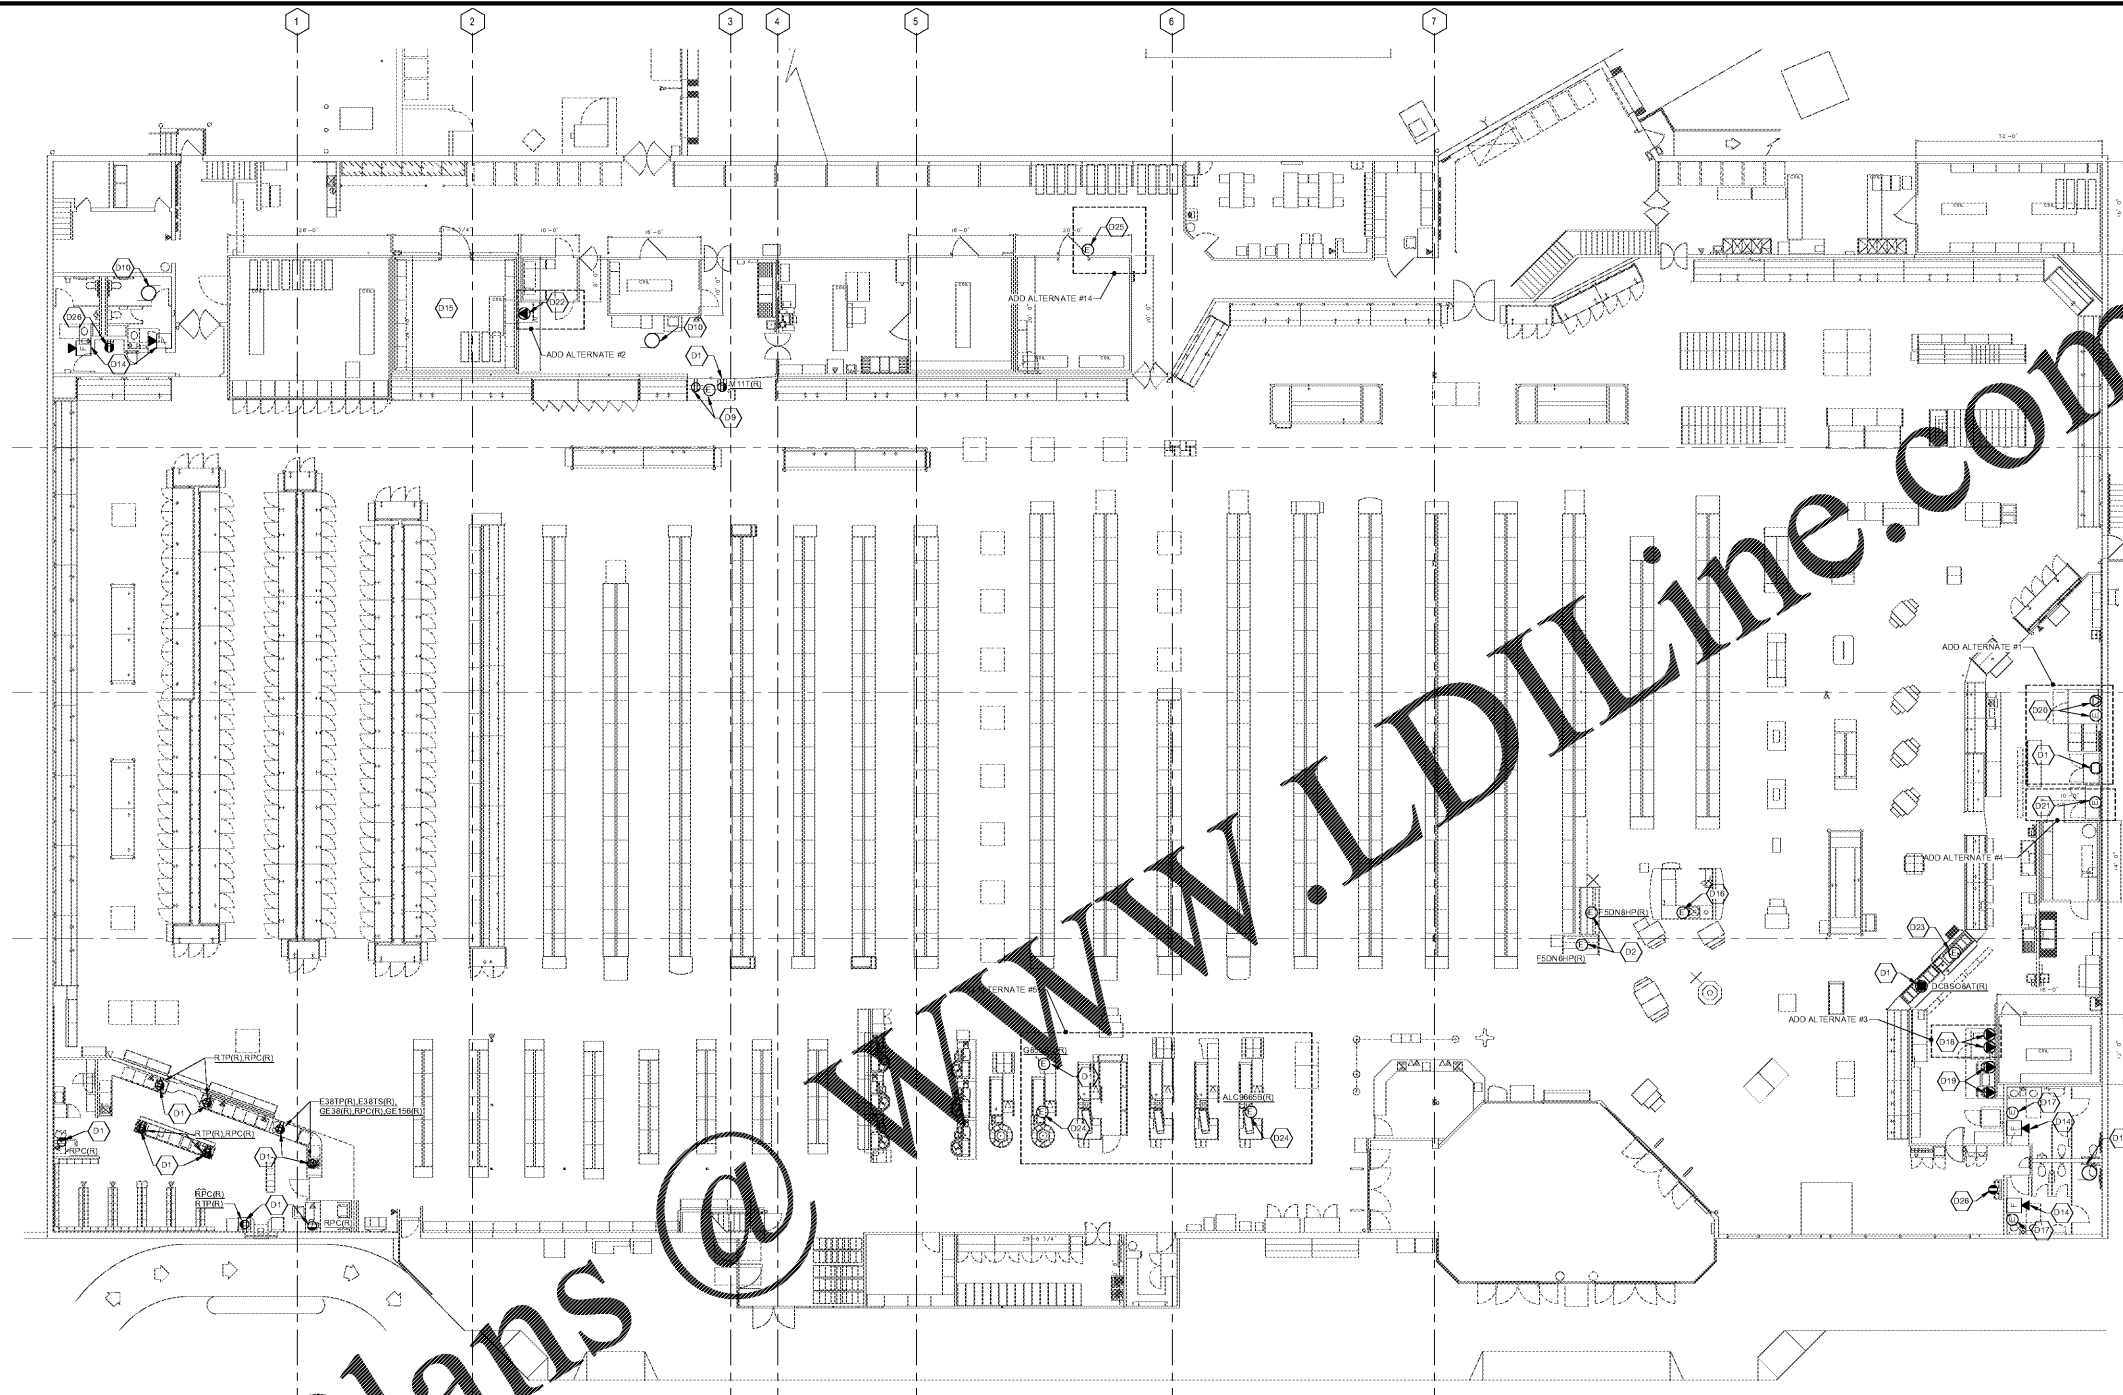

1 POWER DEMOLITION PLAN
3/22" = 1'-0"

POWER DEMOLITION KEYNOTE LEGEND	
Key Value	Keynote Text
01	EXISTING EQUIPMENT TO BE RELOCATED: FIELD VERIFY EXACT LOCATION. REMOVE ALL ELECTRICAL CIRCUITS TO NEW LOCATION AS REQUIRED. REUSE EXISTING CONDUIT, JUNCTION BOXES, CONDUIT DROPS, ETC. WHERE POSSIBLE. WHERE CONDUIT IS STUBBED UP IN SALES FLOOR, CUT CONDUIT FLUSH WITH FLOOR AND CAP. SEE POWER PLAN FOR MORE INFORMATION.
02	EXISTING REFRIGERATED CASES TO BE RELOCATED: REROUTE ALL EXISTING POWER CIRCUITS (FANS, LIGHTS, ANTISWEATS) AND REFRIGERATION CIRCUITS (DEFROST, CONTROL, ETC.) TO NEW LOCATION FOR CONNECTION TO NEW CASES. REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. WHERE APPLICABLE, EXISTING LIGHT FIXTURES MOUNTED ON TOP OF CASE ARE TO BE REUSED. WHERE EXHAUST FANS ARE NOT FULFILLING DRIBBLE DOOR CASES THEY ARE TO BE REUSED. PERFORM ALL ELECTRICAL WORK AS REQUIRED FOR REUSE OF LIGHT FIXTURES AND EXHAUST FANS. SEE POWER PLAN FOR MORE INFORMATION.
03	EXISTING REFRIGERATED CASES TO BE REPLACED: MAINTAIN ALL EXISTING POWER CIRCUITS (FANS, LIGHTS, ANTISWEATS) AND REFRIGERATION CIRCUITS (DEFROST, CONTROL, ETC.) AS REQUIRED FOR CONNECTION TO NEW CASES. REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.
04	EXISTING REGISTER CASES TO BE RELOCATED: REROUTE ALL ELECTRICAL CIRCUITS TO NEW LOCATION AS REQUIRED. REUSE EXISTING CONDUIT, JUNCTION BOXES, CONDUIT DROPS, ETC. WHERE POSSIBLE. WHERE CONDUIT IS STUBBED UP IN SALES FLOOR, CUT CONDUIT FLUSH WITH FLOOR AND CAP. SEE POWER PLAN FOR MORE INFORMATION.
05	EXISTING REFRIGERATED CASES TO BE DEMOLISHED: REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (CONDUIT, WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. REMOVE ALL REFRIGERATION CIRCUITS (DEFROST, CONTROL, ETC.) BACK TO REFRIGERATION SOURCE. MAINTAIN OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS AND SUBSYSTEMS TO REMAIN. WHERE CONDUIT IS STUBBED UP IN SALES FLOOR, CUT CONDUIT FLUSH WITH FLOOR AND CAP.
010	EXISTING EXHAUST FAN TO BE REPLACED: DISCONNECT AND MAINTAIN ALL ELECTRICAL CIRCUITRY FOR CONNECTION TO NEW EXHAUST FAN. SEE LIGHTING PLAN FOR MORE INFORMATION.
014	EXISTING FIRE ALARM NOTIFICATION DEVICE TO REMAIN: DISCONNECT / RECONNECT AS REQUIRED FOR REMODELING. COORDINATE WITH ALL OTHER TRADES.
015	EXISTING GROCERY FREEZER TO BE DEMOLISHED: REMOVE ALL ELECTRICAL DEVICES IN THIS SPACE TO BE REMOVED. REMOVE ALL WIRING, ETC. BACK TO PANEL AND LABEL BREAKER AS SPARE. REUSE EXISTING CONDUITS WHERE POSSIBLE. SEE POWER PLAN FOR NEW POWER REQUIREMENTS. MAINTAIN OPERATION OF ALL DOWNSTREAM DEVICES TO REMAIN.
016	EXISTING FLOOR WORKSTATION TO BE DEMOLISHED: REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (CONDUIT, WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. MAINTAIN OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS AND SUBSYSTEMS TO REMAIN. WHERE CONDUIT IS STUBBED UP IN SALES FLOOR, CUT CONDUIT FLUSH WITH FLOOR AND CAP.
017	EXISTING HAND DRYER TO BE DEMOLISHED: REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (CONDUIT, WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. MAINTAIN OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS AND SUBSYSTEMS TO REMAIN.
018	EXISTING OVENS TO BE DEMOLISHED: REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (CONDUIT, WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. MAINTAIN OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS AND SUBSYSTEMS TO REMAIN.
019	EXISTING FRYERS TO BE DEMOLISHED: REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (CONDUIT, WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. MAINTAIN OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS AND SUBSYSTEMS TO REMAIN.
020	EXISTING BAKERY OVEN TO BE REPLACED: MAINTAIN ALL EXISTING POWER CIRCUITS (FAN, CONTROLS, MOTOR) AS REQUIRED FOR CONNECTION TO NEW BAKERY OVEN. REUSE EXISTING CONDUIT, JUNCTION BOXES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.
021	EXISTING BAKERY RETARDER TO BE REPLACED: MAINTAIN EXISTING CIRCUIT FOR CONNECTION TO NEW BAKERY RETARDER.
022	EXISTING CE BAKERS TO BE DEMOLISHED: REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (CONDUIT, WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. MAINTAIN OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS AND SUBSYSTEMS TO REMAIN.
023	EXISTING SANDWICH CASE TO BE DEMOLISHED: REMOVE ALL ASSOCIATED ELECTRICAL DEVICES (CONDUIT, WIRING, ETC.) BACK TO PANEL AND LABEL BREAKER AS SPARE. MAINTAIN OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS AND SUBSYSTEMS TO REMAIN.
024	EXISTING REGISTER TO BE REPLACED: MAINTAIN ALL EXISTING POWER CIRCUITS AS REQUIRED FOR CONNECTION TO NEW REGISTER. REUSE EXISTING CONDUIT, JUNCTION BOXES, POWER POLES, ETC. WHERE POSSIBLE. SEE POWER PLAN FOR MORE INFORMATION.
025	EXISTING FREEZER DOOR TO BE REPLACED: DISCONNECT / RECONNECT ELECTRICAL AS REQUIRED.
026	EXISTING WATER COOLER TO BE REPLACED: DISCONNECT / RECONNECT ELECTRICAL AS REQUIRED.

ROBERTSON LOJA ROOF ARCHITECTS & ENGINEERS
3440 Preston Ridge Road - Suite 275 - Alpharetta, GA, 30005
770.974.2607 / www.rljape.com



Kroger GA-291
2175 Park Lake Drive, Atlanta, GA
The Kroger Company

NO.	DATE	REVISIONS

POWER DEMOLITION PLAN

03-06-20

20-108

ED1.2