

GENERAL NOTES:

1. PIPING ROUTED IN COOLER OR FREEZER WALLS WILL NOT BE PERMITTED. WHERE SHOWN PIPING SHALL BE RUN DOWN FACE OF COOLER PANEL ON THE OUTSIDE (OR WARM) FACE OF THE INSULATED PANELS, STUBBED THROUGH THE WALL FOR CONNECTIONS TO SINKS, ETC. THERE SHOULD BE NO WATER SUPPLY LINES UNDER EITHER A COOLER OR A FREEZER.
2. PIPING EXPOSED TO SALES AREA SHALL BE PAINTED TO MATCH STRUCTURE. WHEN USING INSULATION ON EXPOSED PIPING USE SCHULLER MICRO-LOK (M) FIBER GLASS INSULATION.
3. WATER PIPING IN AREAS SUBJECT TO FREEZING TEMPERATURES WILL NOT BE PERMITTED.
4. COMPONENT CONNECTIONS AND SEISMIC SUPPORTS SHALL BE IN ACCORDANCE WITH SEISMIC DESIGN REQUIREMENTS OF THE INTERNATIONAL BUILDING CODE.
5. COORDINATE ALL ROUTING OF WATER PIPING TO SALES AREA WITH REFRIGERATION DRAINAGE.
6. ALL ISOLATION BALL VALVES (IBVS) AND CHECK VALVES SHALL BE MOUNTED 10'-0" A.F.F.
7. EXACT SIZE AND LOCATION OF EXISTING SANITARY & WATER LINES TO BE DETERMINED BY THE CONTRACTOR ON THE JOB. FIELD VERIFY ALL CONNECTING INVERTS PRIOR TO BEGINNING CONSTRUCTION.
8. CONTRACTOR SHALL DETERMINE DIRECTION OF FLOW IN EXISTING LINES AND THE NEW PIPES IN THE PROPER DIRECTION.
9. ALL PIPING FROM FIXTURES TO BE REMOVED SHALL BE PROPERLY PLUGGED AND CAPPED SO THAT UPON COMPLETION OF ALL NEW WORK, ALL ABANDONED PIPING SHALL BE CONCEALED IN FINISHED AREAS.
10. NO DEAD ENDS SHALL BE LEFT ON ANY DRAINAGE PIPING UPON COMPLETION OF THE JOB.
11. CONCEALED ABANDONED PIPING NEED NOT BE REMOVED IF IT DOES NOT INTERFERE WITH THE NEW WORK.
12. THE EXISTING SYSTEM(S) TO BE REUSED SHALL BE LEFT IN PERFECT WORKING ORDER UPON COMPLETION OF THE JOB. VERIFY INVERT OF EXISTING SANITARY PIPING PRIOR TO STARTING WORK. IF INVERT IS NOT LOW ENOUGH TO CONNECT NEW WORK, CONTACT ARCHITECT.
13. ROUTE NEW VENT LINE TO MAKE CONNECTION TO EXISTING VENT OR VENT THRU ROOF.
14. INSULATE WATER AND DRAIN LINE UNDER HAND SINK TO PROTECT AGAINST CONTACT (GEORGIA ACCESSIBILITY CODE SECTION 120-3-20-43).

PLUMBING NOTES:

1. DISPOSE OF ALL MATERIALS REMOVED AND NOT REUSED, AS DIRECTED BY KROGER ENGINEER.
2. EXACT SIZE AND LOCATION OF EXISTING SANITARY, WATER AND GAS LINES AND EXISTING EQUIPMENT TO BE DETERMINED BY THE CONTRACTOR ON THE JOB. FIELD VERIFY ALL CONNECTING INVERTS PRIOR TO BEGINNING CONSTRUCTION.
3. PLUMBING CONTRACTOR SHALL DEMO ALL EXISTING TOILET ROOM FIXTURES (TOILETS, URINALS, LAVATORIES & WATER COOLERS) AND REPLACE WITH NEW FIXTURES (SEE SPECIFICATIONS 22-200 FOR REQUIREMENTS).
4. CONTRACTOR ADJUST EXISTING SANITARY AND WATER CONNECTIONS AS REQUIRED FOR NEW FIXTURE LOCATIONS.
5. CONTRACTOR SHALL COORDINATE PHASING OF TOILET ROOM RENOVATION WITH GENERAL CONTRACTOR AND KROGER FACILITY ENGINEER.
6. CONTRACTOR SHALL JET, SNAKE AND SCOPE ALL EXISTING SANITARY LINES, TOILET ROOMS, PRIOR TO STARTING PLUMBING WORK.
7. PLUMBING CONTRACTOR SHALL PERMANENTLY CAP WITH CLEANOUT TOP, ALL EXISTING CASE DRAINS OR HUB DRAINS NO LONGER IN USE, FOR DEMOLITION AND RELATED FIXTURES. PLUMBING CONTRACTOR SHALL PROVIDE TEMPORARY CONNECTIONS FOR THE FIXTURE DURING PHASING OF REMOVAL.
8. PROVIDE NEW DRAIN SHOWN AS REQUIRED. ROUTE NEW REFRIGERATED CASE CONDENSATE LINE PER PSD-1/PS.1. RE-USE EXISTING DRAIN IF APPROVED BY KROGER FACILITY ENGINEER.
9. ALL EXISTING DRAINS ARE TO BE ABANDONED AND SHALL BE PLUGGED AND CAPPED WITH CLEANOUT TOP.
10. CONTRACTOR SHALL PROVIDE ONE 3/4" VALVED FILTERED WATER AND 3/4" VALVED UNFILTERED WATER LINE (30-90 PS) FOR EACH OVEN. SEE DETAIL PSD-23A/PS.1 FOR INSTALLATION REQUIREMENTS.
11. PROVIDE NEW HOT WATER HOSE BB BELOW HAND SINK. SEE SPECIFICATIONS FOR EXACT MODEL AND REQUIREMENTS.
12. DEMO ALL EXISTING STERILOX EQUIPMENT AND PIPING AND PERMANENTLY CAP IN WALL. SEE NOTE #1.
13. ROUTE NEW REFRIGERATED CASE CONDENSATE LINE PER PSD-1/PS.1.
14. MAKE CONNECTION TO EXISTING 3/4" VALVED WATER LINE FOR PRODUCE MISTING CONTROLLER.
15. DEMO ALL EXISTING OUTDOOR MISTING EQUIPMENT AND PIPING AND PERMANENTLY CAP IN WALL. SEE NOTES #1 & #2.


NOTE:
THIS PROJECT IS A RENOVATION OF AN EXISTING FACILITY AND OF NECESSITY, PREVIOUS RECORD DRAWINGS FROM THE BASIS FOR MANY OF THESE DRAWINGS. IT IS THEREFORE DEEMED MORE IMPORTANT THAN IN NEW CONSTRUCTION THAT ALL DIMENSIONS SHALL BE FIELD VERIFIED BEFORE FABRICATION OR PURCHASE OF DIMENSION CRITICAL EQUIPMENT, MATERIALS, AND ASSEMBLIES. THERE MAY EXIST FIELD CONDITIONS NOT ACCESSIBLE DURING DESIGN WHICH DIFFER FROM THOSE SHOWN ON THE DRAWINGS. ANY SUCH DEVIATIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT AND KROGER ENGINEER FOR RESOLUTION BEFORE PROCEEDING WITH ANY CONSTRUCTION, FABRICATION, OR MATERIAL/EQUIPMENT PURCHASES WHICH WOULD BE UNUSABLE UNDER THOSE CIRCUMSTANCES.

1 PLUMBING FLOOR PLAN
P1.1 SCALE: 3/32" = 1'-0"



2 WATER PART PLAN
P1.1 SCALE: 3/32" = 1'-0"

Order Plans @

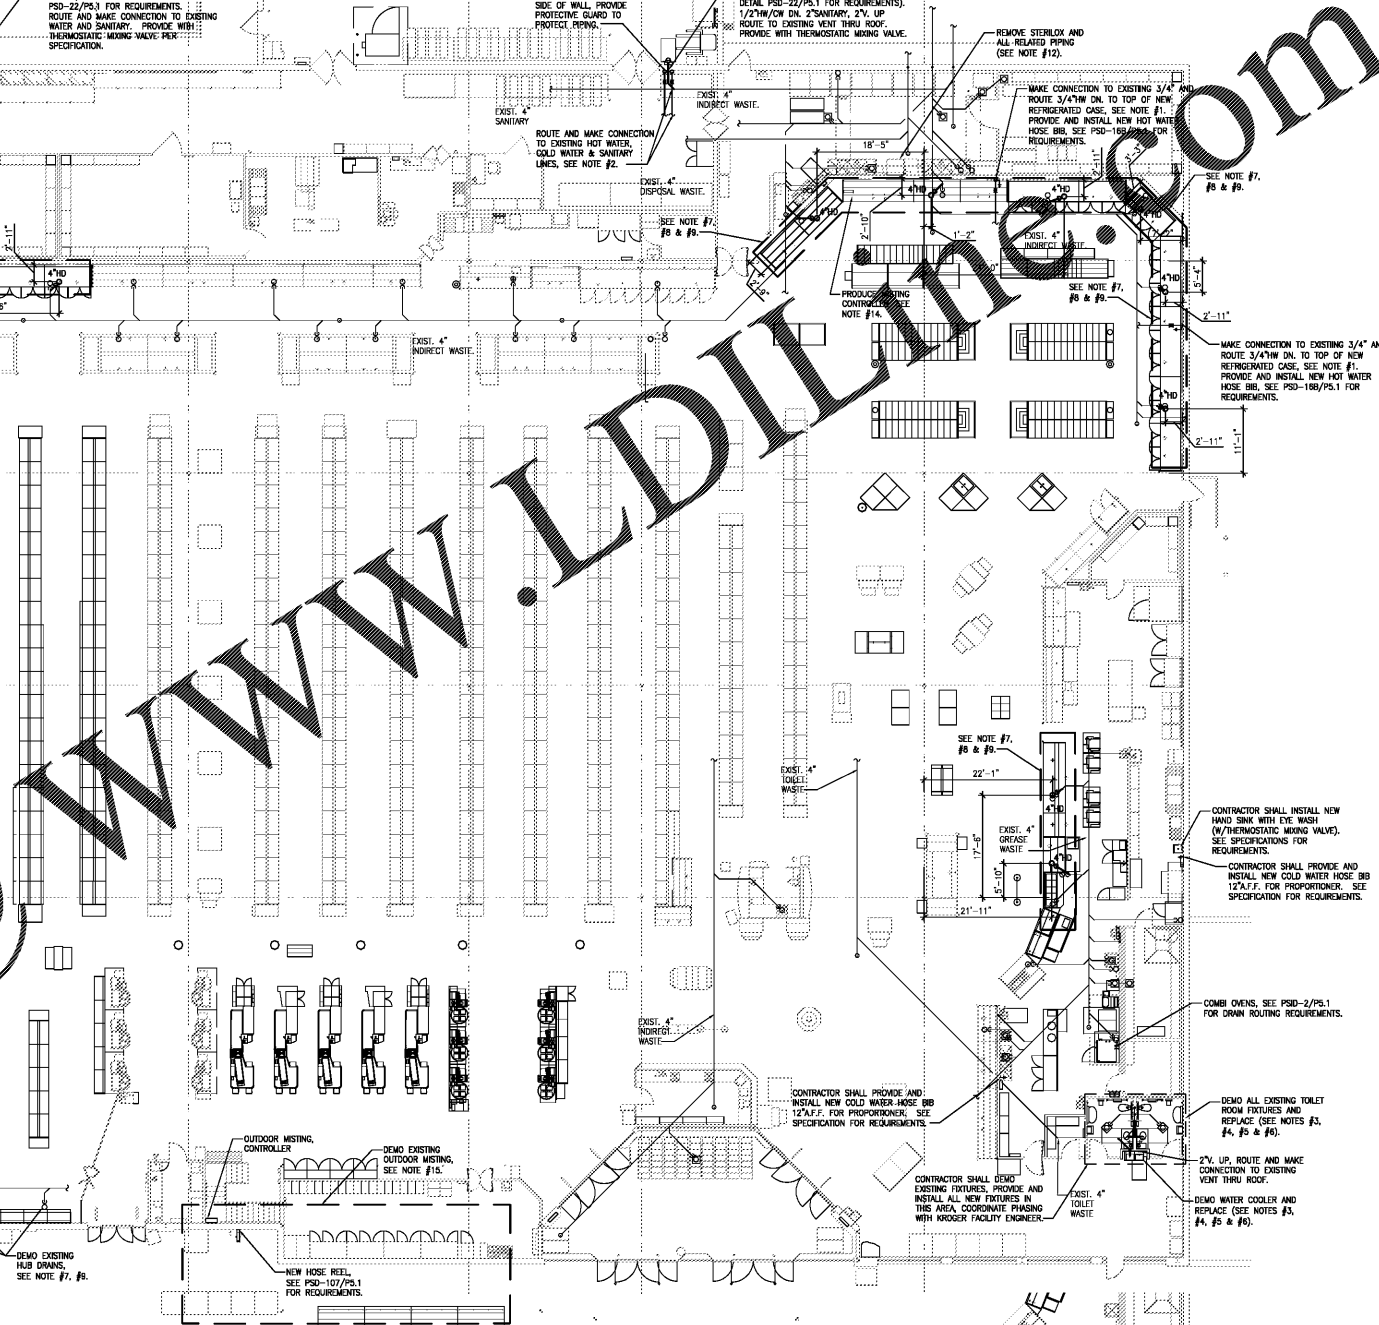

REVISIONS

NO.	DATE	DESCRIPTION

02-12-20

20-107