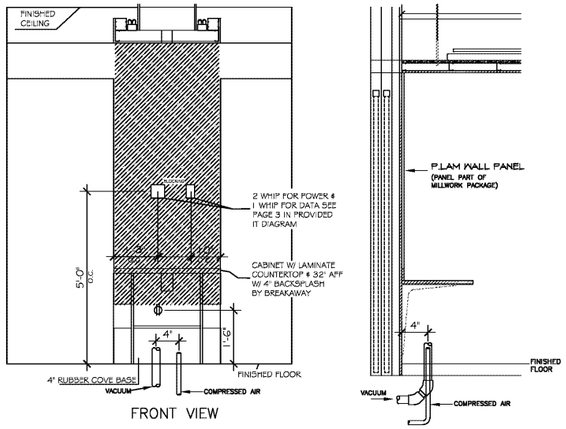

1 **12 O'CLOCK WALL DETAIL**
NTS

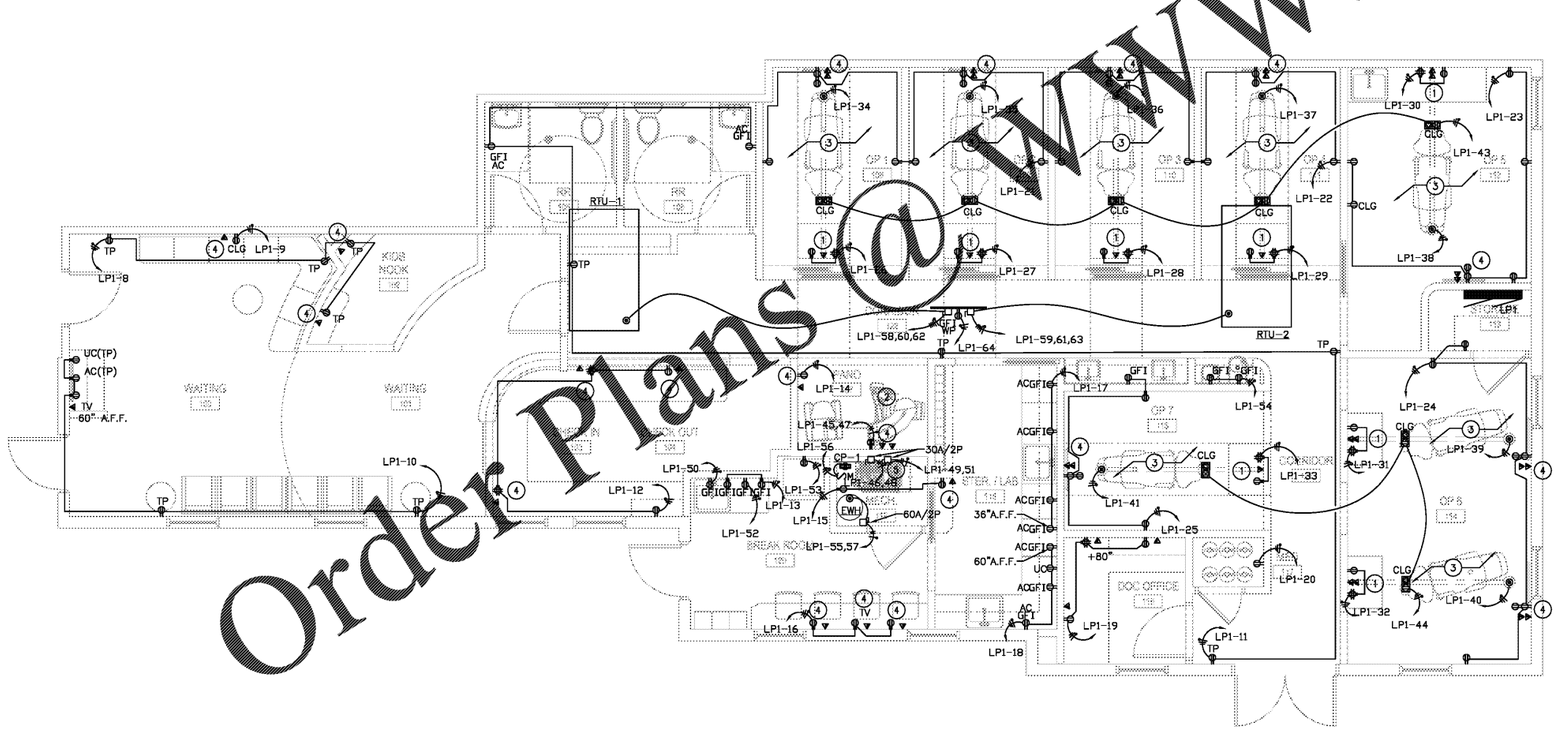

2 **POWER PLAN**
1/4" = 1'-0"

ELECTRICAL KEYED NOTES:

1. REFER TO DETAIL ON THIS SHEET FOR MOUNTING HEIGHT AND REQUIREMENTS OF 12'OCLOCK WALL DEVICES. VERIFY EXACT LOCATION WITH DENTAL DESIGN PRIOR TO ROUGH-IN. TYPICAL OF ALL OP ROOMS.
2. VERIFY ELECTRICAL REQUIREMENTS OF PANORAMIC DENTAL X-RAY WITH DENTAL CONSULTANT PRIOR TO ROUGH-IN.
3. PROVIDE REDUNDANT GROUNDING PER NEC 517. TYPICAL OF ALL EXAM ROOMS AND X-RAY ROOM.
4. ONE DUPLEX/DATA MOUNTED AT 36" A.F.F., SECOND DUPLEX/DATA MOUNTED AT 60" A.F.F. VERIFY MOUNTING HEIGHT OF RECEPTACLE/DATA WITH OWNER PRIOR TO ROUGH-IN.
5. COORDINATE COMPRESSOR/VACUUM FINAL LOCATION PRIOR TO ROUGH-IN.

Order Plans @ WWW.LDILine.com

LEAN dental design
8000 IH-10, FRONTAGE RD., STE 300
SAN ANTONIO, TX 78230
210-899-4500

HMB ENGINEERING CONSULTANTS
2902 NORTH FLORES
SAN ANTONIO, TEXAS 78212
210.393.1940 PHONE
SAN ANTONIO - RGV
TBPE FIRM REGISTRATION NO. 13361

DENTAL OFFICES OF
DR. FREITAS & DR. SOUZA
17901 PINES BLVD. SUITE 202, PEMBROKE PINES, FL 33029

ALFREDO HERNANDEZ LICENSE No. 84942 STATE OF FLORIDA PROFESSIONAL ENGINEER
3/20/20

ISSUE

NO.	DATE	DESCRIPTION
1	03-20-2020	PERMIT DOCUMENTS

Project No. HM3 PROJ #20055
Date: 03/20/20

Sheet Title: ELECTRICAL POWER PLAN

Page No. **E200**