

DATE	DESCRIPTION
01/25/19	PERMIT SET
03/16/20	REFRESH TO 2020.0113

HWY 316 @ 81

**BETHLEHEM
 GA 30620
 839 LOGANVILLE HWY**

#1304

2018 LH MO 0405


SPB NO. 0405 DATE 12/18/18

STANDARD PLAN BULLETINS (SPB) MODIFY THE PROTOTYPE SERIES SET NOTED ABOVE. THE LISTED SPB REPRESENTS THE LATEST MODIFICATION INCORPORATED TO THIS PROTOTYPE SERIES SET AT ORIGINAL RELEASE. THE ISSUE/REVISION RECORD COLUMN ABOVE LISTS ANY REVISIONS OR SPB INCORPORATED IN THIS SET AFTER THE ORIGINAL RELEASE. CONTACT RACETRAC ENGINEERING AND CONSTRUCTION FOR ANY SUBSEQUENT BULLETINS NOT INCORPORATED HEREIN.


2018157.19

**ELECTRICAL
 DETAILS**


E600

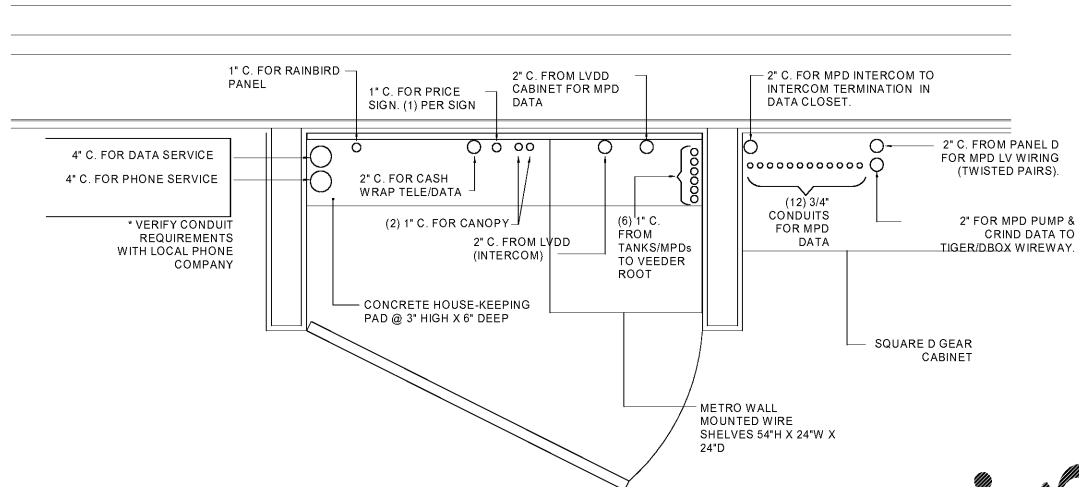

6 TELEPHONE BACKBOARD DETAIL
 N.T.S.

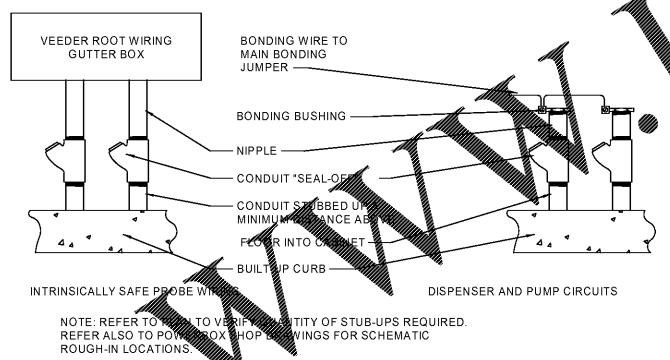


4 DISPENSER PUMP AND INTRINSICALLY SAFE STUB-UP DETAIL
 N.T.S.

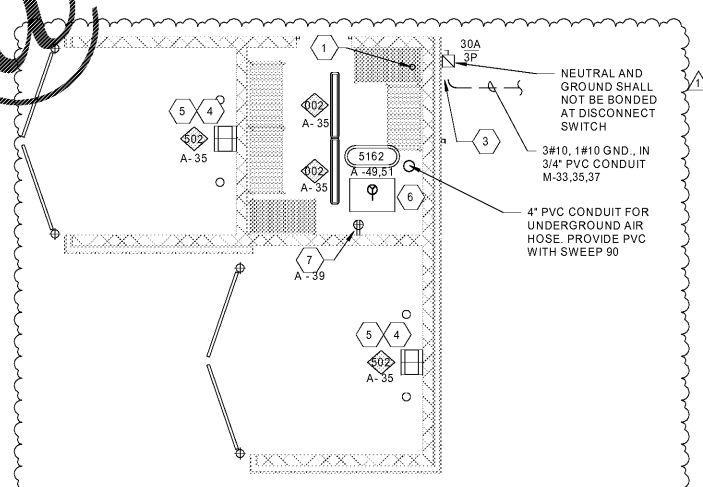


KEYNOTES

- CONTRACTOR SHALL PROVIDE 3/4" CONDUIT WITH PULLSTRING FROM "MDP" AND STUB-UP AND CAP.
- NOTE NOT USED.
- PROVIDE 30A/2P/240V FUSED DISCONNECT IN NEMA 3R ENCLOSURE WITH 20A FUSES FOR OUTDOOR STORAGE ROOM DISCONNECT SWITCH. LABEL "OUTDOOR STORAGE DUMPSTER ENCLOSURE DISCONNECT".
- PROVIDE DISCONNECT OF SELECTED CIRCUIT PER NEC 210.4 (B).
- LIGHT FIXTURE CONTROLLED BY PHOTOCELL. REFER TO WIRING DIAGRAM ON SHEET E-502.
- AIR COMPRESSOR. REFERENCE SHEET E-430 FOR ADDITIONAL INFORMATION.
- PROVIDE WEATHERPROOF RECEPTACLE WITHIN 5'-0" OF AIR COMPRESSOR FOR TANK DRAIN.


2A DUMPSTER ENCLOSURE ELECTRICAL PLAN
 3/16" = 1'-0"

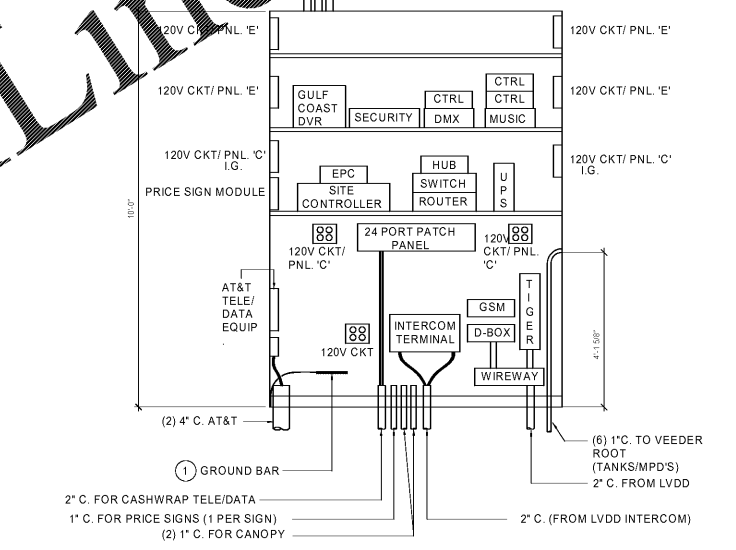

5 TELEPHONE BACKBOARD ELEVATION
 N.T.S.

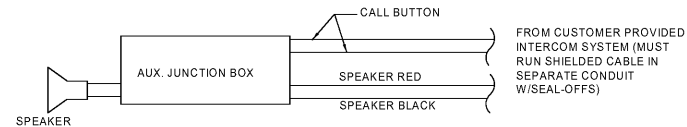

3 INTERCOM SINGLE LINE DIAGRAM
 N.T.S.

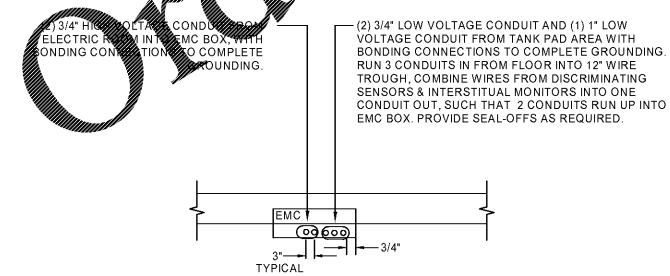

1 TANK MONITORING DETAIL
 N.T.S.

Order Plans @ WWW.LDILine.com