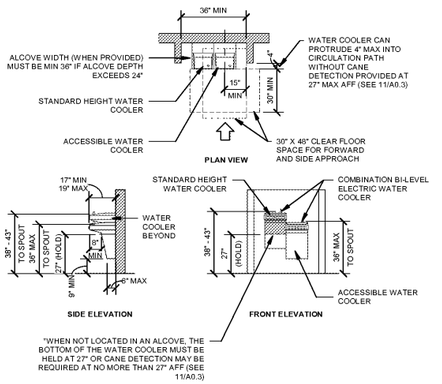

NOTES:
1. THE CLEAR FLOOR SPACE REQUIRED FOR FORWARD APPROACH SHALL BE CENTERED ON THE UNIT AND SHALL INCLUDE KNEE AND TOE CLEARANCE (SEE 9/A0.3 AND 10/A0.3)

2. PARTS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5 POUNDS MAX.

3. THE SPOUT SHALL BE LOCATED 15" MAX FROM THE VERTICAL SUPPORT AND 5" MAX FROM THE FRONT EDGE OF THE UNIT, INCLUDING BUMPERS.

4. THE SPOUT SHALL PROVIDE A FLOW OF WATER 4" HIGH MIN AND SHALL BE LOCATED 5" MAX FROM THE FRONT OF THE UNIT. THE ANGLE OF THE WATER STREAM SHALL BE MEASURED HORIZONTALLY RELATIVE TO THE FRONT FACE OF THE UNIT. WHERE SPOUTS ARE LOCATED LESS THAN 3" FROM THE FRONT OF THE UNIT, THE ANGLE OF THE WATER SHALL BE 30° MAXIMUM. WHERE SPOUTS ARE LOCATED BETWEEN 3" AND 5" MAX FROM THE FRONT OF THE UNIT, THE ANGLE OF THE WATER STREAM SHALL BE 15° MIN.

1 DRINKING FOUNTAIN AND ALCOVE DETAIL
1/4" = 1'-0"

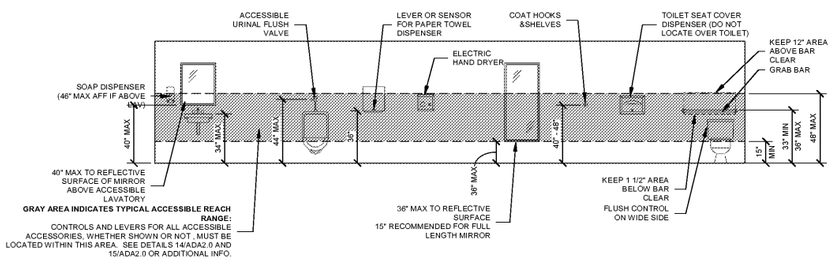

NOTES:
1. THE CLEAR FLOOR SPACE AT ACCESSORIES SHALL BE 30" X 48 MIN

2. UNLESS NOTED OTHERWISE, THE CLEAR FLOOR SPACE MAY BE POSITIONED OR EITHER FORWARD OR PARALLEL APPROACH TO AN ELEMENT.

3. OPERABLE PARTS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5 POUNDS MAX.

4. REFER TO 14/ADA2.0 AND 15/ADA2.0 FOR DETAILED INFORMATION REGARDING FORWARD AND SIDE REACH REQUIREMENTS.

5. TOILET ROOM ACCESSORIES MUST BE LOCATED OR SELECTED SO THEY ARE NOT PROTRUDING OBJECTS INTO THE CIRCULATION SPACE. SEE DETAILS 11/ADA2.0 AND 12/ADA2.0 FOR ADDITIONAL INFORMATION.

2 TOILET & BATHING ROOM ACCESSIBLE ACCESSORY MOUNTING HEIGHTS
1/4" = 1'-0"

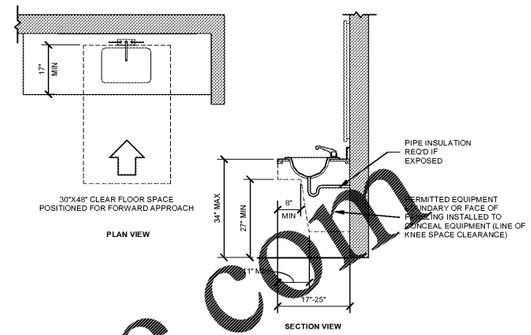

NOTES:
1. A CLEAR FLOOR SPACE IS POSITIONED FOR FORWARD APPROACH, AND KNEE AND TOE CLEARANCE SHALL BE PROVIDED (SEE 9/A0.3 AND 10/ADA2.0)

2. THE FRONT OF SINK SHALL BE 34" MAX ABOVE THE FINISH FLOOR, MEASURED TO THE FIXTURE RIM OR COUNTER SURFACE, WHICHEVER IS HIGHER.

3. HAND-OPERATED, SELF-CLOSING FAUCETS SHALL REMAIN OPEN FOR 10 SECONDS MIN.

4. WATER SUPPLY AND DRAIN PIPES UNDER SINKS SHALL BE INSULATED OR OTHERWISE CONFIGURED TO PROTECT AGAINST CONTACT. THERE SHALL BE NO SHARP OR ABRASIVE SURFACES UNDER SINKS.

5. OPERABLE PARTS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5 POUNDS MAX.

3 ACCESSIBLE SINK AND COUNTERTOP DETAIL
1/2" = 1'-0"

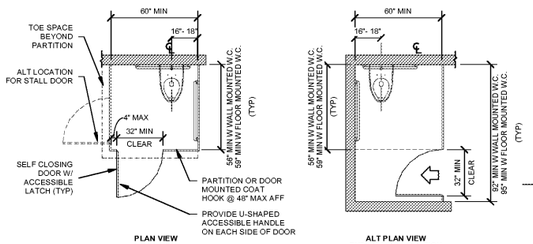

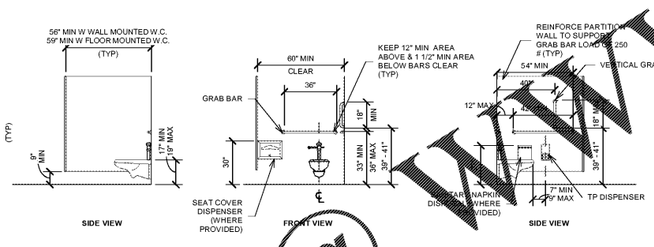

NOTES:
1. THE WATER CLOSET SHALL BE POSITIONED WITH A WALL OR PARTITION TO THE REAR AND ONE SIDE. THE CENTERLINE OF THE WATER CLOSET SHALL BE 16"-18" FROM THE SIDE WALL OR PARTITION.

2. WHEELCHAIR ACCESSIBLE COMPARTMENTS SHALL BE 60" MIN WIDE PERPENDICULAR TO THE SIDE MOUNTED WATER CLOSETS MEASURED PERPENDICULAR TO REAR WALL.

3. DOORS SHALL BE LOCATED IN THE FRONT PARTITION OR IN THE SIDE WALL OR PARTITION FARTHEST FROM THE SIDE WALL OR PARTITION FARTHEST FROM THE WATER CLOSET. WHERE LOCATED IN THE SIDE WALL OR PARTITION, THE DOOR OPENING SHALL BE 4" MAX FROM THE FRONT PARTITION. THE DOOR SHALL BE SELF CLOSING. AN ACCESSIBLE DOOR PULL SHALL BE PLACED ON BOTH SIDES OF THE DOOR NEAR THE LATCH. COMPARTMENT DOORS SHALL NOT SWING INTO THE MINIMUM REQUIRED COMPARTMENT AREA.

4. IN WHEELCHAIR ACCESSIBLE COMPARTMENTS, THE FRONT PARTITION AND AT LEAST ONE SIDE PARTITION SHALL PROVIDE A 9" MIN TOE CLEARANCE EXTENDING 6" DEEP BEYOND THE COMPARTMENT PARTITION EXCLUSIVE OF PARTITION SUPPORT MEMBERS. TOE CLEARANCE AT THE FRONT OF THE PARTITION IS NOT REQUIRED IN A COMPARTMENT GREATER THAN 62" DEEP WITH A WALL-HUNG WATER CLOSET OR 66" DEEP WITH A FLOOR-MOUNTED WATER CLOSET. TOE CLEARANCE AT THE SIDE PARTITION IS NOT REQUIRED IN A COMPARTMENT GREATER THAN 60" WIDE.

5. A SIDE WALL GRAB BAR SHALL BE PROVIDED ON THE WALL CLOSEST TO WATER CLOSET AND A REAL-WALL GRAB BAR SHALL BE PROVIDED.

6. COAT HOOKS PROVIDED WITHIN TOILET COMPARTMENTS SHALL BE 48" MAX ABOVE THE FLOOR. WHERE PROVIDED, A FOLD-DOWN SHELF SHALL BE 40" MIN AND 48" MAX ABOVE THE FINISH FLOOR.

7. DOOR MANEUVERING CLEARANCES SHALL BE PROVIDED AT COMPARTMENT DOORS. IF THE APPROACH IS TO THE LATCH SIDE OF THE DOOR, CLEARANCE BETWEEN THE DOOR SIDE OF THE COMPARTMENT AND ANY OBSTRUCTION SHALL BE 42" MIN

** WHEN PARTITION DOOR SWINGS INTO THE STALL

4 ACCESSIBLE TOILET STALL & WATER CLOSET DETAIL
1/4" = 1'-0"



5 ACCESSIBLE URINAL DETAIL
1/4" = 1'-0"

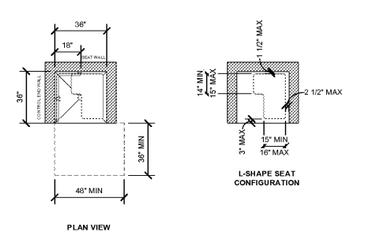

7 ACCESSIBLE TRANSFER SHOWER DETAIL
1/4" = 1'-0"

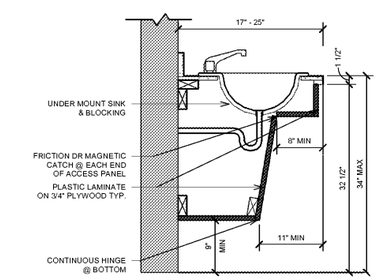

6 ENLARGED ADA VANITY DETAIL
1" = 1'-0"

Order Plans @ WWW.LDILine.com

PRICING SET
NOT FOR CONSTRUCTION

EXPIRATION DATE:

COPYRIGHT NOTICE
THE DRAWINGS ARE THE PROPERTY OF RIVER STREET ARCHITECTURE LLC. ANY USE, REUSE, REPRODUCTION, DISPLAY OR SALE OF THESE DRAWINGS WITHOUT THE EXPRESS WRITTEN CONSENT OF THE ARCHITECT IS STRICTLY PROHIBITED.

river street ARCHITECTURE
123 E 7th street, suite 400 chattanooga, tennessee 37402
p.423 634 0806 www.riverstreetarchitecture.com

DRS. BRUCE & SMITH MEDICAL OFFICES
ORTHOPEDIC OFFICES
1ST FLOOR
RIVERFRONT PARKWAY
CHATTANOOGA, TN 37402

Revision Schedule

Rev. #	Rev. Date	Revision Description

Release Date: 05.10.2020
Project No.: 20021

TYPICAL ADA GUIDELINES-PLUMBING

ADA0.2

5/11/2020 1:59:27 PM