

ARCHITECT'S SEAL:

ENGINEER'S SEAL:



REVISIONS
NO DATE REMARKS

FOOD LION
2118 Executive Drive, Salisbury, NC 28145
Tel: 704.281.2228
www.foodlion.com
Food Lion is a DELHAIZE AMERICA company.


FOOD LION
REMODEL
STORE #1208
13490 DUMFRIES RD
MANASSAS, VA 20112

PROJECT NO: 2019.0917
DATE: 2-13-20

30 OF 47
MO.01

MECHANICAL DEMOLITION
PLAN

CHECKED: GIN DRAWN: AE

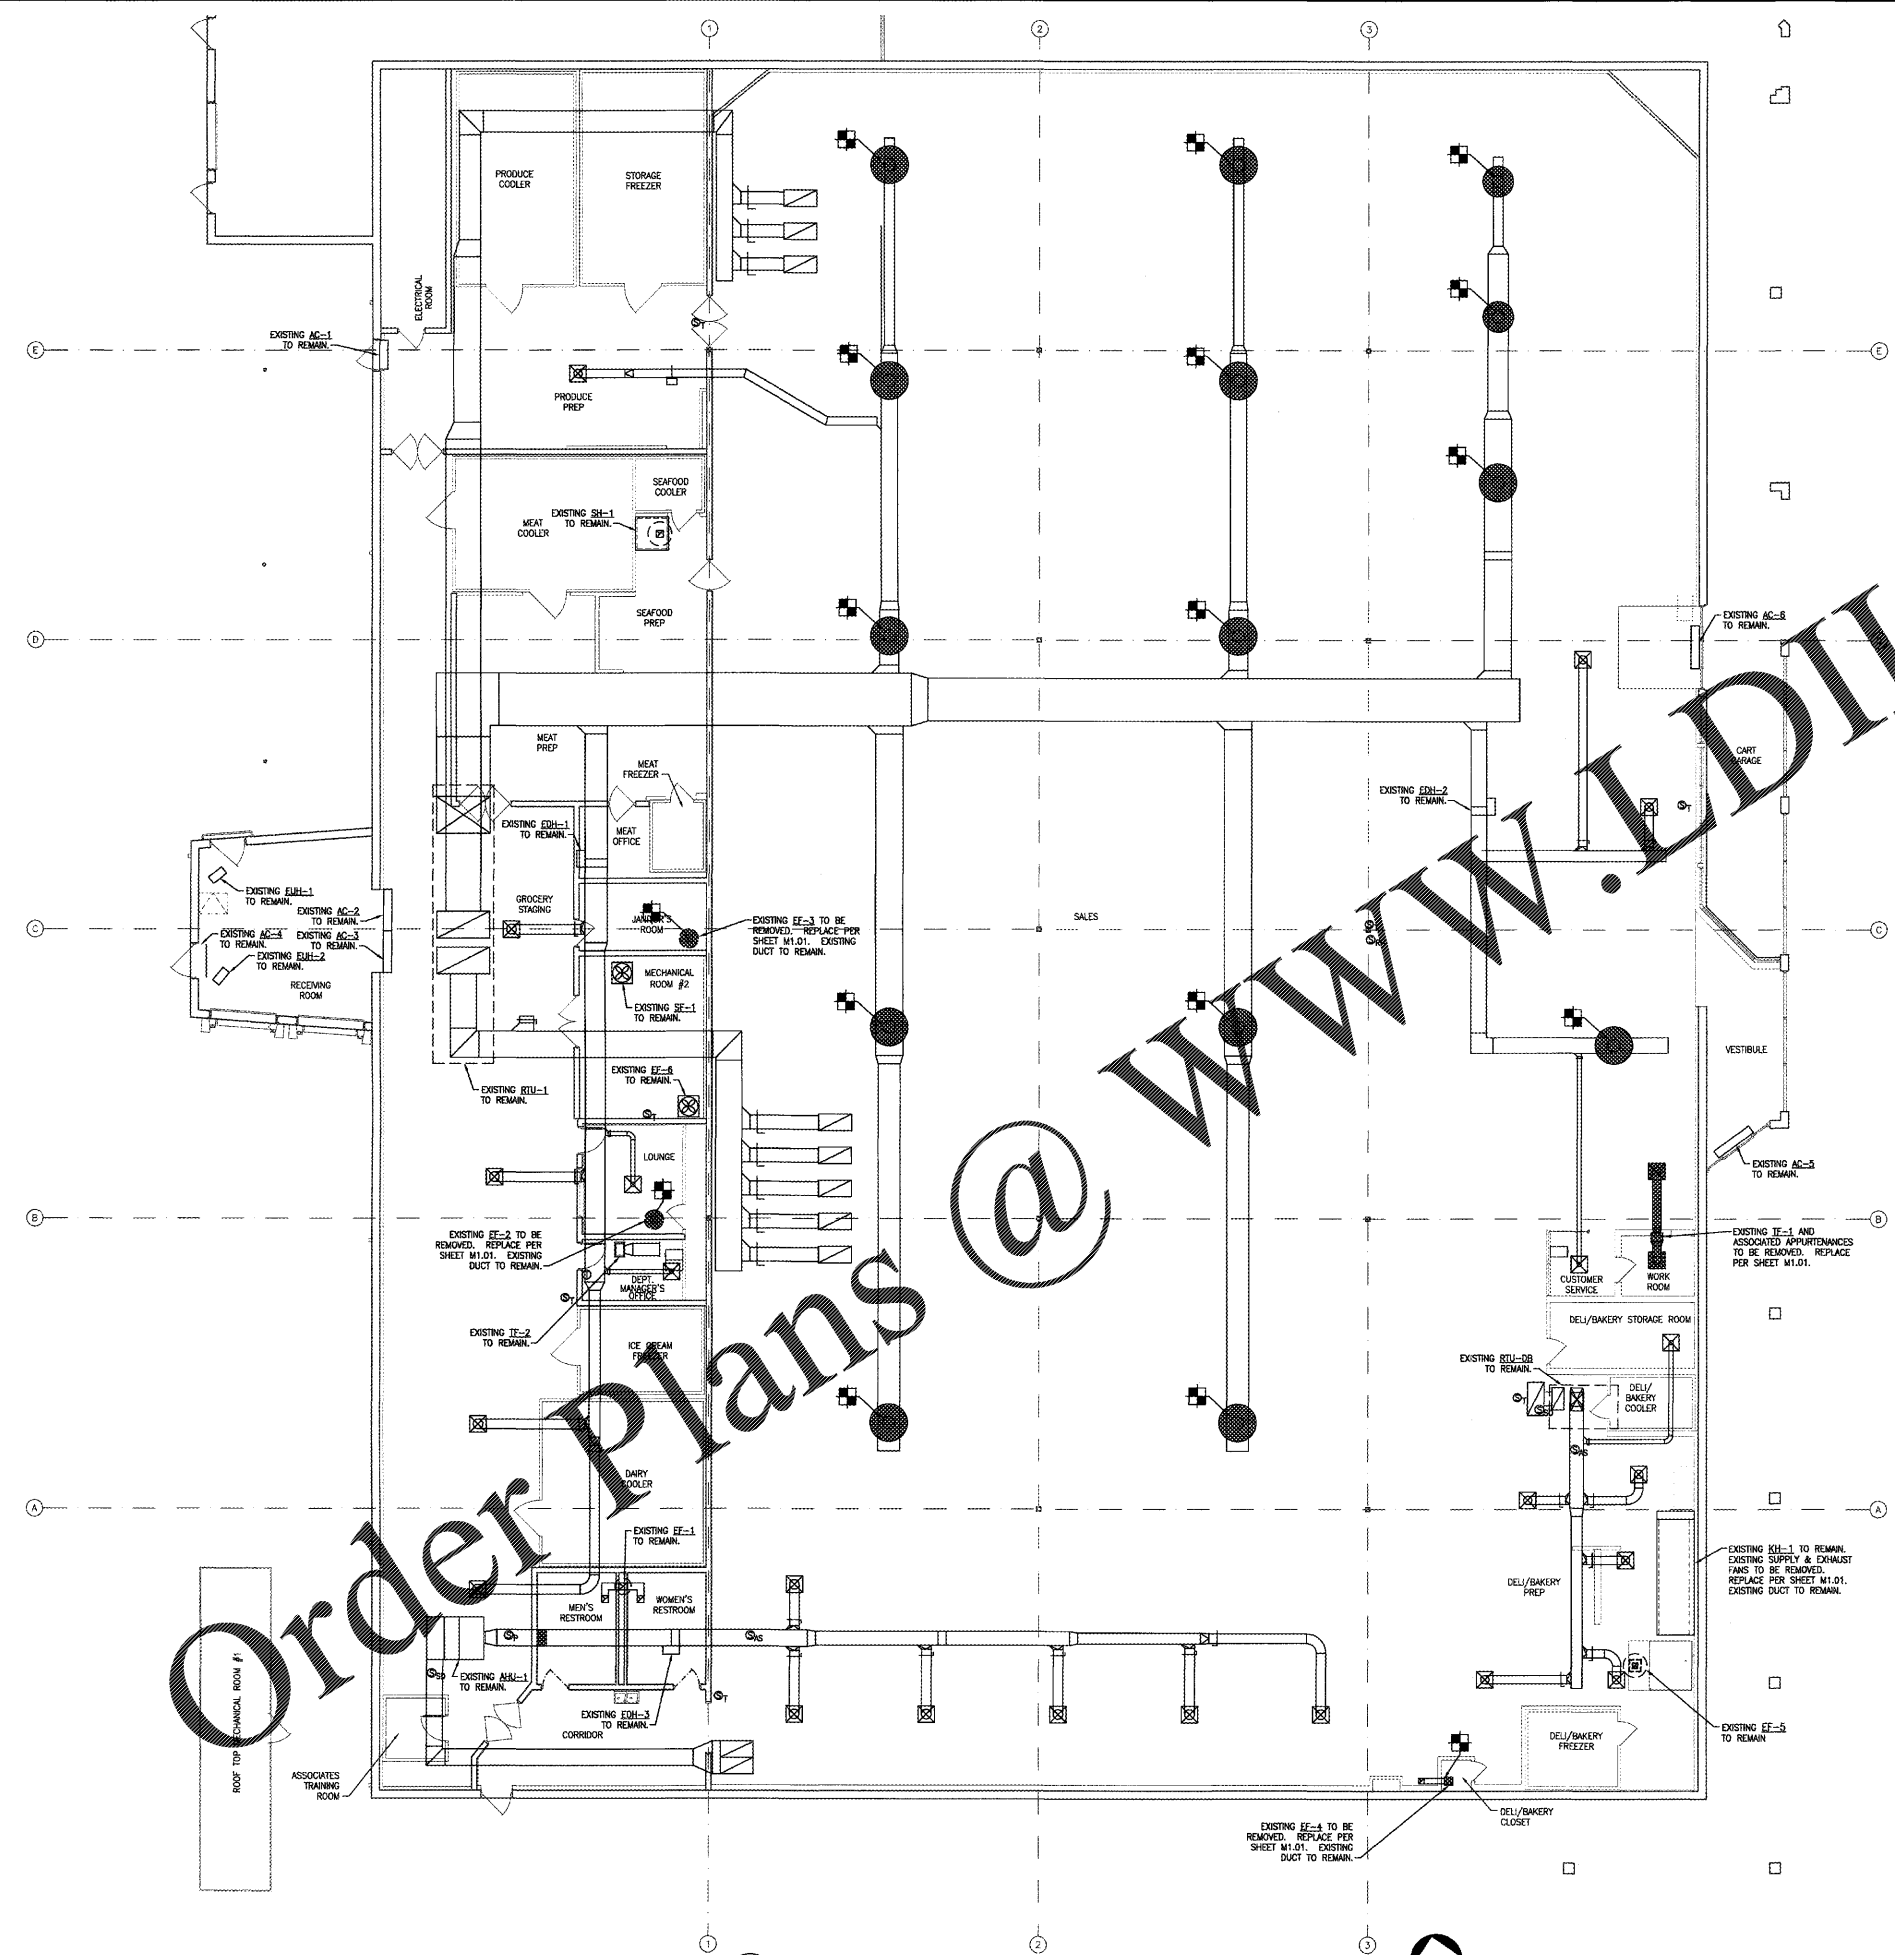

DEMOLITION NOTES

- MECHANICAL CONTRACTOR SHALL VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WITH DEMOLITION WORK. DIFFUSERS, GRILLES, DAMPERS, DUCT HEATERS, FANS, ETC. SHALL BE SALVAGED AS INDICATED ON PLAN FROM AREAS SCHEDULED FOR DEMOLITION.
- SALVAGED EQUIPMENT MAY BE RE-USED OR RELOCATED WHEN INDICATED PER SHEET M1.01. UNUSED ITEMS SHALL BE RETURNED TO Food Lion SHARED SERVICES GROUP, LLC
- ALL EXISTING MECHANICAL EQUIPMENT SHALL REMAIN UNLESS NOTED OTHERWISE.
- MECHANICAL CONTRACTOR WILL BE RESPONSIBLE FOR REMOVING ALL OLD SMOKE DETECTORS. ONCE SYSTEM HAS BEEN SWITCHED OVER TO FIRE ALARM CONTACT, MECHANICAL CONTRACTOR WILL NOTIFY GENERAL CONTRACTOR IN WRITING. MECHANICAL CONTRACTOR WILL THEN REMOVE OLD DETECTORS. WIRING FROM DETECTORS IS TO BE REMOVED TO ASSOCIATED JUNCTION BOXES AND CAPPED OFF WITH WIRE NUTS. WIRING FROM ECP TERMINALS IS TO BE REMOVED TO TROUGH AND CAPPED OFF WITH WIRE NUTS.

SYMBOL LEGEND

- 20x20 EXISTING DUCTWORK TO REMAIN - SIZE AS INDICATED. FIRST DIMENSION IS FACE OF DUCT SHOWN ON PLAN.
- EXISTING DUCTWORK TO BE REMOVED.
- MOTOR OPERATED DAMPER
- MANUAL VOLUME DAMPER
- LIMIT OF REMOVED AND/OR ABANDONED DUCTWORK

SENSOR LEGEND

- SD SMOKE DETECTOR
- RH RELATIVE HUMIDITY
- T TEMPERATURE
- AS AIR PRESSURE SWITCH
- TH THERMOSTAT
- AS DISCHARGE AIR SENSOR

ABBREVIATIONS

- AHU AIR HANDLING UNIT
- A.F.F. ABOVE FINISHED FLOOR
- O.A. OUTSIDE AIR
- S.A. SUPPLY AIR
- R.A. RETURN AIR
- RTU ROOFTOP UNIT (AIR CONDITIONING)

1 MECHANICAL DEMOLITION PLAN
MO.01 SCALE: 3/32" = 1'-0"

Order Plans @ www.DILine.com

www.DILine.com