

SYMBOL LEGEND

[Solid black square]	NEW LIGHTS	[Circle with crosshair]	EXISTING EXIT LIGHTS
[Hatched square]	RELOCATED LIGHTS	[Circle with dot]	NEW/RELOCATED EXIT LIGHTS
[Dashed line]	EXISTING LIGHTS	[Square with crosshair]	EXISTING EMERGENCY LIGHTS
[Solid line]	NEW NIGHT LIGHTS	[Circle with 'E']	NEW EMERGENCY LIGHTS
[Line with 'T']	NEW LIGHTS WITH TUBE SHIELDS	[Circle with 'EM']	ENERGY MANAGEMENT LOAD NUMBER
[Line with 'C']	EXISTING COOLER/FREEZER LIGHTS	[Line with 'L']	NEW UP-LIGHTING POWERED TRELLIS
[Line with 'N']	NEW/RELOCATED COOLER/FREEZER LIGHTS	[Line with 'NL']	NON-POWERED TRELLIS
		[Circle with 'C']	CEILING MOUNTED OCCUPANCY SENSOR
		[Circle with 'R']	CEILING MOUNTED RECEPTACLE
		[Circle with 'S']	WALL SWITCH

GENERAL NOTES:


- LIGHT FIXTURES SHALL BE MANUFACTURED BY LITHONIA UNLESS NOTED OTHERWISE. PURCHASE FROM SYLVANIA AT THE NATIONAL CONTRACT PRICE. FOR PURCHASE, CONTACT SYLVANIA AT 1-800-573-1514 EXT. 0086. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING QUANTITIES, RATINGS, LENGTHS, ETC. ANY DISCREPANCIES SHALL BE RESOLVED WITH SYLVANIA PRIOR TO BID. CONTRACTOR SHALL BE RESPONSIBLE FOR ANY ADDITION TO THE BILL OF MATERIALS DUE TO LOCAL, STATE GOVERNMENTAL CODES.
- EMERGENCY & EXIT LIGHTS SHOWN WITH MINIMUM NUMBER OF RECORD SHALL PROVIDE EMERGENCY LIGHT FIXTURES IN ACCORDANCE WITH LIFE SAFETY CODE 101 SECTIONS 5-9 AND LOCAL ORDINANCE.
- ALL JUNCTION BOXES LOCATED IN COOLERS & FREEZERS ARE TO BE WEATHERPROOF AFTER WIRING IS COMPLETE. SEAL ALL PENETRATIONS PER NEC 300-15 TO PREVENT MOISTURE TRANSFER AND ACCUMULATION. ANY MOISTURE ACCUMULATION/CONDENSATION OR ICE PRESENT WITHIN A REFRIGERATED SPACE, CONDUIT BODY, ELECTRICAL BOX OR FIXTURE SHALL BE REMOVED WHILE THE ENTRY POINT IS PROPERLY REPAIRED/SEALED.
- ALL LIGHT SWITCHES ARE TO BE MOUNTED NO MORE THAN 48" A.F.F. PER THE REQUIREMENTS OF A.D.A. ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR RUNNING ALL NEW WIRING TO PANELS & CONNECTION OF ALL FIXTURES.
- ELECTRICAL CONTRACTOR SHALL SUPPLY & INSTALL END CAPS ON BOTH ENDS OF EVERY NEW LIGHT FIXTURE RUN. NO END CAPS SHALL BE INSTALLED BETWEEN TWO ADJOINING FIXTURES.
- ELECTRICAL CONTRACTOR SHALL SUPPLY & INSTALL JUNCTION BOXES ABOVE BAR JOISTS.
- ALL EMERGENCY LIGHTING SHALL BE ON A SCHEDULED CIRCUIT, AND ON THE LINE SIDE OF ANY ENERGY MANAGEMENT CONTROLS.
- "NL" INDICATES FIXTURES ON A NIGHT LIGHT CIRCUIT.
- ALL HOME RUNS SHALL GO TO EXISTING PANELS, UNLESS INDICATED OTHERWISE. THE ELECTRICAL CONTRACTOR SHALL VERIFY SIZE WITH EQUIPMENT AND SUPPLY ALL NEW BREAKERS AND RE-SIZED BREAKERS FOR EXISTING CIRCUITS AS REQUIRED.
- ALL NEW WIRING SHALL BE DONE IN STRICT ACCORDANCE WITH N.E.C. STANDARDS AND WITH FOOD LION STANDARDS. NO COLOR SENSITIVE OR HAZARDOUS WORK WILL BE ACCEPTED. NO COLOR CHANGES IN WIRING RUNS, MISLABELED CIRCUITS, ETC.
- ELECTRICAL CONTRACTOR IS TO MAKE SURE THAT NO MC OR FLEX CABLES ARE USED UNLESS OTHERWISE NOTED. MC OR FLEX CABLES CAN ONLY BE USED IN SHORT RUNS FOR LIGHTING FEEDS. ELECTRICAL METAL TUBING MUST BE USED TO CONNECT PANEL TO JUNCTION BOX AND HAVE COMPRESSION TYPE FITTINGS. SEE SPECIFICATIONS FOR STANDARD PRACTICES.
- ALL UP-LIGHTING ATOP THE PERIMETER HIGH DECK REFRIGERATED CASES SHALL BE TYPE "OZA" OR "OZA1" (SEE LIGHT FIXTURE SCHEDULE ON SHT. E6.02). UP-LIGHTING SHALL BE INSTALLED THRU THE ENERGY MANAGEMENT SYSTEM; REFER TO E6.03 FOR CORRECT LOAD #. INSTALL A COMBINATION OF 4" AND 8" LIGHT FIXTURES ABOVE THE CASES FOR EVEN LIGHT DISTRIBUTION ALONG THE WALLS. EXAMPLE: 8" CASE SHOULD GET (2) 4" LIGHT FIXTURES OVERLAPPED. LIGHTING TO BE INSTALLED AT LEAST 8" IN FROM THE EDGES OF THE CASES AND AS CLOSE TO THE FRONT OF THE CASE AS THE VALANCE WILL ALLOW.
- THE FOOD LION STOREFRONT SIGN IS FURNISHED & INSTALLED BY OTHERS. THE ELECTRICAL CONTRACTOR SHALL PROVIDE PIG-TAILS, FINAL CONNECT WIRE STOREFRONT SIGN AND WIRE TO APPROPRIATE CIRCUITS.
- ANY LIGHT FIXTURES TO BE REUSED ARE TO BE REMOVED AND STORED IN A MANNER THAT REMAINS REUSABLE IN A SECURED TRAILER BY THE GC/EC.
- ALL "E1" LIGHTING SHALL BE ON A DEDICATED OR LABELED CIRCUIT AND BE ON THE LINE SIDE OF ANY ENERGY MANAGEMENT CONTROLS.
- REFER TO SHEET E6.02 FOR LIGHT FIXTURE SCHEDULE.
- REFER TO SHEET E6.03 FOR ENERGY MANAGEMENT SYSTEM NOTES.

HANGING TRACK SYSTEM NOTES: (SUPPLIED BY FOOD LION)


- PRODUCE AREA EQUIPMENT (SILVER COATED)**
2 CIRCUIT SILVER TRACK BY BUS STRUT; PROVIDED BY FOOD LION, INSTALLED BY DECOR VENDOR, WIRED BY ELECTRICAL CONTRACTOR.
- ELECTRICAL:**
THE TRACK SYSTEM WILL HAVE A SINGLE CORNER DROP FROM A 4"x4" JUNCTION BOX STRATEGICALLY LOCATED IN THE BAR JOISTS ABOVE THIS AREA. BX CORD TO BE SILVER. ELECTRICAL CONTRACTOR TO PROVIDE TWO (2) 20 AMP CIRCUITS. ELECTRICIAN WILL NEED 90-DEGREE CONNECTOR INTO KNOCKOUT OF FITTING.
- TRELLIS SCENARIOS:**
- EXISTING TRELLIS (1 CIRCUIT TRACK) TO REMAIN- NO CHANGES. EXISTING TRELLIS WILL REMAIN ON SINGLE ELECTRICAL CIRCUIT AND EMS LOAD 1.
 - EXISTING TRELLIS (2 CIRCUIT TRACK) TO REMAIN- EC TO VERIFY 2 ELECTRICAL CIRCUITS ARE DEDICATED AND SPLIT 1/3 VS. 2/3 ON EMS LOADS 1 & 9.
 - EXISTING TRELLIS TO BE REPLACED WITH BUS STRUT- EC TO VERIFY 2 ELECTRICAL CIRCUITS ARE DEDICATED ON EMS LOADS 1.
 - NO TRELLIS EXISTING, ADDING BUS STRUT- REQUIRES 2 DEDICATED CIRCUITS, ON EMS LOADS 1.
- GC SHALL NOT WIRE TRELLIS TO AN EXISTING LIGHTING LOAD/RUN.**
- TRACK LAYOUT:**
THE PRODUCE TABLE ARRANGEMENT ON THESE DRAWINGS HAS BEEN APPROVED AND SHOULDN'T BE CHANGED UNLESS REQUESTED BY FOOD LION. BE SURE THAT THE TRACK HEADS ARE MOUNTED AS INDICATED ON THE DRAWINGS. ADJUSTMENT CAN BE MADE AFTER THE TABLES ARE IN PLACE.
- INSTALLATION (BY DECOR CONTRACTOR):**
THE TRACK SYSTEM AND TRACK HEADS WILL BE DELIVERED AND INSTALLED BY SOUTHEASTERN PRODUCTS. ELECTRICAL CONTRACTOR TO PROVIDE POWER TO TRACK AND CONNECT.
- TRELLIS MOUNTING HEIGHTS (APPLICABLE TO NEW TRELLISES):**
- 10" AFF CEILING- MOUNT TRELLIS TO CEILING, MAINTAIN 8" MIN. HORIZONTAL CLEARANCE FROM SPRINKLER HEADS.
 - 11" AFF CEILING- MOUNT TRELLIS TO CEILING, MAINTAIN 8" MIN. HORIZONTAL CLEARANCE FROM SPRINKLER HEADS.
 - 12" AFF CEILING & HIGHER- MOUNT AT 10"-6" AFF.
 - OPEN CEILING- SUSPEND AT 12"-0" AFF.
 - GARDEN COOLER INTERIOR- MOUNT TRELLIS AT 10"-6" AFF.
 - GARDEN COOLER SALES AREA- SEE ABOVE.
- BUS STRUT CONTACT:**
ELIZABETH DURBIN (614)933-8695 X. 1006
EADURBIN@BUSSTRUT.COM

LIGHTING PLAN KEY NOTES

- STORE FRONT SIGN TO BE REPEALED. RECONNECT TO EXISTING CIRCUITS. COORDINATE REQUIREMENTS WITH SIGN CONTRACTOR.
- ELECTRICAL CONTRACTOR TO ORDER AND INSTALL 4" OF "04" LED LIGHTING FOR TOI SIGNAGE MOUNTED TO BACK OF BULKHEAD.
- NEW LIGHT FIXTURE TO MATCH EXISTING, CONNECT TO EXISTING ELECTRICAL CIRCUIT. FIELD VERIFY EXISTING CONDITIONS; ELECTRICAL CONTRACTOR TO VERIFY EXISTING CIRCUIT IS NOT OVERLOADED.
- RECEPTACLE AND JUNCTION BOX FOR DELI MONITOR MOUNTED IN CEILING TILE. COORDINATE EXACT LOCATION WITH FOOD LION CONSTRUCTION MANAGER.
- EXISTING LIGHT REMOVED. RECONNECT NEW LIGHTS TO EXISTING CIRCUIT. ELECTRICAL CONTRACTOR TO VERIFY EXISTING CIRCUIT IS NOT OVERLOADED.
- CONNECT EMERGENCY LIGHT FIXTURE TO EXISTING EMERGENCY CIRCUIT AHEAD OF ANY SWITCHING.

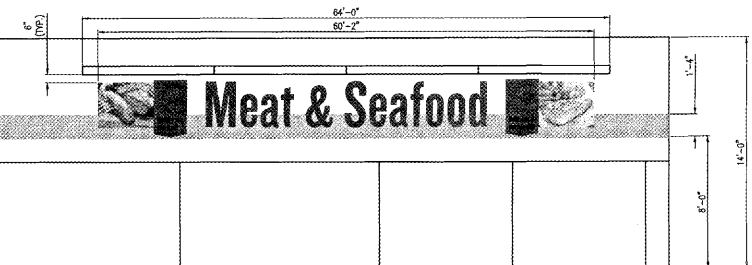

3 SUSPENDED DECOR SIGNAGE LIGHTING DETAIL
E1.01 NTS

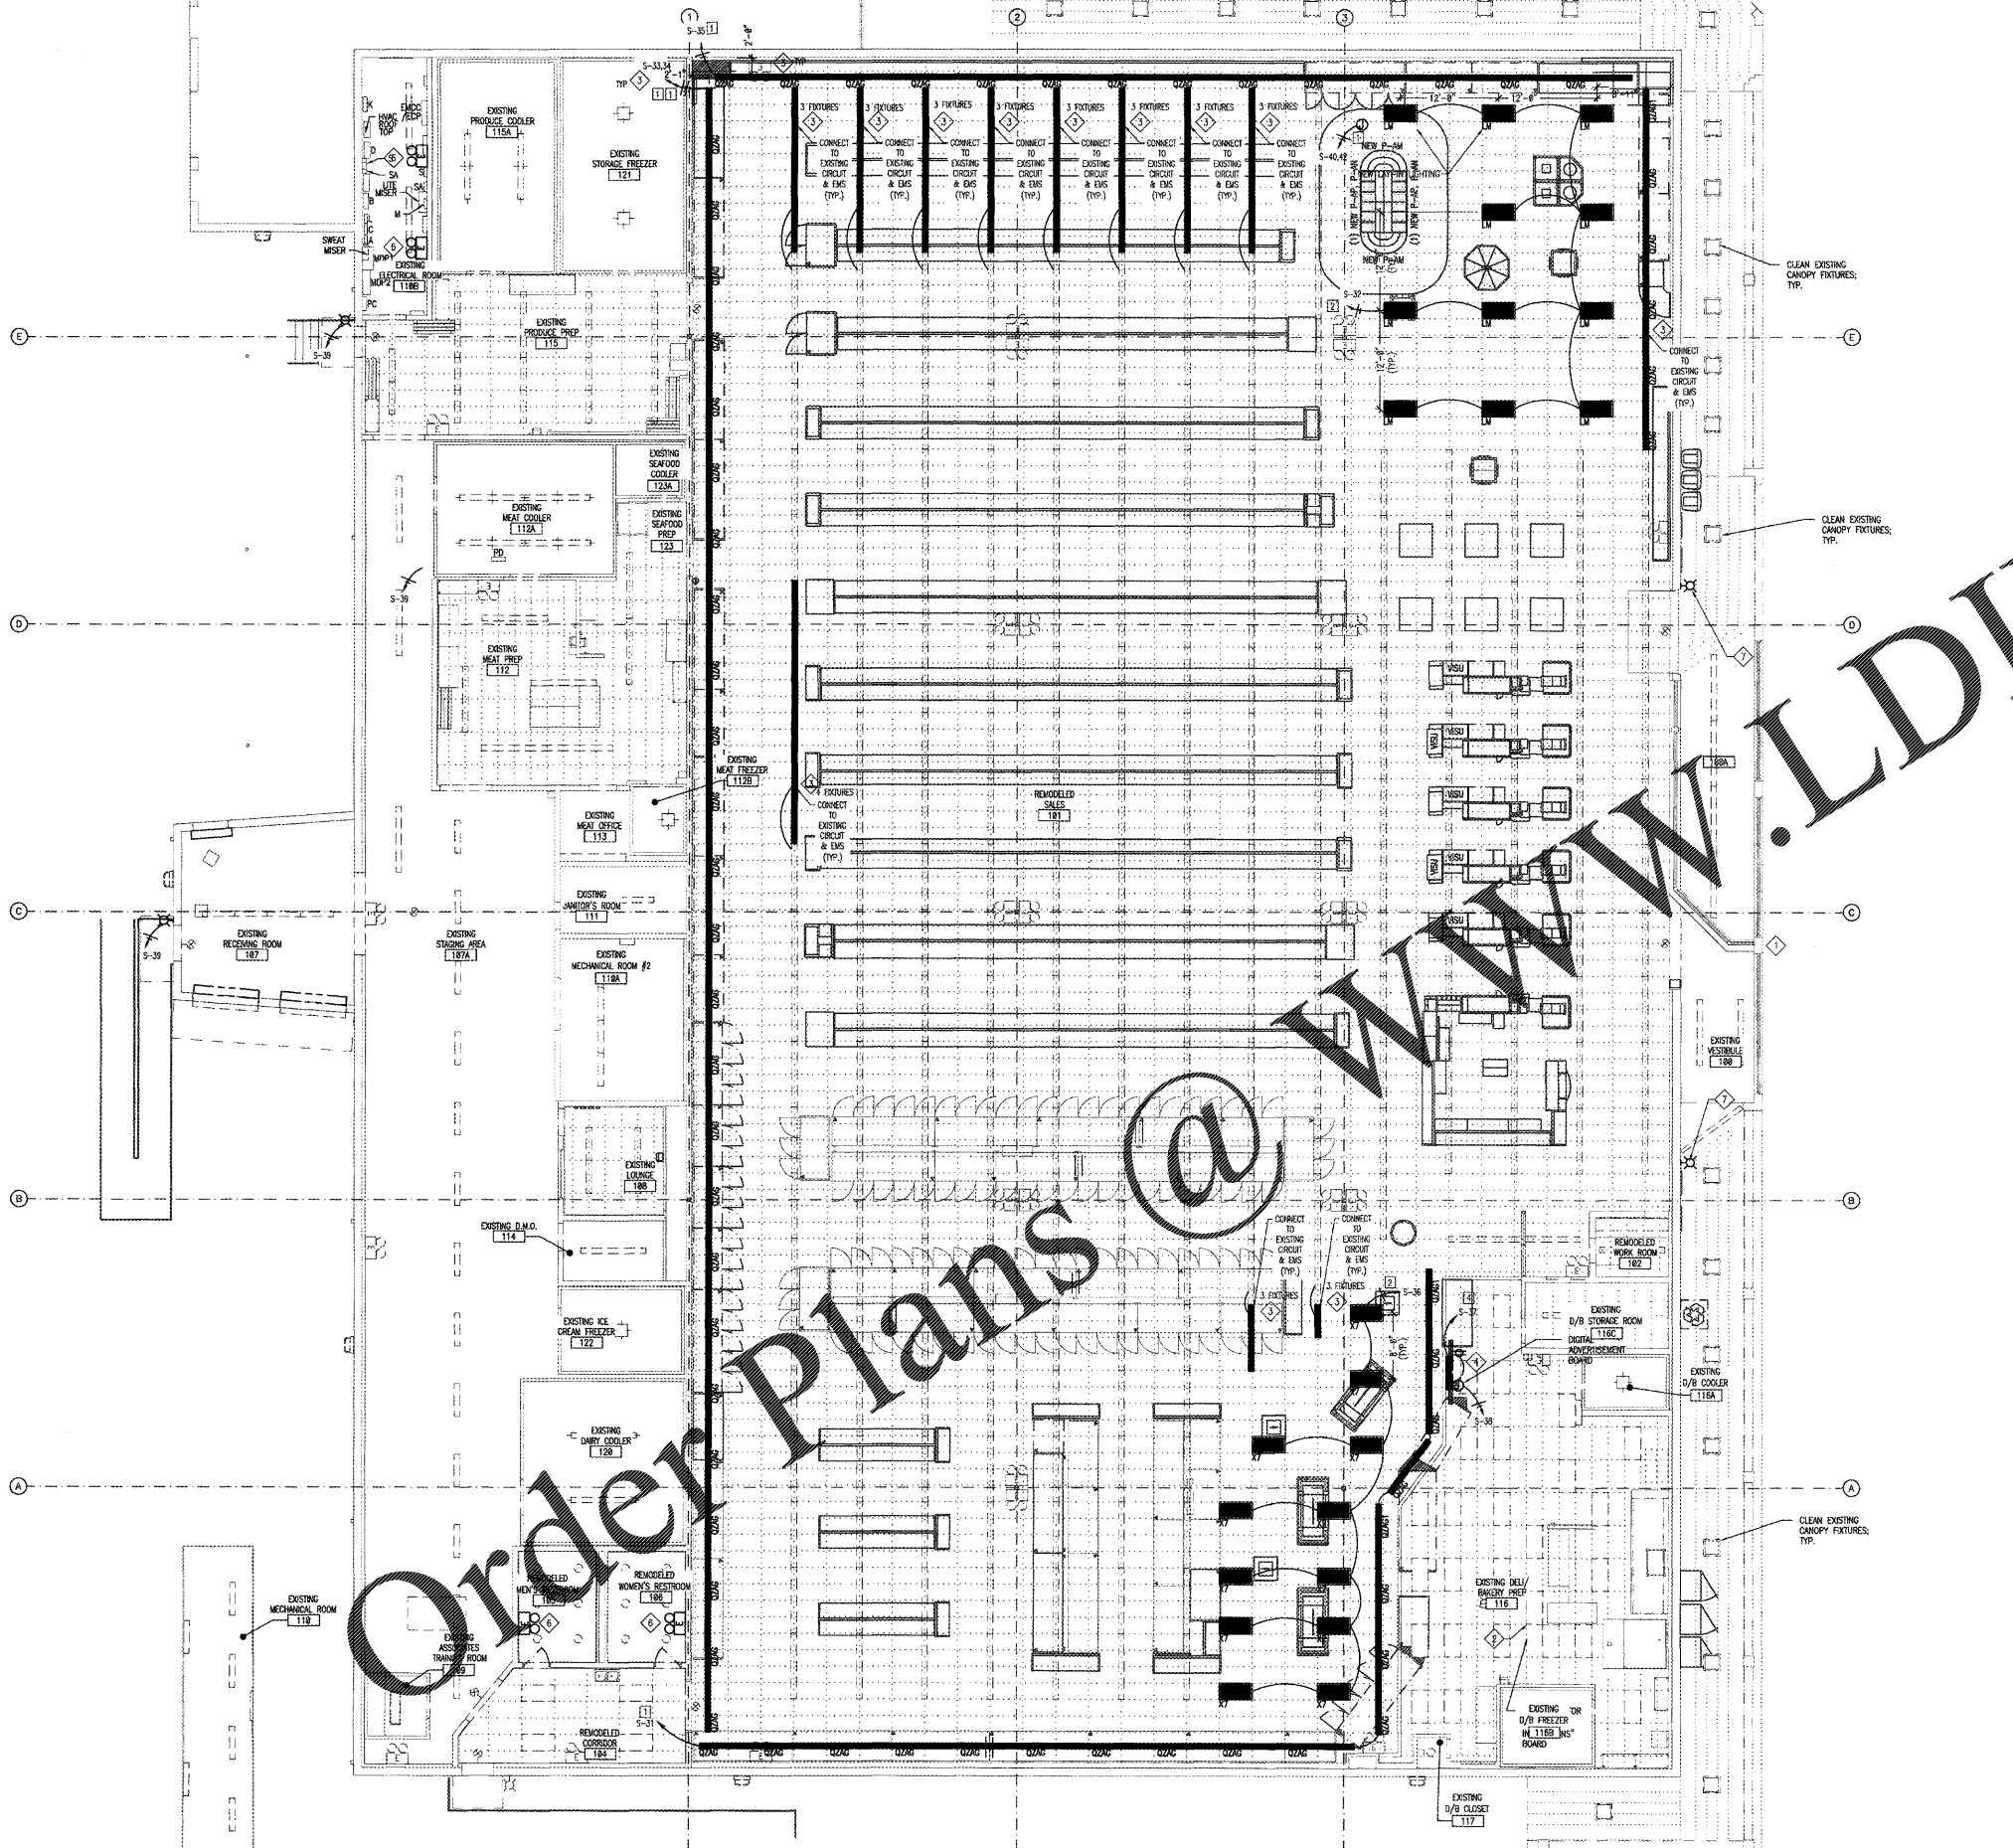

1 ELECTRICAL LIGHTING PLAN
E1.01 SCALE: 3/32" = 1'-0"



- ELECTRICAL DEFICIENCIES TO BE REPAIRED:**
- EMERGENCY LIGHTING-FED FROM R 4, M 4, 10. LIGHTS AT OSD EXIT AND EGRESS WERE CONFIRMED TO NOT ILLUMINATE WHEN ABOVE CIRCUITS WERE DE-ENERGIZED. REPAIR, ALL EMERGENCY LIGHTING SHALL BE FED FROM A BRANCH CIRCUIT PANEL BOARD, ON THE LINE SIDE OF ANY ENERGY MANAGEMENT CONTROLS, AND SHALL BE LABELED / SCHEDULED AS SUCH.
 - UPDATE EGRESS LIGHTING - UPDATE FIXTURES ON THE FOLLOWING DOORS: BOTH FRONT ENTRANCES. WORK WITH OWNER ON FIXTURE SELECTION.