CHECKOUT INSTALLATION NOTES

1. SEE SHEET E4.03 FOR WORKROOM, CUSTOMER SERVICE AND CHECKOUT COMMUNICATION WIRING.
2. CASH REGISTER CIRCUITS SHALL BE PROVIDED WITH DEDICATED NEUTRAL AND GREEN ISOLATED GROUND.
3. BX CABLES SHALL BE INSTALLED WITH INSULATED THROATS AND APPROVED CONNECTORS.
4. ELECTRICAL CONTRACTOR SHALL LEAVE A PULL STRING IN CEILING J-BOX AT COMMUNICATIONS SECTION OF "TELE-POWER" POLE FROM THE COMMUNICATION JUNCTION BOX TO EACH CHECKOUT FOR USE BY OTHERS.
5. ELECTRICAL CONTRACTOR SHALL COORDINATE TELEPOLE LOCATIONS WITH LIGHTING & HVAC PRIOR TO INSTALLATION TO MINIMIZE INSTALLATION CONFLICTS.

CHECKOUT WIRING LEGEND

- DIRTY CIRCUIT No. 1 (BELT MOTOR, STAND LIGHT, CANDY RACK LIGHTS GEN. RECEPTACLES.)
- DIRTY CIRCUIT No. 2 (VISU COOLERS)
- CLEAN CIRCUIT No. 1 (REGISTER, CATALINA, DEBIT CARD, SCANNER & SCALE, SPARE RECEP.)

ELECTRICAL WIRING KEY NOTES (X)

(1) EXISTING PANEL SCHEDULE FOR PANEL CR AND OW NOT LABELED CORRECTLY. ELECTRICAL CONTRACTOR TO TRACE AND FIELD VERIFY EACH CIRCUIT IN PANEL CR AND OW PROPERLY LABEL CIRCUITS IN TYPED WRITTEN PANEL SCHEDULE IN EACH PANEL.

(2) ELECTRICAL CONTRACTOR TO CONNECT POWER FOR NEW CHECK STAND "DIRTY POWER" AND VISU COOLERS TO EXISTING CIRCUITS IN PANEL OW MADE SPARE BY REMOVAL OF EXISTING CHECK STAND EQUIPMENT.

(3) ELECTRICAL CONTRACTOR TO CONNECT RELOCATED EQUIPMENT TO INDICATED CIRCUIT.

(4) VERIFY EXISTING CONDITIONS- CIRCUIT TO BE DEDICATED FED FROM CR PANEL, RE-CIRCUIT AS NECESSARY.

(5) ELECTRICAL CONTRACTOR TO CONNECT NEW EQUIPMENT TO NEW CIRCUITS OR REUSE EXISTING CIRCUITS AS NOTED.

(6) CONDUITS ON THIS WALL TO BE RECESSED BEHIND GWB.

(7) MOUNT QUAD OUTLET FLUSH IN THE CHECKOUT STAND FOR THE VISU COOLER(S) AND LED CANDY RACK LIGHTING AT THIS LOCATION. RECEPTACLE TO BE MOUNTED 1'-4" A.F.F. IN THE SIDE NEAREST THE CASHIER AND ACCESSIBLE TO THE VISU COOLER PIGTAIL CONNECTION. FACE PLATE TO BE PAINTED TO MATCH CHECKOUT STAND COLOR. COORDINATE LOCATION WITH PRE-WIRED CONTROLS MOUNTED INSIDE THE CHECKOUT.

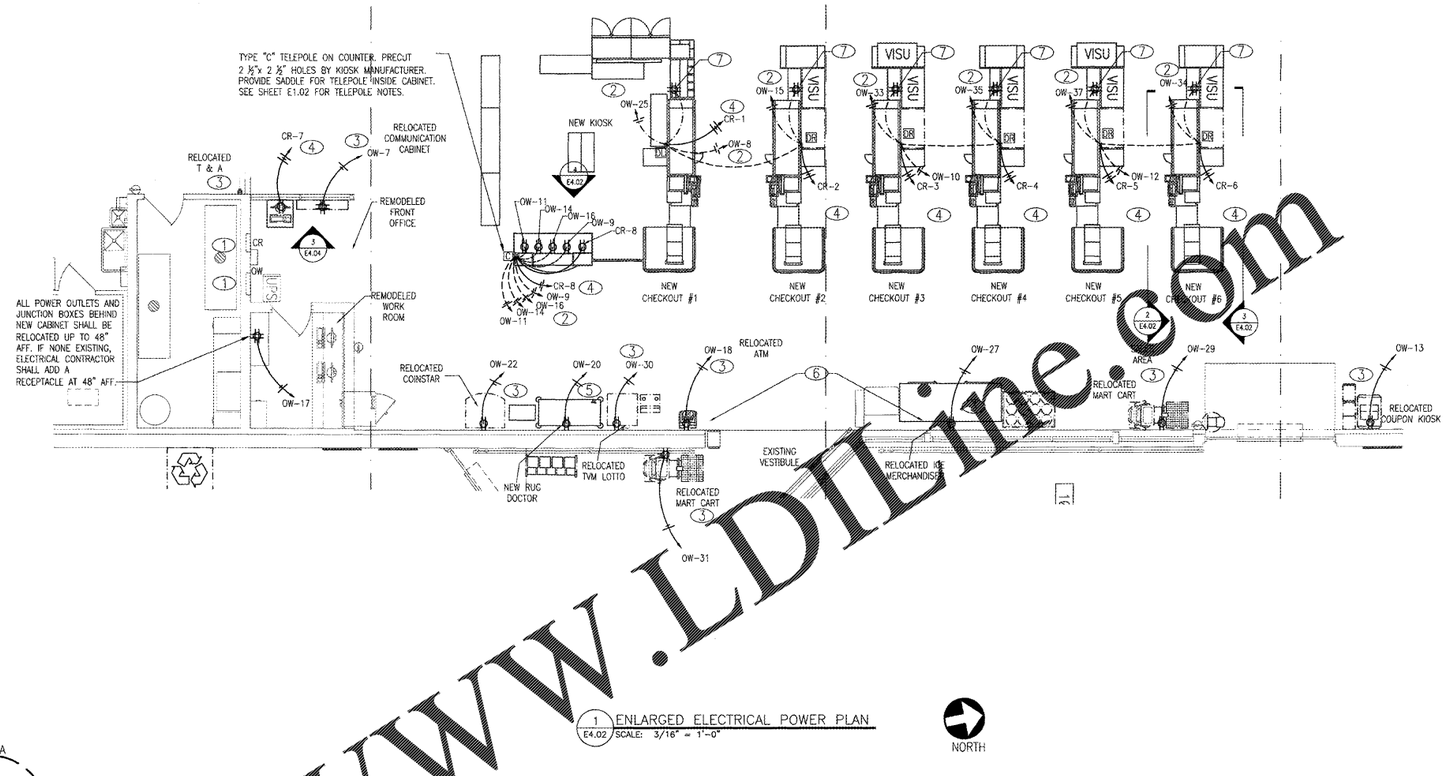

1 E4.02 ENLARGED ELECTRICAL POWER PLAN
SCALE: 3/16" = 1'-0"

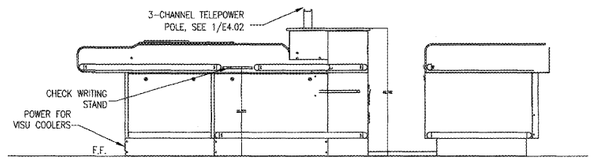

2 E4.02 SERVICE SIDE ELECTRICAL ELEVATION
NOT TO SCALE

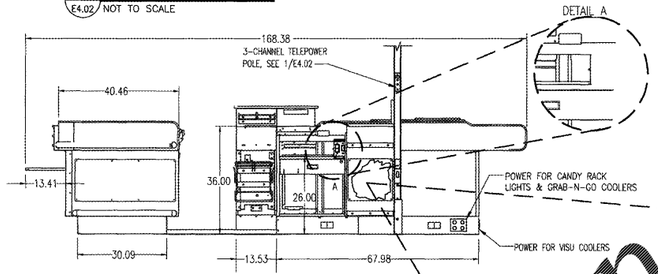

3 E4.02 ASSOCIATE SIDE ELECTRICAL ELEVATION
NOT TO SCALE

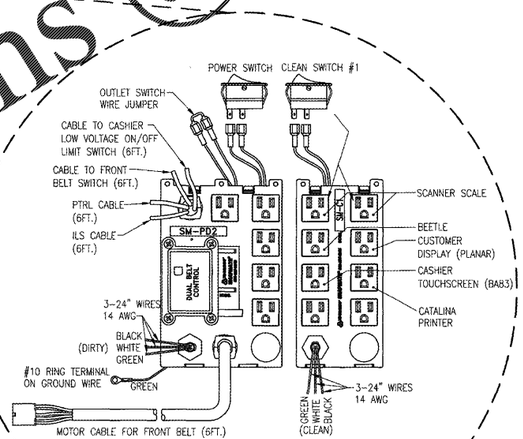

WIRING HARNESS (SUPPLIED WITH CHECKOUT)

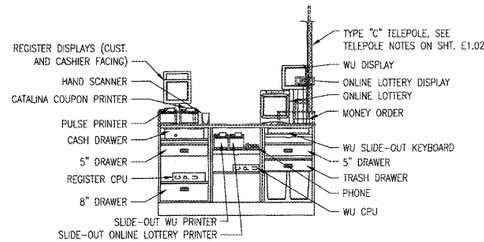

4 E4.02 CUSTOMER SERVICE KIOSK ELECTRICAL ELEVATION
NOT TO SCALE

Order Plans @ WWW.LDline.com

INTERPLAN LLC
ARCHITECTURE
ENGINEERING
INTERIOR DESIGN
PROJECT MANAGEMENT
604 COURTLAND STREET
SUITE 100
ORLANDO, FLORIDA 32804
PH 407.645.5008
FX 407.629.9124

ARCHITECT'S SEAL:

ENGINEER'S SEAL:

COMMONWEALTH OF VIRGINIA
STACY TREVOR HENSON
Lic. No. 0402071830
PROFESSIONAL ENGINEER
VER 1 3 2020

REVISIONS

NO	DATE	REMARKS

FOOD LION
2110 Executive Drive, Salisbury, NC 28145
Telephone: 704.633.8250
Food Lion is a DELHAIZE AMERICA company.

FOOD LION REMODEL STORE #1208

13490 DUMFRIES RD
MANASSAS, VA 20112

PROJECT NO: 2019.0917
DATE: 2-13-20

40 OF 47

E4.02

CUST. SERV. WORKRM & CHECK OUT POWER PLAN

CHECKED: BKJ DRAWN: MVI

COPYRIGHT © 2020 INTERPLAN LLC. RESERVES COPYRIGHT & OTHER RIGHTS RESTRICTING THESE DOCUMENTS TO THE ORIGINAL SITE ON PURPOSES FOR WHICH THEY WERE PREPARED. REPRODUCTIONS, CHANGES OR ASSIGNMENTS ARE PROHIBITED.

marwas - 02/11/2020 6:06:12 PM