

REVISIONS

NO.	DESCRIPTION

RENEWED MEDICAL BUILDING
 CORE & SHELL ONLY
 SOUTH FULTON, GEORGIA
 PROJECT #19-9883

PROJECT



03/27/2020
 SEAL

MARCH 27, 2020

PERMIT SET
 RELEASED FOR CONSTRUCTION
 RELEASE DATE


2ND FLOOR
 FRAMING PLAN

DRAWING TITLE

© COPYRIGHT 2020 JEFFERSON BROWNE GRESHAM ARCHITECTS. THIS DOCUMENT AS AN INSTRUMENT OF SERVICE REMAINS THE PROPERTY OF JEFFERSON BROWNE GRESHAM ARCHITECTS AND NO PART THEREOF MAY BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM JEFFERSON BROWNE GRESHAM ARCHITECTS.

Drawn By: **cmh**
 Checked By: **cmh**
 PROJECT # **S-102**
 19-9883



GGHE
GOODMAN GIANNAVOLA HINES ENGINEERS
 314 14th STREET
 SUITE 2
 ATLANTA, GA 30318
 GGHEngineers.com

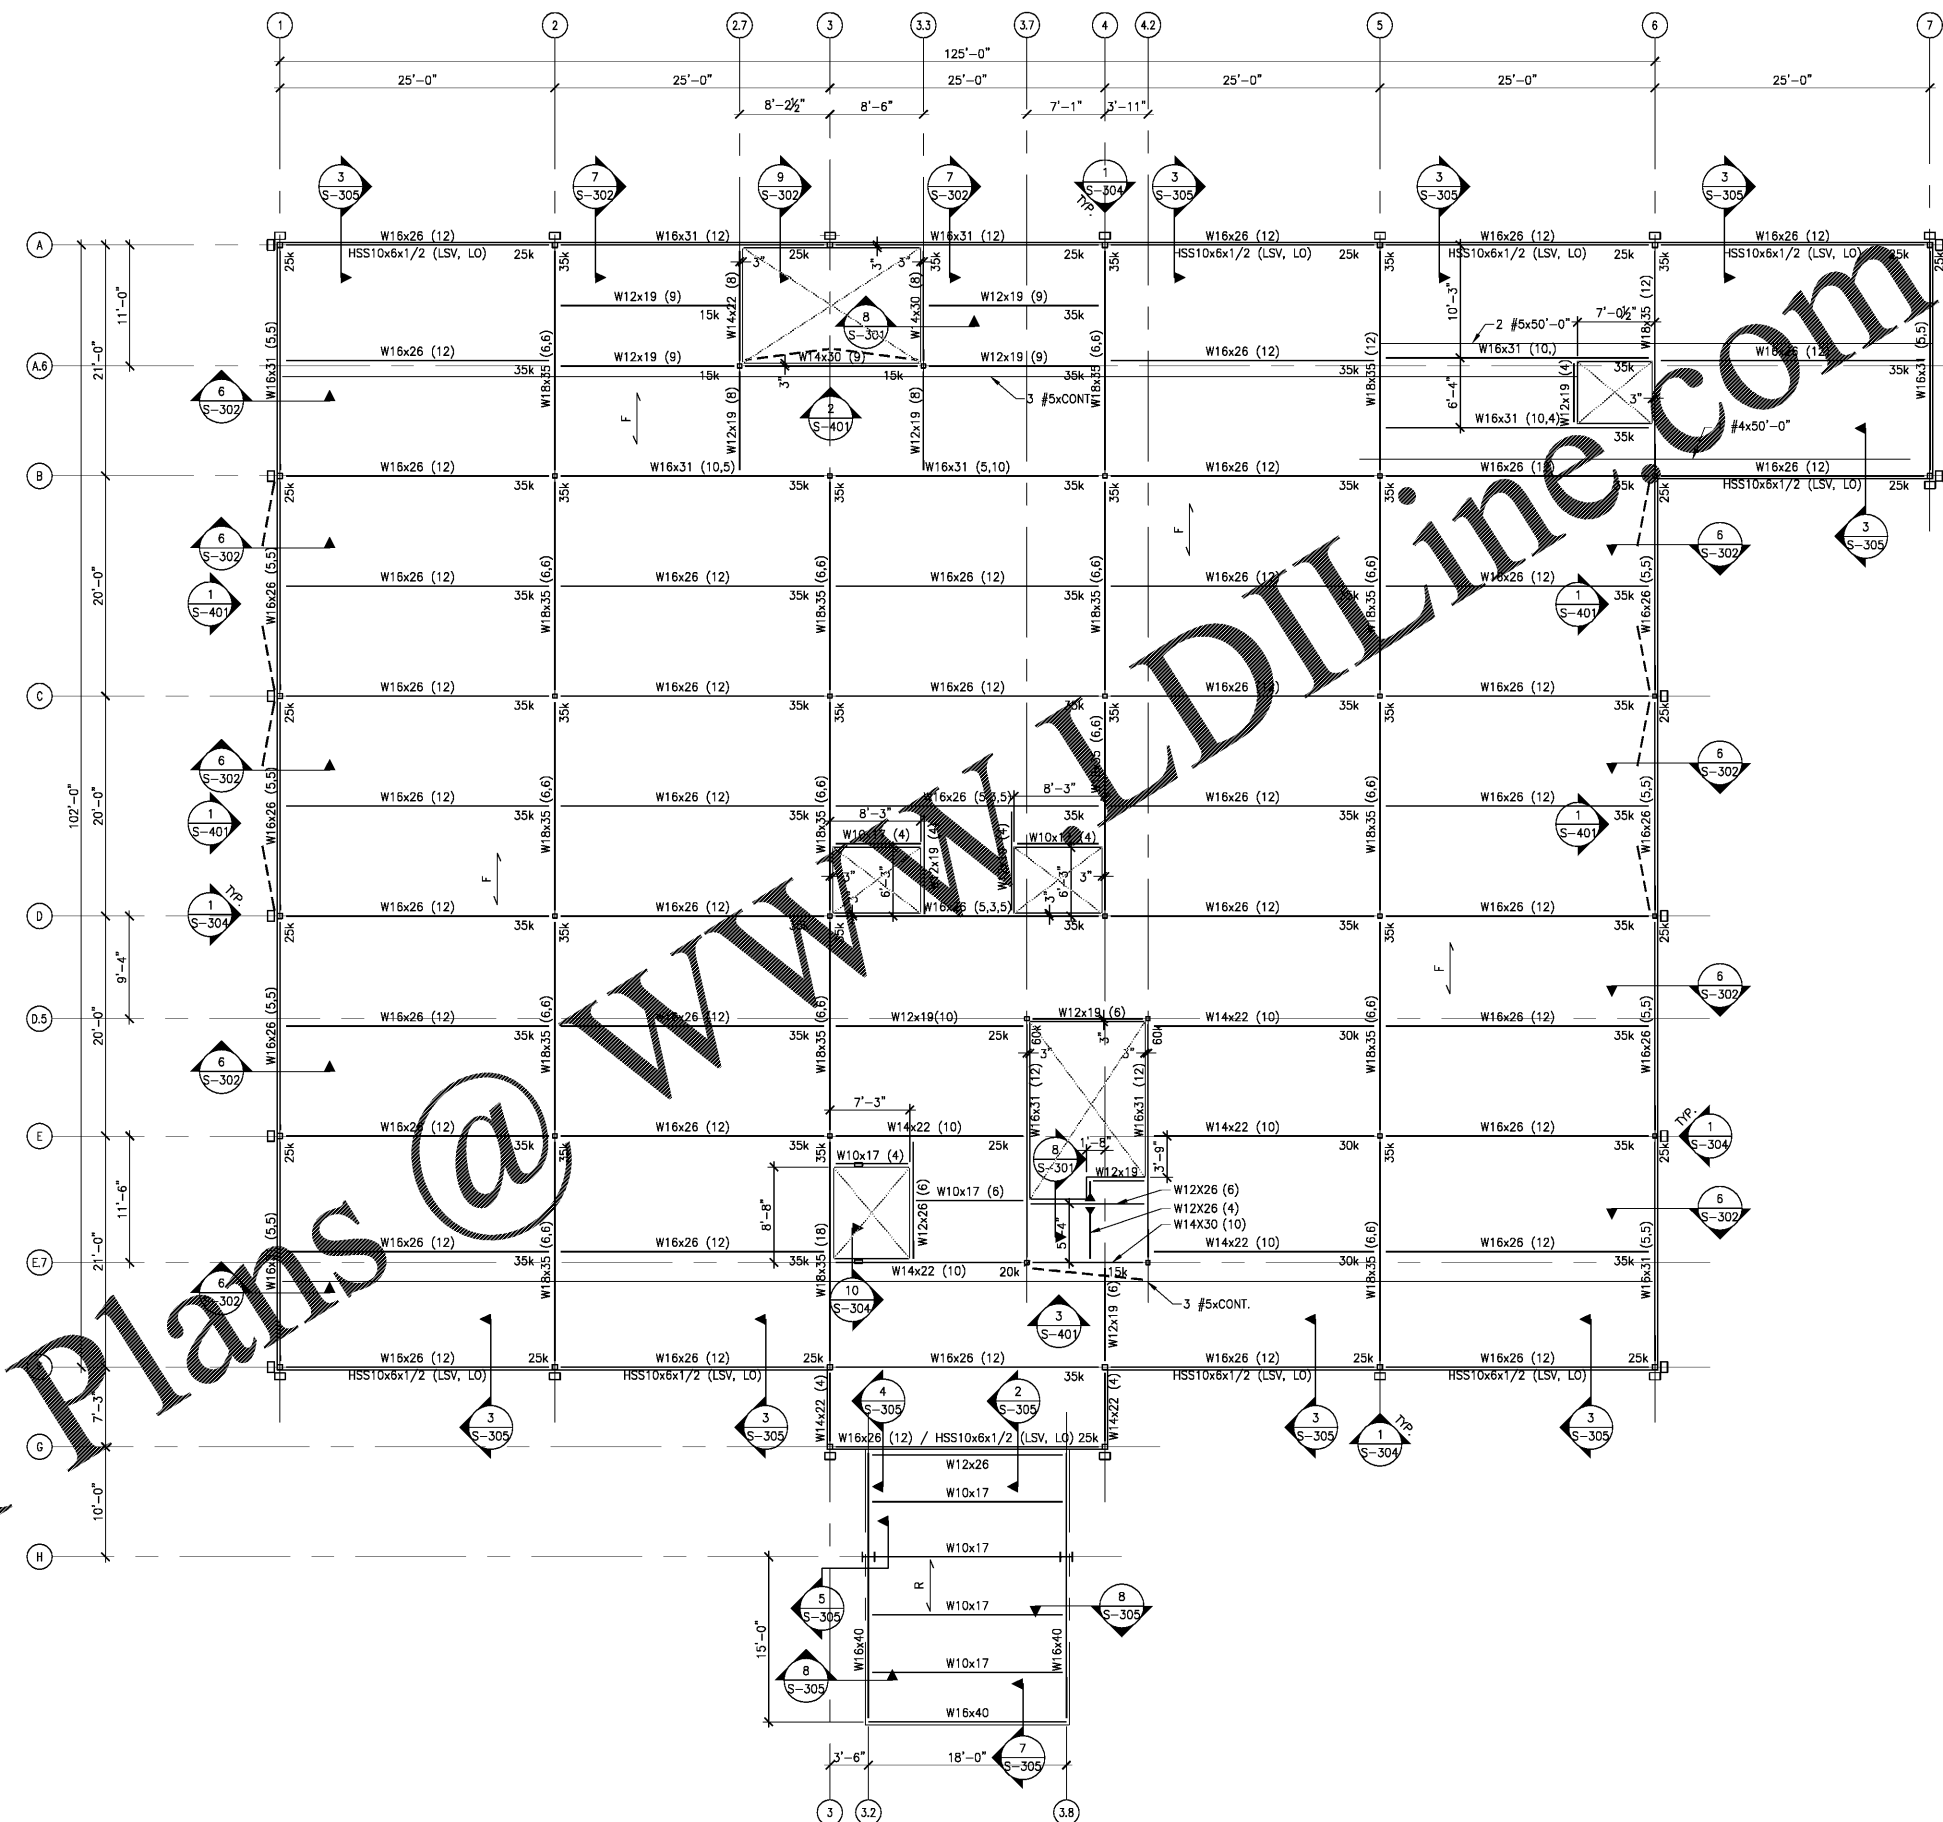

2ND FLOOR FRAMING PLAN
 SCALE: 1/8"=1'-0"



- UPPER LEVEL FRAMING PLAN NOTES:
1. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS BEFORE COMMENCING CONSTRUCTION. ALL DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT AND THE STRUCTURAL ENGINEER. FOR ADDITIONAL INFORMATION SEE ARCHITECTURAL DRAWINGS AND STRUCTURAL NOTES SHEET S-001
 2. COORDINATE SIZE AND LOCATION OF ALL OPENINGS IN FLOOR WITH ARCH, MECH, AND PLUMBING DRAWINGS.
 3. TOP OF CONCRETE SLAB ELEVATION = +15'-0". ALL OTHER ELEVATIONS ARE MEASURED FROM THIS DATUM.
 4. TOP OF STEEL ELEVATION = -6 1/2" FROM TOP OF CONCRETE SLAB, U.N.O. BY (-x"). ADJUST T/STEEL FOR JOIST BEARING AS REQUIRED.
 5. BEAMS ARE LOCATED 4" FROM EOS, U.N.O. PROVIDE 1/4" BENT PLATE AT ALL EDGES OF SLAB.
 6. **F** INDICATES 3 1/2" NORMAL WEIGHT CONCRETE (145 pcf) TOPPING ON 3" 20 GA GALVANIZED COMPOSITE STEEL DECK (6 1/2" TOTAL THICKNESS). DECK SHALL BE CONTINUOUS OVER THREE SPANS, MIN. REINFORCE WITH 6x6-W2.9xW2.9 W.W.F. LOCATED 1" BELOW THE TOP OF SLAB.
 7. **R** INDICATES SPAN OF 1 1/2" DEEP, TYPE B, 22 GA GALVANIZED STEEL WIDE RIB ROOF DECK (THREE SPAN MIN. CONDITION). FASTEN DECK TO ALL SUPPORTS PARALLEL AND PERP. TO SPAN, ATTACH USING 36/4 (4) PATTERN. SEE S-002 FOR ADDITIONAL INFORMATION.
 8. SEE 4/S-301 FOR TYPICAL CONNECTION DETAILS.
 9. BEAMS ARE EQUALLY SPACED BETWEEN COLUMN LINES AND/OR DIMENSIONED BEAMS

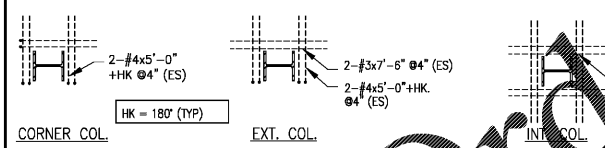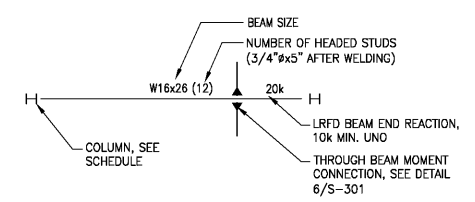

REQUIRED CONTINUITY REINFORCING

Order Plans @ WWW.DIline.com