
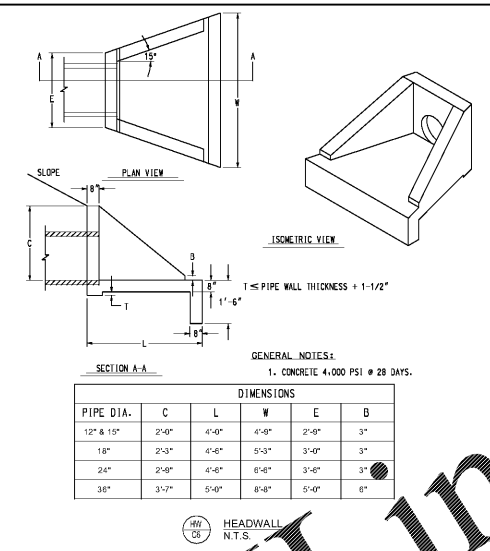
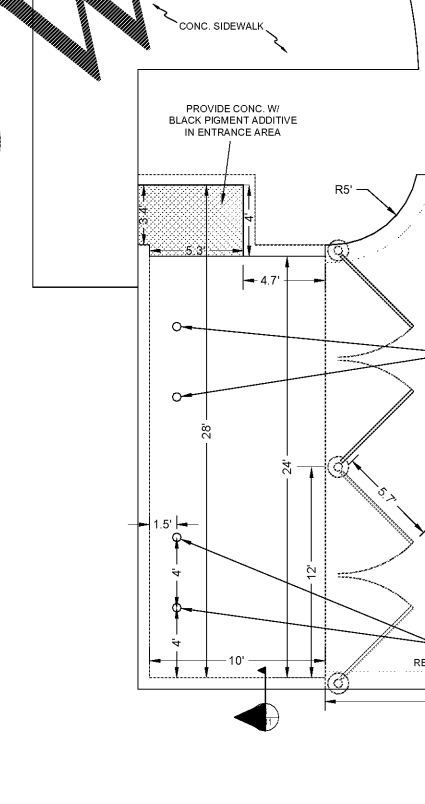





SITE RETAINING WALL SCHEDULE

RETAINED HEIGHT "HT"	W	X	L	D	A	B	C
TO 4'-0"	1'-0"	1'-0"	3'-0"	1'-0"	#5 @ 12"	#5 @ 12"	#5 @ 12"
4'-1" TO 6'-0"	1'-2"	1'-10"	4'-0"	1'-0"	#5 @ 12"	#5 @ 12"	#5 @ 12"

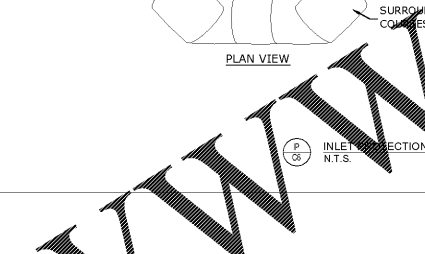



DIMENSIONS

PIPE DIA.	C	L	W	E	B
12" & 15"	2'-0"	4'-0"	4'-0"	2'-0"	3"
18"	2'-3"	4'-6"	5'-3"	3'-0"	3"
24"	2'-6"	4'-6"	6'-4"	3'-6"	3"
36"	3'-2"	5'-0"	8'-4"	5'-0"	6"

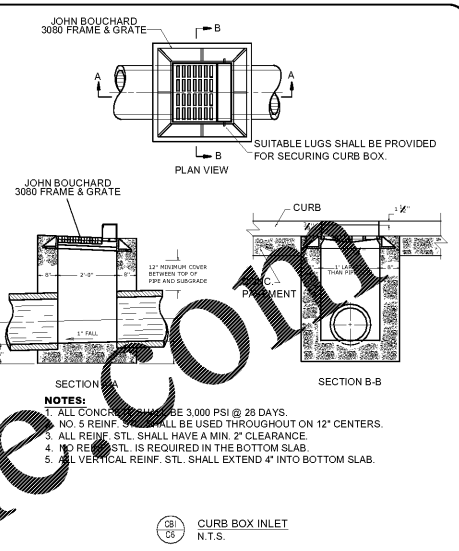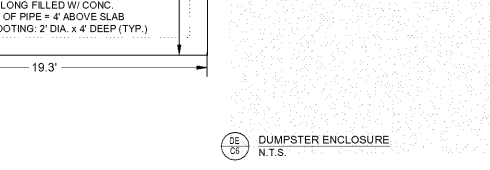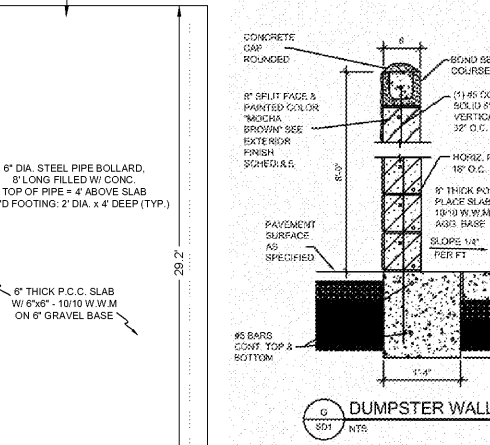

MATERIAL SPECIFICATION

SPECIFICATION	LIGHT DUTY SILT FENCE (SF-LD)
MIN. TENSILE STRENGTH (LBS)	WARP - 120
ASTM D-4632	FILL - 100
MAX. ELONGATION (%)	40
ASTM D-4632	#30
APPARENT OPENING SIZE	25
MAX. SIEVE SIZE (ASTM D-4751)	80
MAX. FLOW RATE (GAL/MIN/FT)	80
GDT-37	
ULTRAVIOLET STABILITY	WARP - 120
ASTM D-4632 AFTER 300 HOURS PER ASTM D-4355	
MIN. BURSTING STRESS (PSI)	FILL - 100
ASTM D-3786	
MIN. FABRIC WIDTH (IN)	36 IN

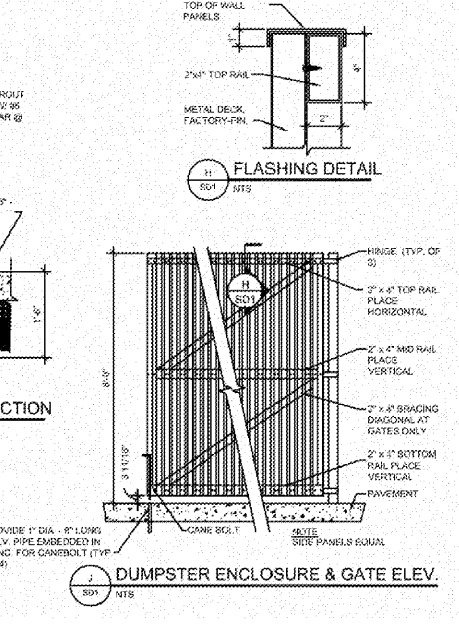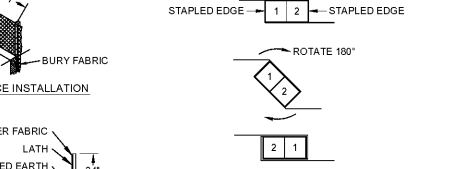

REVISIONS

NO.	DESCRIPTION

PopEyes
NASHVILLE ROAD
BOWLING GREEN, KY 42103

ACES
ARNOLD CONSULTING
ENGINEERING SERVICES, INC.
P.O. BOX 1398
BOWLING GREEN, KY 42101
PHONE (270) 760-9445

JOB NUMBER: 20-1336-L
DATE: 04-23-2020
SCALE: N.T.S.
DRAWN: A. ARNOLD
CHECKED: A. ARNOLD
FILE PATH: 23112013-DETAILS.DWG



C6
DETAILS