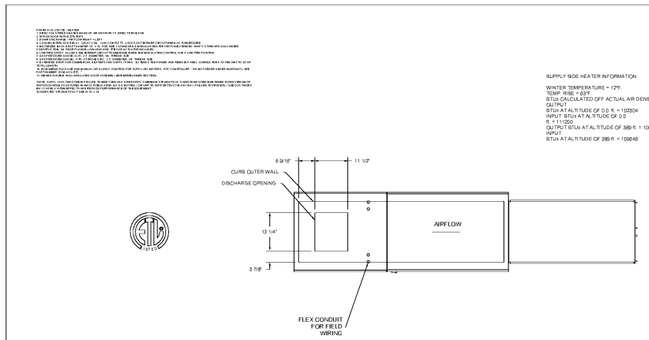

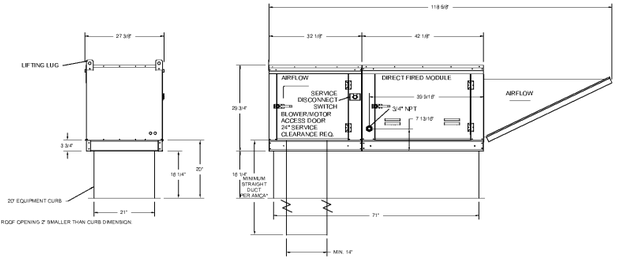

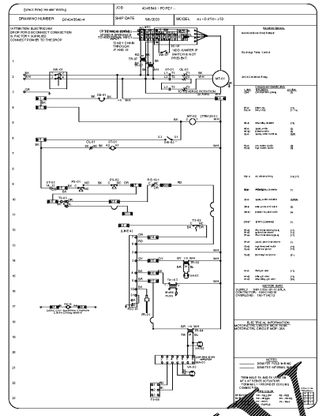

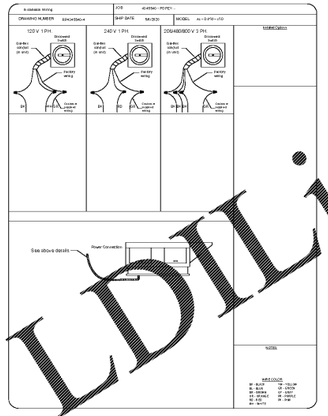

Direct Fired (DF) Portfolio Packaged Rooftop Unit

Direct Fired

SUPPLY SIDE HEATER INFORMATION

WINTER TEMPERATURE = 12°F
SUMMER TEMP = 95°F
BTUs CALCULATED OFF ACTUAL AIR DENSITY
OUTPUT
BTUs AT ALTITUDE OF 0.0 ft. = 102304
INPUT BTUs AT ALTITUDE OF 0.0
INPUT
OUTPUT BTUs AT ALTITUDE OF 389 ft. = 100874
INPUT
BTUs AT ALTITUDE OF 389 ft. = 109648

Order Plans @ www.LDILine.com

REVISIONS	
DESCRIPTION	DATE
△	
△	
△	
△	

CAPTIVE AIRE
Northern Regional Office
855 Morrison Rd, Gahanna, OH, 43230 PHONE: 614-501-1999 FAX: 877-237-7526 EMAIL: info@captiveaire.com

POPEYES - Bowling Green, KY
Dishman Lane
Bowling Green, KY, 42101

DATE: 5/6/2020
DWG.#: 4345540
DRAWN BY: Tanderson
SCALE: 3/4" = 1'-0"
MASTER DRAWING
SHEET NO. 4

FRCH NELSON
A NELSON BRAND
311 Elm Street Suite 600
Cincinnati OH 45202
513 241 3000
www.frchnelson.com

LOUISIANA KITCHEN
POPEYES

JPL MANAGEMENT

ISSUE INFORMATION

REVISIONS

△ _____ _____

Nelco Architecture, Inc.

STATE OF KENTUCKY
JOHN
NELCO
30829
LICENSED
PROFESSIONAL ENGINEER

05/08/2020

PROJECT INFORMATION

BOWLING GREEN, KY

DISHMAN LANE
BOWLING GREEN, KY 42101

PROJECT #: 11352

SHEET INFORMATION

CAPTIVE AIRE DETAILS

DRAWN BY: Designer
REVIEWED BY: Checker
SCALE: 1/2" = 1'-0"
AUTHORIZED FOR: PERMIT

M8

© The drawing, pattern or otherwise, is the copyrighted property of Nelco Architecture, Inc. The drawing may not be used, reproduced or copied without the permission of Nelco Architecture, Inc.

5/13/2020 12:24:28 PM C:\Users\tdduffy\Documents\11352 - Popeyes - Bowling Green KY_tdduffyDFFAU.rvt