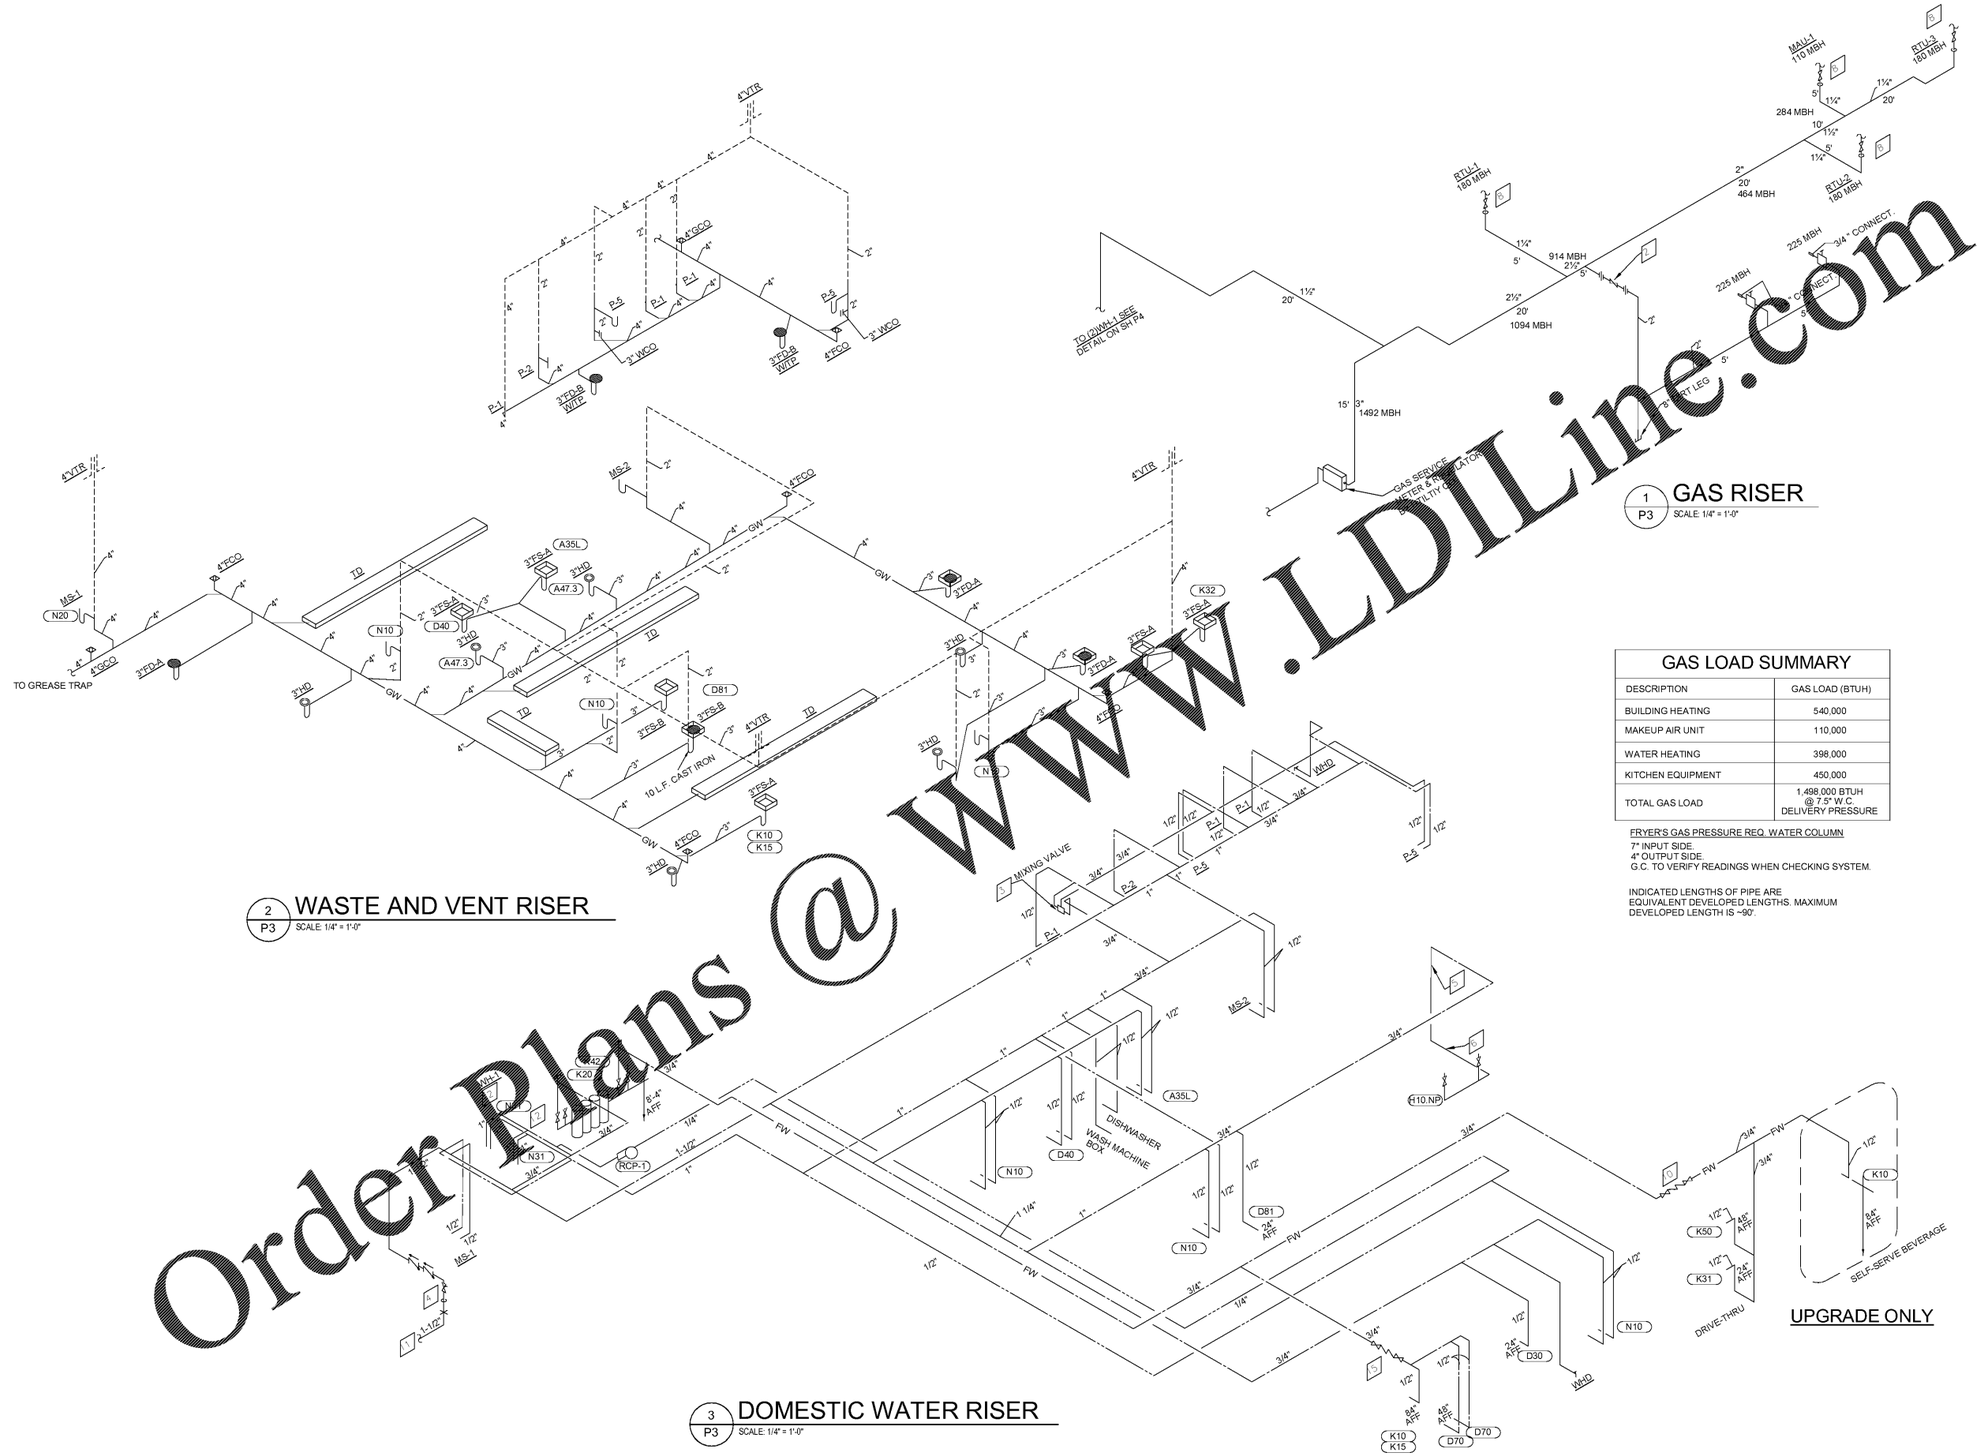

1 P3 GAS RISER
SCALE: 1/4" = 1'-0"

2 P3 WASTE AND VENT RISER
SCALE: 1/4" = 1'-0"

3 P3 DOMESTIC WATER RISER
SCALE: 1/4" = 1'-0"

UPGRADE ONLY

GAS LOAD SUMMARY	
DESCRIPTION	GAS LOAD (BTUH)
BUILDING HEATING	540,000
MAKEUP AIR UNIT	110,000
WATER HEATING	398,000
KITCHEN EQUIPMENT	450,000
TOTAL GAS LOAD	1,498,000 BTUH @ 7.5" W.C. DELIVERY PRESSURE

FRYER'S GAS PRESSURE REQ. WATER COLUMN
7" INPUT SIDE.
4" OUTPUT SIDE.
G.C. TO VERIFY READINGS WHEN CHECKING SYSTEM.

INDICATED LENGTHS OF PIPE ARE EQUIVALENT DEVELOPED LENGTHS. MAXIMUM DEVELOPED LENGTH IS ~90'.

Order Plans @ www.LDILine.com

FRCH NELSON
A NELSON BRAND
311 Elm Street Suite 600
Cincinnati OH 45202
513 241 3000
www.frchnelson.com

LOUISIANA KITCHEN
POPEYES

JPL MANAGEMENT

ISSUE INFORMATION

REVISIONS

Nelco Architecture, Inc.

STATE OF KENTUCKY
JOHN M. QUILLEN
30529
LICENSED
PROFESSIONAL ENGINEER
05/08/2020

PROJECT INFORMATION

BOWLING GREEN, KY

DISHMAN LANE
BOWLING GREEN, KY 42101

PROJECT #:
11352

SHEET INFORMATION

RISER DIAGRAM

DRAWN BY:
ED/ZF/BD

REVIEWED BY:
JJG/JWQ

SCALE:
N.T.S.

AUTHORIZED FOR:
PERMIT

P3

© The drawing, printed or otherwise, is the copyrighted property of Nelco Architecture, Inc. The drawing may not be used, reproduced or copied without the permission of Nelco Architecture, Inc.

5/12/2020 12:24:35 PM C:\Users\eduffy\Documents\11352 - Popeyes - Bowling Green KY_eduffyQFFAU.rvt