


2 CHASE DTL. @ QUEUING (103)  
SCALE: 1 1/2" = 1'-0"

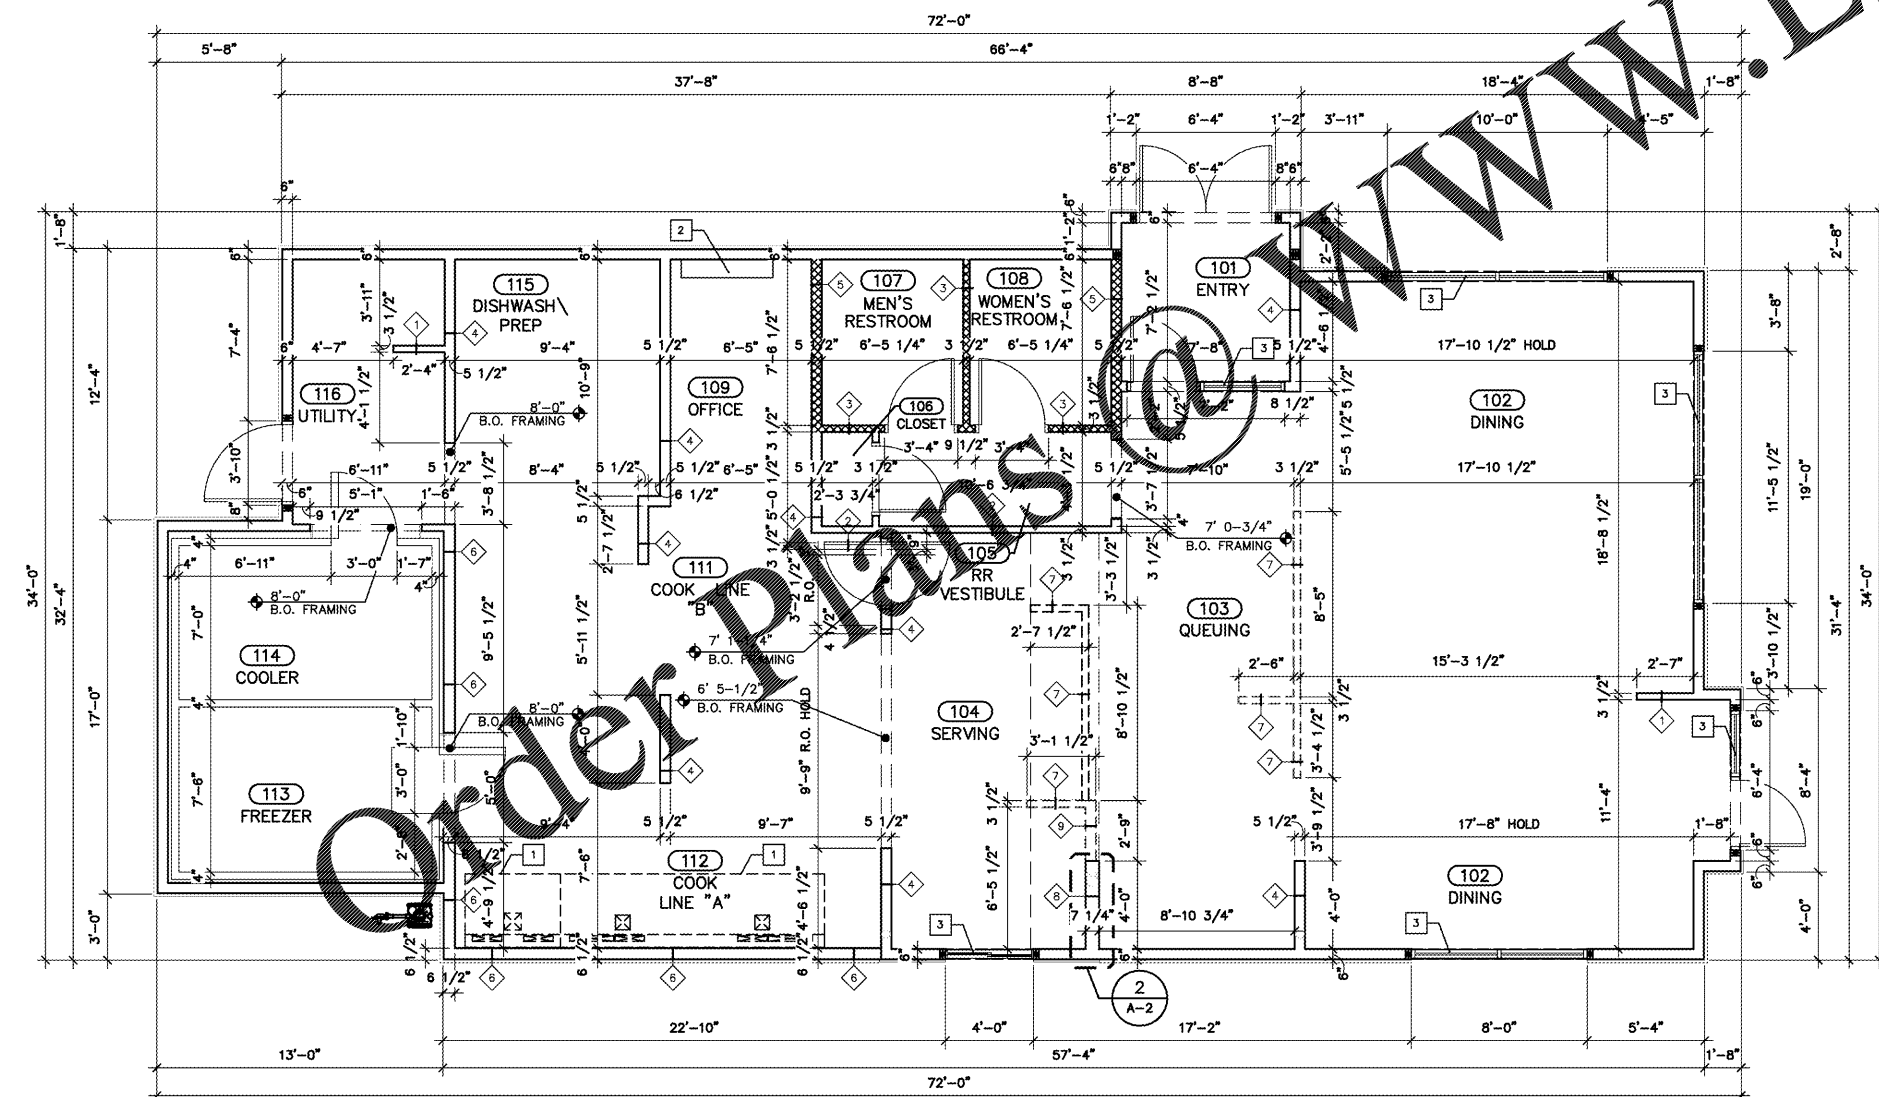

1 DIMENSIONED FLOOR PLAN  
SCALE: 1/4" = 1'-0"

GENERAL NOTES

- REFER TO STRUCTURAL DRAWINGS FOR FRAMING, LUMBER SIZE AND SPACING REQUIREMENTS AT ALL EXTERIOR WALLS. INFORMATION INDICATED ON THE STRUCTURAL DRAWINGS SHALL TAKE PRECEDENCE OVER THE ARCHITECTURAL DRAWINGS.
- INTERIOR WOOD STUDS SHALL BE 2X4'S, 2X6'S, OR 2X8'S AS DIMENSIONED ON FLOOR PLAN. INTERIOR STEEL STUDS SHALL BE 6", 18 GA. AS DIMENSIONED ON FLOOR PLAN OR AS DETAILED. - SEE STRUCTURAL DRAWINGS FOR ADDITIONAL WALL CONSTRUCTION DETAILS.
- REFER TO WALL SECTIONS FOR ADDITIONAL CONSTRUCTION DETAILS.
- G.C. TO COORDINATE AND VERIFY ALL BLOCKING & WALL BRACING LOCATIONS WITH EQUIPMENT & SEATING DRAWINGS.
- REFER TO EXTERIOR ELEVATIONS FOR REQUIRED EXTERIOR FINISHES.
- REFER TO INTERIOR ELEVATIONS AND FINISH MATERIAL SCHEDULE FOR REQUIRED FINISHES.
- BRACE STUD WALLS TO STRUCTURE ABOVE FOR SOUND STABLE INSTALLATION.
- PROVIDE 2X FIRE STOP BLOCKING IN CONCEALED SPACES AT ALL STUD WALLS AT CEILING LEVEL AND AT 10'-0" INTERVALS AND OTHERWISE REQUIRED BY CODE.
- SEE EXTERIOR ELEVATIONS FOR BRACING REQUIREMENTS FOR EXTERIOR LADDER PORT CONNECTION.
- DIMENSIONS INDICATED ON THE FLOOR PLAN ARE FROM FACE OF STUD WALLS AT CEILING LEVEL AND AT 10'-0" INTERVALS AND OTHERWISE REQUIRED BY CODE.
- REFER TO SHEETS 111 FOR FLOOR AND WINDOW SCHEDULE AND A-11.1 FOR FRAMING DETAILS.
- ALL FRAMING, SUBSTRATE, AND FINISHES WITHIN 24" OF KITCHEN HOODS TO BE NON-COMBUSTIBLE.
- SEE SHEET A7.1 FOR TABLES TO BE ATTACHED TO ADJACENT WALL. PROVIDE BLOCKING IN WALL PER SHEET A7.1

KEYED NOTES

- KITCHEN HOOD REFER TO A-3 AND MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION
- 6" CONCRETE CURB FOR SWITCHGEAR - SEE 1/A9.1 AND FOUNDATION PLAN FOR ADDITIONAL INFORMATION.
- WALL FRAMING BELOW WINDOW OPENING THIS LOCATION - SEE INTERIOR ELEVATIONS AND A-11 FOR MORE INFO


WALL TYPES

- 2x4 WOOD FRAMING @ 16" O.C. EXTEND TO BOTTOM OF ROOF TRUSSES ABOVE
- 2x4 WOOD FRAMING @ 16" O.C. EXTEND TOP OF ROUGH FRAMING 3" PAST THE HIGHEST ADJACENT CEILING LINE.
- 2x4 WOOD FRAMING @ 16" O.C. PROVIDE FULL THICKNESS & FULL HEIGHT KRAFT FACED SOUND BATT INSULATION. EXTEND TO BOTTOM OF ROOF TRUSSES.
- 2x6 WOOD FRAMING @ 16" O.C. EXTEND TO BOTTOM OF ROOF TRUSSES ABOVE.
- 2x6 WOOD FRAMING @ 16" O.C. PROVIDE FULL THICKNESS & FULL HEIGHT KRAFT FACED SOUND BATT INSULATION. EXTEND TO BOTTOM OF ROOF TRUSSES ABOVE.
- 600S162-43 18 GAUGE, 33 KSI METAL STUDS @ 16" O.C. SEE WALL SECTIONS FOR HEIGHT OF STUDS. ALSO SEE FRAMING PLAN FOR FURTHER CLARIFICATION. ALL EXTERIOR PLYWOOD AT THIS WALL TYPE IS TO BE FIRE RETARDANT PLYWOOD. INTERIOR SIDE OF STUD WALL IS TO BE SHEATHED IN 5/8" DUROCK TO 24" ABOVE LINE OF THE KITCHEN HOODS. 5/8" TYPE X GYP BOARD CAN BE INSTALLED ABOVE THE DUROCK (STARTING AT 24" ABOVE THE HOODS). AT THIS WALL LOCATION THE CONTRACTOR IS TO INSULATE WITH MINERAL WOOL INSULATION IN LIEU OF BATT INSULATION (MATCH SPECIFIED R-VALUE) - SEE WALL SECTIONS FOR FURTHER CLARIFICATION & ADDITIONAL GYP BOARD THAT IS TO BE INSTALLED ON UNDER SIDE OF TRUSSES / IN EXHAUST SHAFT.
- 2x4 WOOD FRAMING @ 16" O.C., PARTIAL HEIGHT WALL SEE INTERIOR ELEVATIONS FOR WALL FINISHED HEIGHT.
- 2x8 WOOD FRAMING @ 16" O.C. EXTEND TO BOTTOM OF ROOF TRUSSES ABOVE
- 2x6 WOOD FRAMING @ 16" O.C., PARTIAL HEIGHT WALL SEE INTERIOR ELEVATIONS FOR WALL FINISHED HEIGHT.

- WALL SURFACE GENERAL NOTES:
- PROVIDE 1/2" GYP. BD. ON ALL WALL SURFACES UNLESS NOTED OTHERWISE IN RR VESTIBULE 105, SERVING 104, QUEUING 103, DINING 102, ENTRY 101, MEN'S RESTROOM 107, WOMEN'S RESTROOM 108. AT ALL COMBUSTIBLE STUD LOCATIONS AT COOKLINE A 112, COOKLINE B 111, OFFICE 109, DISHWASH / PREP 115, UTILITY 116 THE CONTRACTOR IS TO INSTALL DUROCK FOR THE FIRST 16" ABOVE THE FINISHED FLOOR, THE REMAINING HEIGHT OF THE WALL IS TO BE CLAD IN 1/2" PLYWOOD.
  - PROVIDE MOISTURE RESISTANT GYP. BD. AT WET WALL LOCATIONS.
  - THE INTERIOR SIDE OF THE EXTERIOR FRAMED WALLS SHALL HAVE THE GYP BOARD / PLYWOOD / DUROCK EXTENDED TO THE ROOF DECK ABOVE SO THAT NO EXTERIOR KRAFT FACED INSULATION IS EXPOSED. ABOVE THE LINE OF THE FINISHED CEILING, IT IS THE CONTRACTORS OPTION TO ONLY PROVIDE FIRE TAPE FINISH AT GYP BOARD LOCATIONS ABOVE THE LINE OF THE FINISHED CEILING.
  - AT THE INTERIOR WALLS, THE CONTRACTOR IS TO EXTEND THE GYP BOARD OR PLYWOOD TO 3" ABOVE THE LINE OF THE ADJACENT FINISHED CEILING AND PROVIDE FIRE BLOCKING AS REQUIRED. AT WALL LOCATIONS WHERE KRAFT FACED INSULATION IS PROVIDED, THE CONTRACTOR SHALL EXTEND THE GYP BOARD / PLYWOOD / DUROCK FULL HEIGHT TO THE UNDERSIDE OF THE ROOF DECK ABOVE. KRAFT FACED INSULATION SHALL NOT BE EXPOSED ABOVE THE LINE OF THE FINISHED CEILING.
  - ALL NEW FRAMED WALLS TO RECEIVE TREATED BOTTOM PLATES, TYP.
  - ALL INTERIOR WALLS SEPARATING RESTROOM VESTIBULE (105), RESTROOMS (107 & 108), & ENTRY (101) FROM DINING / OFFICE AREAS TO RECEIVE SOUND BATT INSULATION, TYP. - AREAS SHOWN HATCHED ON FLOOR PLAN, SEE WALL TYPES.



A NEW LOCATION FOR  
**CAPTAIN D'S**  
7525 STATE AVENUE  
KANSAS CITY, KS 66112  
**CAPTAIN D'S, LLC**  
624 GRASSMERE PARK DRIVE,  
SUITE 30  
NASHVILLE, TN 37211



Job Number:  
Revisions:

**A-2**  
DIMENSIONED  
FLOOR PLAN